
END VIEW CL TANK



CONSTRUCTION NOTES

- 1. TANK SHALL BE AN ABOVEGROUND ATMOSPHERIC OR LOW-PRESSURE TANK THAT MEETS OR EXCEEDS THE *UL-142 STANDARD (ACTUAL TANK MAY DIFFER FROM DETAIL SHOWN).
- 2. TANK SHALL BE LOCATED ON A CLEAN HARD SURFACE AND SHALL EXTEND 2 FEET (MIN) BEYOND THE OUTSIDE DIMENSIONS OF THE TANK.
- 3. VEHICLE FILLING AREA SHALL HAVE A SIMILAR SURFACE
- 4. VEHICLE PROTECTION IS REQUIRED. GUARD POSTS OR SIMILAR APPROVED PROTECTION IS ACCEPTABLE. POSTS SHALL BE LOCATED WHERE NECESSARY FOR MAXIMUM ACCIDENTAL CONTACT PROTECTION.
- 5. SAFETY SIGNS SHALL BE PLACED AT FACILITY. THIS INCLUDES A MINIMUM OF ONE "NO SMOKING" SIGN AT FUELING AREA. FILL PORTS SHALL BE PAINTED WITH THE PROPER PAINT CODE FOR THE FUEL(S) BEING CONTAINED; GASOLINE-RED, DIESEL-YELLOW, KEROSENE-BROWN
- 6. ANY CHANGES TO THIS DESIGN MUST BE APPROVED BY NRCS
- 7. NOTIFY NRCS AT LEAST 2 DAYS PRIOR TO START OF CONSTRUCTION.

*UNDERWRITERS LABORATORIES STANDARD NO. 142 "STANDARD FOR STEEL ABOVEGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS"

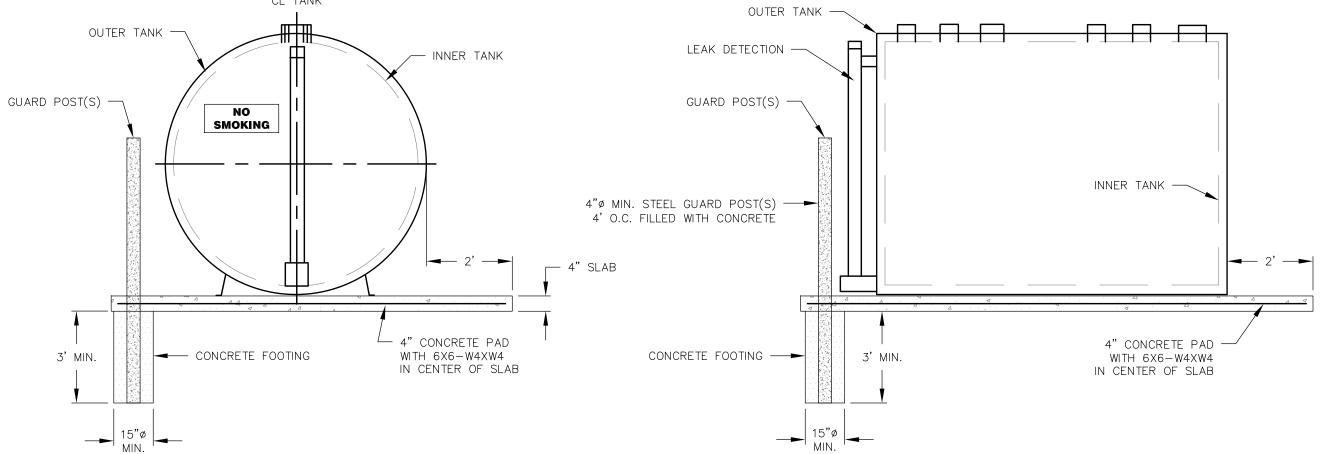

SIDE VIEW

- 1. AVOID AREAS
 - CLOSER THAN 300 FT FROM A WELL
 - CLOSER THAN 25 FT TO MAJOR TRAFFIC AREAS
 - CLOSER THAN 10 FT TO ANY BUILDING
 - WHERE RISK OF VANDALISM IS HIGH
- 2. CONTACT INSURANCE CARRIER REGARDING PLACEMENT OF TANKS NEAR BUILDINGS



Dig Safe System, Inc. It's Smart. It's Easy. It's the Law. 1-888-DIG-SAFE (888) 344-7233

digsafe.com

BILL OF MATERIALS

| ITEM # | ITEM | QUANTITY | UNIT | CONSTRUCTION SPECIFICATIONS |
|-----------|------------------|----------|------|-----------------------------|
| 1. | PSI CONCRETE | | C.Y. | 31 |
| 2. | CLEAN STONE | | C.Y. | 11 |
| 3. | STEEL GUARD POST | | EA | |

HAZARD C LOW 7

ICTURE

WALL FUEL CONTAINMENT STRU TYPICAL SECTIONS & NOTES DUAL

rawing Name