



DOUBLE-WALL TANK SECONDARY CONTAINMENT FACILITY  
(NOT TO SCALE)

END VIEW

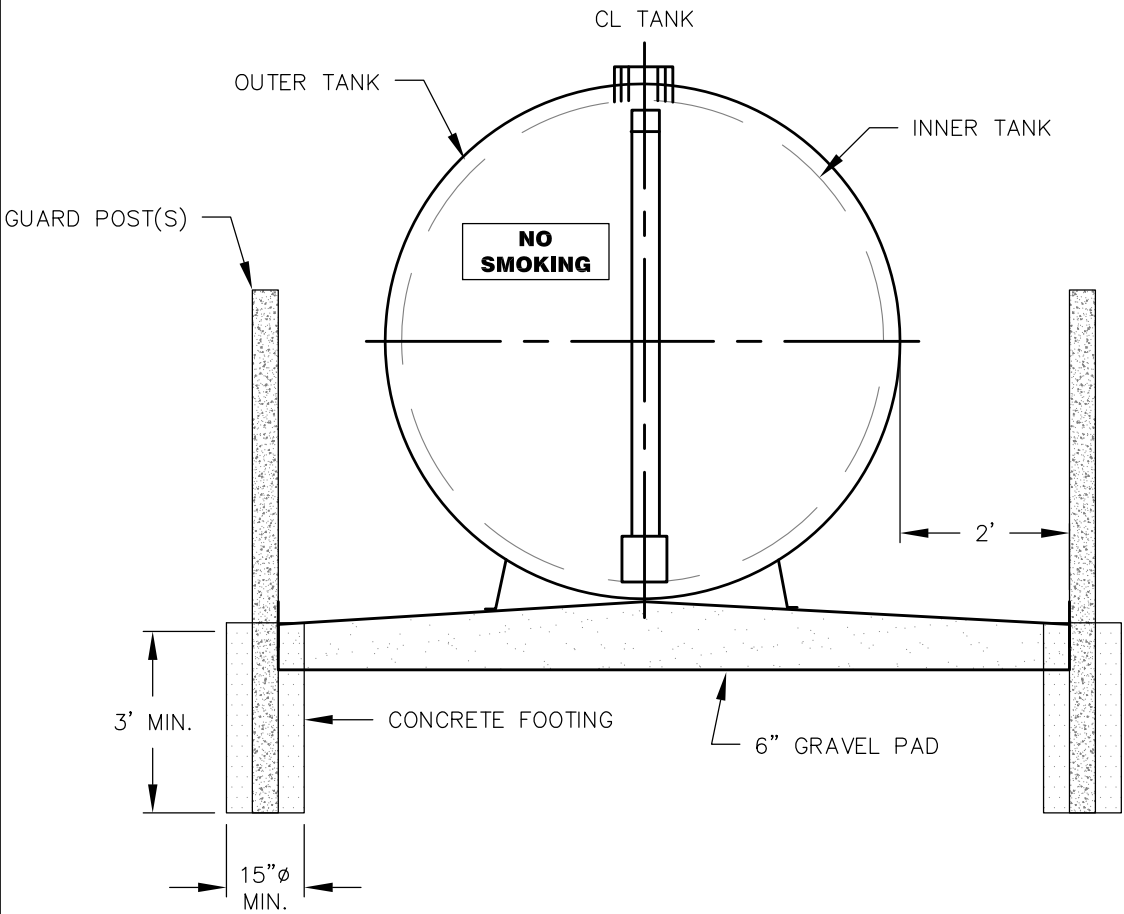

SIDE VIEW

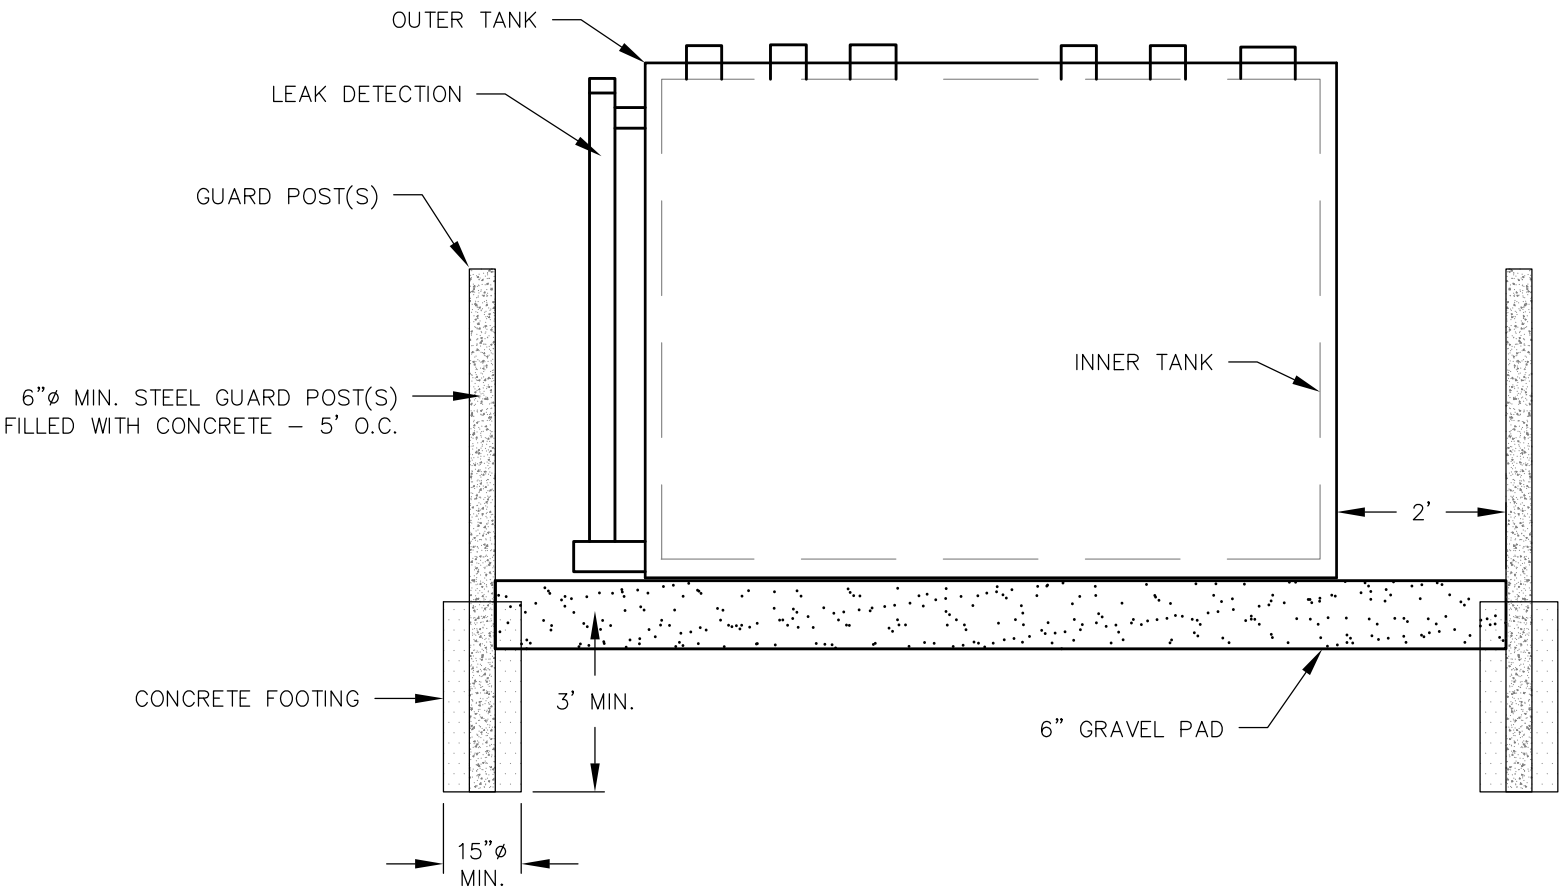

CONSTRUCTION NOTES

1. TANK SHALL BE AN ABOVEGROUND ATMOSPHERIC OR LOW-PRESSURE TANK THAT MEETS OR EXCEEDS THE \*UL-142 STANDARD (ACTUAL TANK MAY DIFFER FROM DETAIL SHOWN).
2. TANK SHALL BE LOCATED ON A CLEAN HARD GRAVEL SURFACE AND SHALL EXTEND 2 FEET (MIN) BEYOND THE OUTSIDE DIMENSIONS OF THE TANK.
3. VEHICLE FILLING AREA SHALL BE A CLEAN HARD DURABLE SURFACE.
4. GUARD POSTS SHALL BE INSTALLED AROUND THE TANK AND SHALL BE SPACED NO MORE THAN 5 FEET APART. GUARD POST SHALL BE SCH. 80 STEEL PIPE FILLED WITH CONCRETE OR OTHER APPROVED MATERIALS.
5. SAFETY SIGNS SHALL BE PLACED AT FACILITY. THIS INCLUDES A MINIMUM OF ONE "NO SMOKING" SIGN AT FUELING AREA. FILL PORTS SHALL BE PAINTED WITH THE PROPER PAINT CODE FOR THE FUEL(S) BEING CONTAINED; GASOLINE-RED, DIESEL-YELLOW, KEROSENE-BROWN
6. ANY CHANGES TO THIS DESIGN MUST BE APPROVED BY NRCS
7. NOTIFY NRCS AT LEAST 2 DAYS PRIOR TO START OF CONSTRUCTION.

\*UNDERWRITERS LABORATORIES STANDARD NO. 142 "STANDARD FOR STEEL ABOVEGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS"

SITE CONSIDERATIONS

1. AVOID AREAS
  - CLOSER THAN 300 FT FROM A WELL
  - CLOSER THAN 25 FT TO MAJOR TRAFFIC AREAS
  - CLOSER THAN 10 FT TO ANY BUILDING
  - WHERE RISK OF VANDALISM IS HIGH
2. CONTACT INSURANCE CARRIER REGARDING PLACEMENT OF TANKS NEAR BUILDINGS

BILL OF MATERIALS

ITEM #	ITEM	QUANTITY	UNIT	CONSTRUCTION SPECIFICATIONS
1.	3000 PSI CONCRETE		C.Y.	31
2.	CLEAN STONE		C.Y.	11
3.	STEEL GUARD POST		EA	



**Dig Safe System, Inc.**  
*It's Smart. It's Easy. It's the Law.*  
**1-888-DIG-SAFE**  
(888) 344-7233  
digsafe.com

Date \_\_\_\_\_  
Designed \_\_\_\_\_  
Drawn C.H. \_\_\_\_\_  
Checked \_\_\_\_\_  
Approved by \_\_\_\_\_



HAZARD CLASS  
LOW

JOB CLASS  
----

DUAL WALL FUEL CONTAINMENT STRUCTURE  
TYPICAL SECTIONS & NOTES

VERMONT

File Name

Drawing Name