


**UNITED STATES DEPARTMENT OF AGRICULTURE
NATURAL RESOURCES CONSERVATION SERVICE**

**GEORGIA STANDARD DRAWINGS - 20' WIDE, DEEP BIN, STAND
ALONE COMPOST FACILITY CONSTRUCTED WITH 6" X 6" POSTS**

1. THE FOLLOWING DRAWINGS WERE PREPARED IN ACCORDANCE WITH PRACTICE CODE 317-COMPOSTING FACILITY AND GEORGIA BUILDING CODE (INTERNATIONAL BUILDING CODE 2006)
2. DESIGN DATA REQUIRED BY IBC 2006:
 - A) ROOF LIVE LOAD - 19 PSF.
 - B) BASIC WIND SPEED OF 90 MPH AND GROUND SNOW LOAD OF 10 PSF OR BASIC WIND SPEED OF 100 MPH AND NO SNOW LOAD.
 - C) IMPORTANCE FACTOR, I=0.87
 - D) WIND EXPOSURE CATEGORY C.
 - E) INTERNAL PRESSURE COEFFICIENT = 0.55
3. THIS DESIGN IS NOT INTENDED FOR USE IN EXTREME SOUTH AND EAST COUNTIES OF THE STATE THAT ARE SUBJECT TO HURRICANE WIND LOADS (SEE MAP BELOW)
4. THIS DESIGN IS NOT INTENDED FOR CONSTRUCTION ON AN ISOLATED HILL, RIDGE, OR ESCARPMENT IN ANY REGION OF THE STATE.
5. ANY CHANGES TO THESE DRAWINGS MUST BE APPROVED BY AN ENGINEER WITH JOB APPROVAL LEVEL IV OR GREATER.

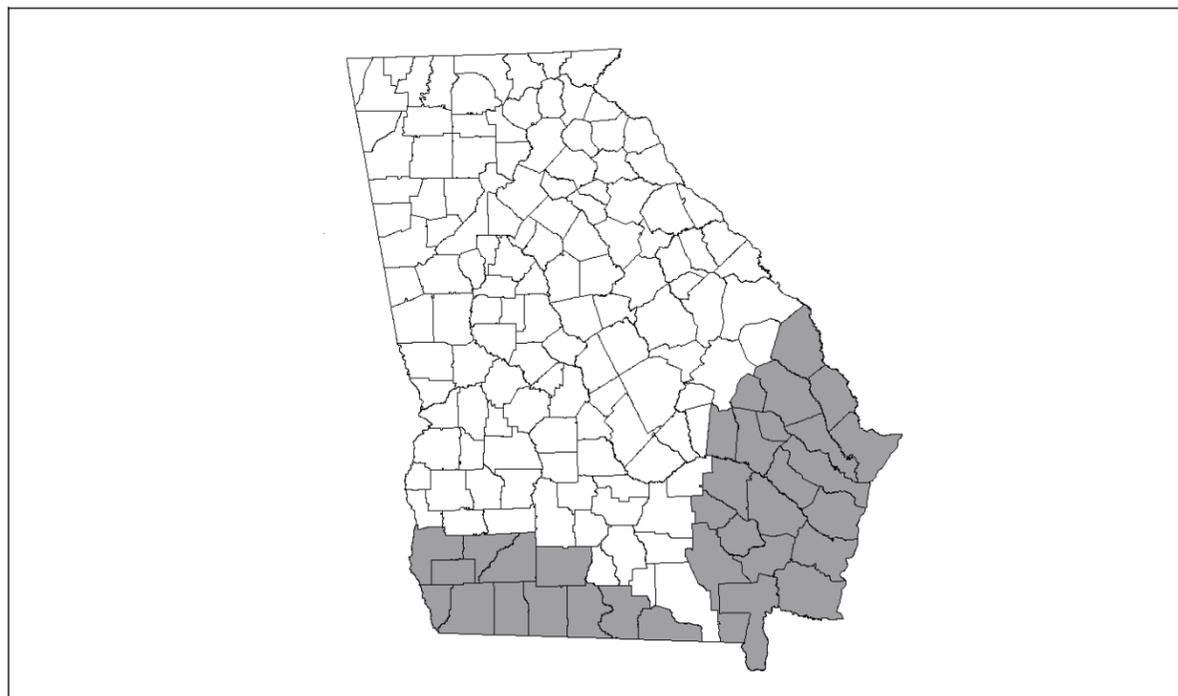

THIS DESIGN IS NOT INTENDED FOR USE IN COUNTIES SUBJECT TO HURRICANE WIND LOADS SHADED GRAY ABOVE.

**THE NATURAL RESOURCES CONSERVATION SERVICE
HELPING PEOPLE HELP THE LAND.**

COMPOST FACILITY

COUNTY, GEORGIA

PRE-CONSTRUCTION CERTIFICATION:

THE _____ COMPOSTING FACILITY HAS BEEN CONSTRUCTED IN ACCORDANCE WITH THE FOLLOWING DRAWINGS AND PRACTICE CODE 317. ALL CHANGES HAVE BEEN APPROVED BY AN ENGINEER WITH JOB APPROVAL AUTHORITY LEVEL IV OR GREATER. ALL ADDITIONS HAVE BEEN APPROVED BY NRCS.

OWNER	DATE	NRCS REPRESENTATIVE	DATE	ENGINEER (IF REQUIRED)	DATE
-------	------	---------------------	------	------------------------	------

AS-BUILT CERTIFICATION:

THIS PRACTICE HAS BEEN CONSTRUCTED IN ACCORDANCE TO THESE PLANS AND MEETS NRCS STANDARDS AND SPECIFICATIONS.

NRCS REPRESENTATIVE	DATE	ENGINEER (IF REQUIRED)	DATE
---------------------	------	------------------------	------

COMPOSTING FACILITY:

JOB CLASS: _____

INDEX TO DRAWINGS:

- SHEET 1 - COVER SHEET
- SHEET 2 - PLAN VIEW
ELEVATION VIEW
FRONT VIEW
GENERAL NOTES
- SHEET 3 - ROOF FRAMING PLAN
- SHEET 4 - GIRDER AND RAFTER TO POST CONNECTIONS
HURRICANE STRAP
HURRICANE CLIP
- SHEET 5 - WOOD TREATMENT TABLE
FIBER REINFORCED CONTRACTION JOINT
CONCRETE POST FOOTING DETAIL
MECHANICAL ANCHOR POST CONCRETE FOOTING DETAIL
STANDARD BIN FRONT - TOP VIEW

Date 10/07
Designed W. Brown
Drawn S. Rogers
Checked H. McFarland
Approved H. McFarland

Georgia Composting Facility
16' Stand-Alone Structure
County, GA




File No.
ga-eng-317-c9.pdf

Drawing No.
Cover

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
10/07	H. MCFARLAND	STATE ENGINEER
06/11	J. HOLLOWAY	STATE ENGINEER

06/15/2011 8:57 AM
Sheet 1 of 5

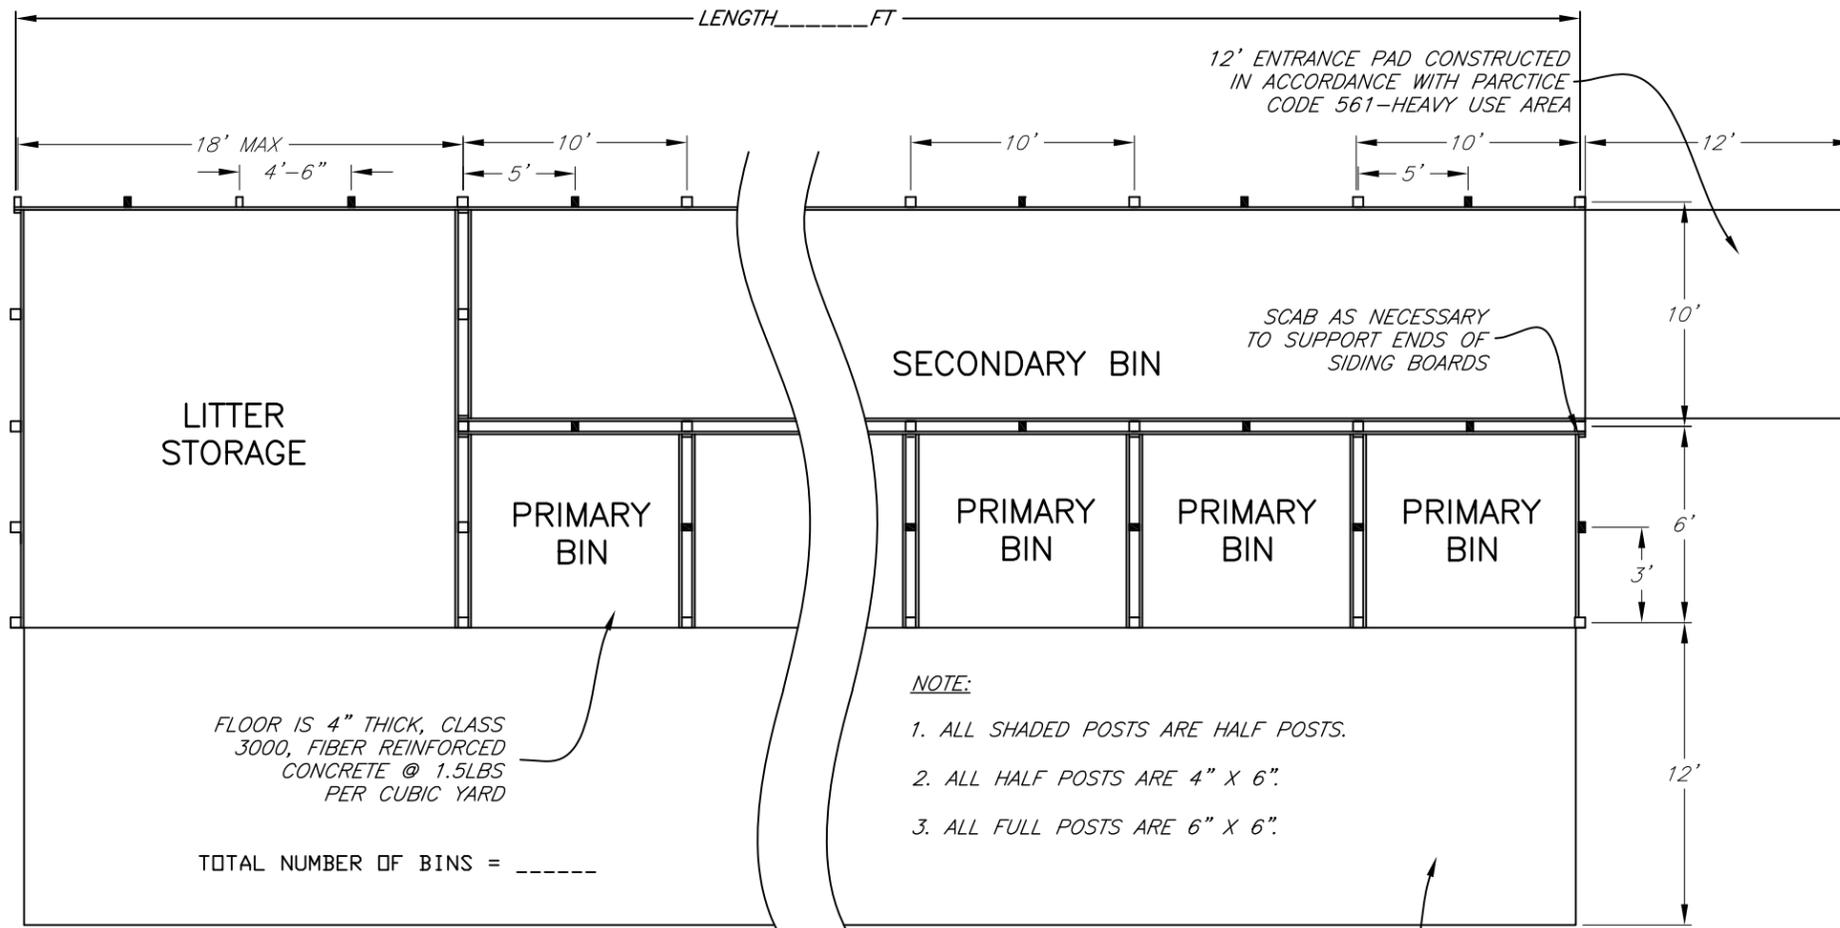


CONCRETE QUALITY:
(1) FLOOR _____ CY
(2) POST HOLES _____ CY
(3) ENTRANCE PAD _____ SQFT


PLAN VIEW

NOTES:

- ALL ENTRANCE AREAS SHALL BE STABILIZED USING PRACTICE STANDARD 561 - HEAVY USE AREA.
- ALL POSTS SHALL BE SET IN CONCRETE WITH CONCRETE OR GRAVEL FOOTING PAD (SEE CONCRETE POST FOOTING DETAIL ON SHEET 5).
- THE BUILDING SITE SHALL BE CLEARED AND GRUBBED AS REQUIRED. PROPER DRAINAGE SHALL BE PROVIDED AROUND THE ENTIRE BUILDING SO THAT RUNOFF WATER DOES NOT ENTER OR POND NEAR BUILDING. DESIGN FOR ROOF RUNOFF IN ACCORDANCE WITH PRACTICE CODE 558 - ROOF RUNOFF MANAGEMENT OR STABILIZE SOIL AROUND BUILDING USING PRACTICE CODE 342 - CRITICAL AREA PLANTING.
- CONCRETE FLOORS AND FOOTINGS SHALL BE PLACED ON FIRM SOIL. ALL LOOSE SOIL SHALL BE REMOVED. IF FILL MATERIAL IS USED, PLACE IN 9" THICK LAYERS AND COMPACT WITH SHEEPSFOOT ROLLER OR OTHER EQUIVALENT COMPACTION METHOD.
- ALL LUMBER, INCLUDING THE POSTS, IN CONTACT WITH LITTER, COMPOST, OR CONCRETE SHALL BE PRESSURE TREATED (SEE WOOD TREATMENT TABLE ON SHEET 5).
- ALL DIMENSION LUMBER SHALL BE SOUTHERN PINE NO. 2 OR BETTER.
- ALL NAILS, BOLTS AND OTHER CONNECTORS SHALL BE OF HOT-DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE, OR COPPER. NAILS SHALL HAVE SPIRALED OR RINGED (ANNULAR) SHANKS. ALL REFERENCES TO "GALVANIZED" IN THIS SET OF DRAWINGS REFERS TO THE ABOVE LISTED COATINGS.
- ROOFING SHALL BE 29 GAUGE GALVANIZED METAL. SEALANT SHALL BE APPLIED TO ALL LAPS.
- ON SITE WATER SOURCE IS NECESSARY TO MAINTAIN MOISTURE CONTENT OF COMPOST.
- ALL DISTURBED AREAS SHALL BE VEGETATED USING PRACTICE CODE 342 - CRITICAL AREA PLANNING.
- CALL BEFORE YOU DIG: 1-800-282-7411 OR 770-623-4344.

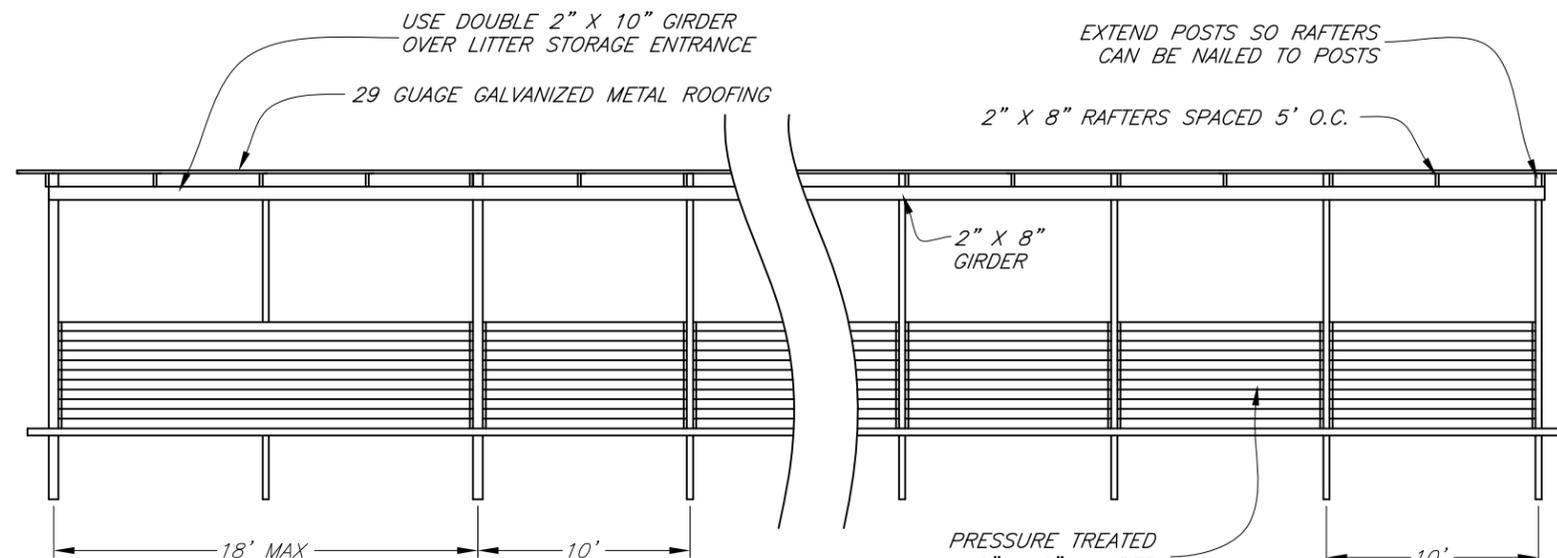

FRONT VIEW

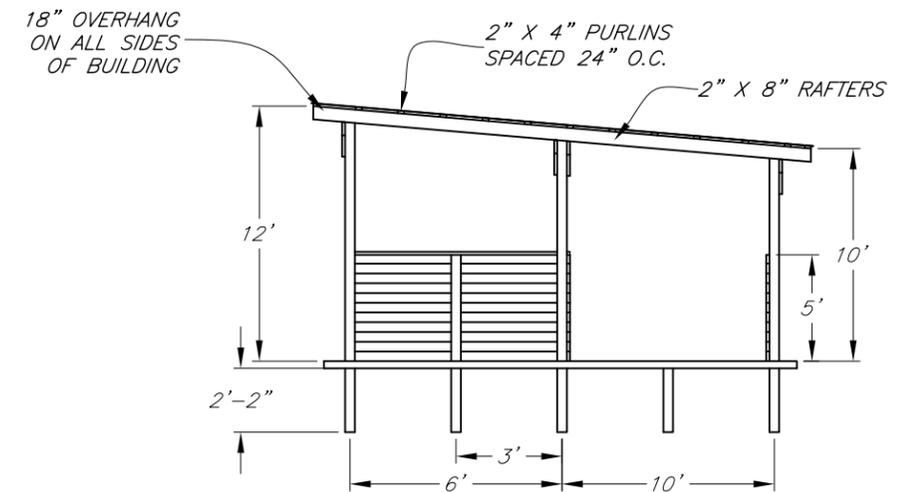

ELEVATION VIEW

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
10/07	H. MCFARLAND	STATE ENGINEER

Date	10/07
Designed	W. Brown
Drawn	S. Rogers
Checked	H. McFarland
Approved	J. Holloway
	H. McFarland


GEORGIA COMPOSTING FACILITY
16' Stand-Alone Structure



File No.
ga-eng-317-c9.pdf

Drawing No.
Plan

10/26/2007 2:53 PM
Sheet 2 of 5

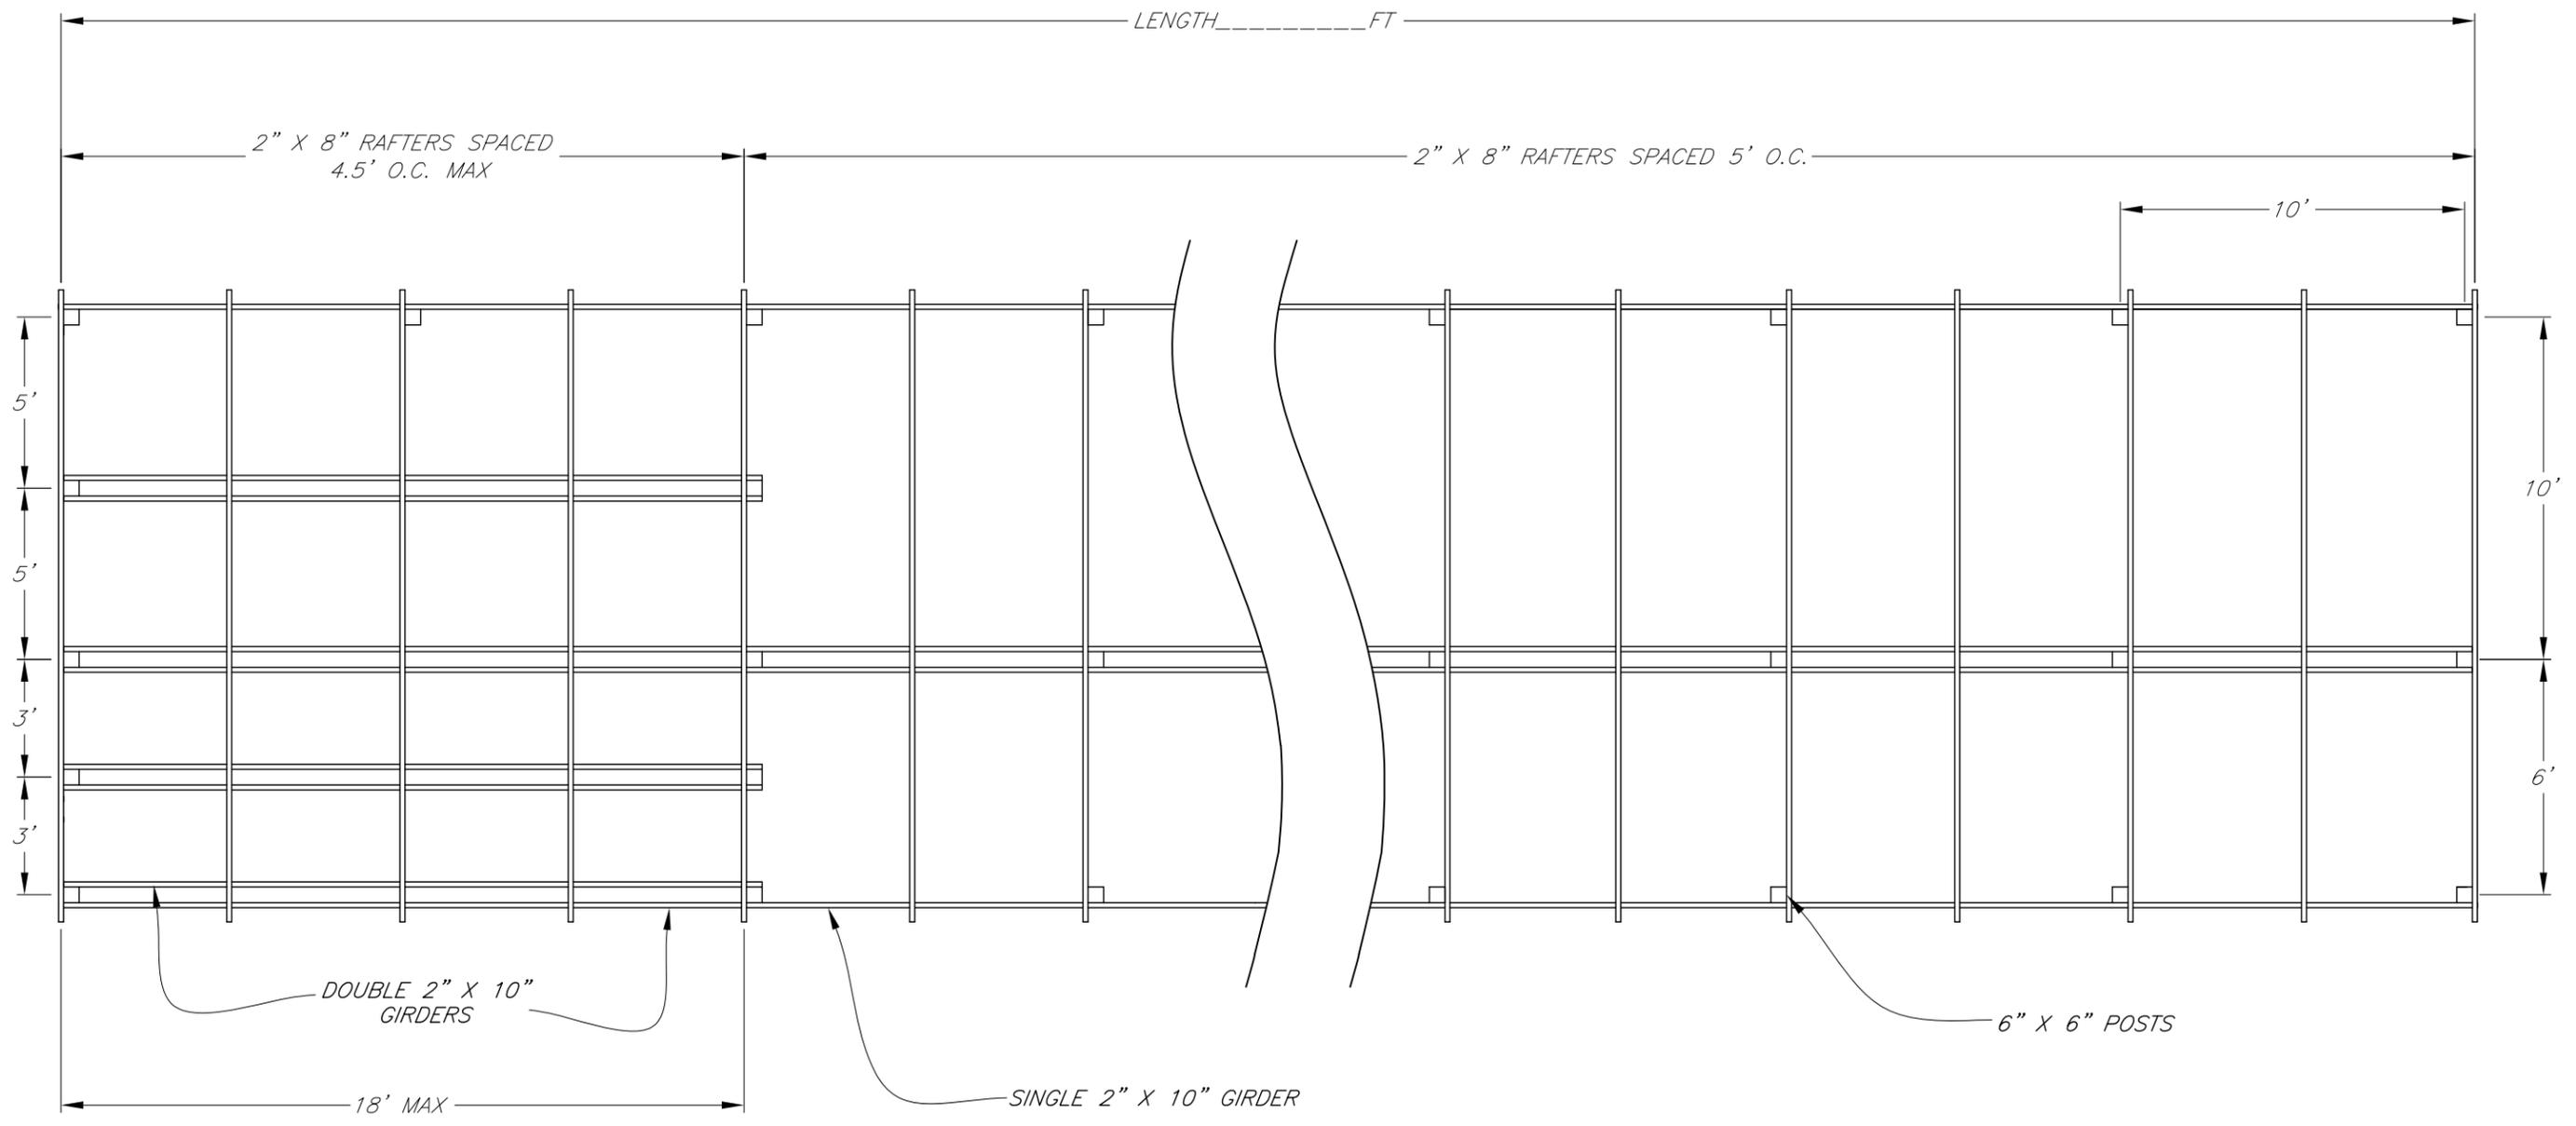

LENGTH _____ FT

2" X 8" RAFTERS SPACED
4.5' O.C. MAX

2" X 8" RAFTERS SPACED 5' O.C.

10'

5'
5'
3'
3'

10'
6'

DOUBLE 2" X 10"
GIRDERS

SINGLE 2" X 10" GIRDER

6" X 6" POSTS

18' MAX

ROOF FRAMING PLAN

Designed W. Brown Date 10/07
 Drawn S. Rogers H. McFarland Date 10/07
 Checked J. Holloway Date 10/07
 Approved H. McFarland Date 10/07


GEORGIA COMPOSTING FACILITY
 16' Stand-Alone Structure
 _____ County, GA




File No.
ga-eng-317-c9.pdf

Drawing No.
Roof Plan

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
10/07	H. MCFARLAND	STATE ENGINEER

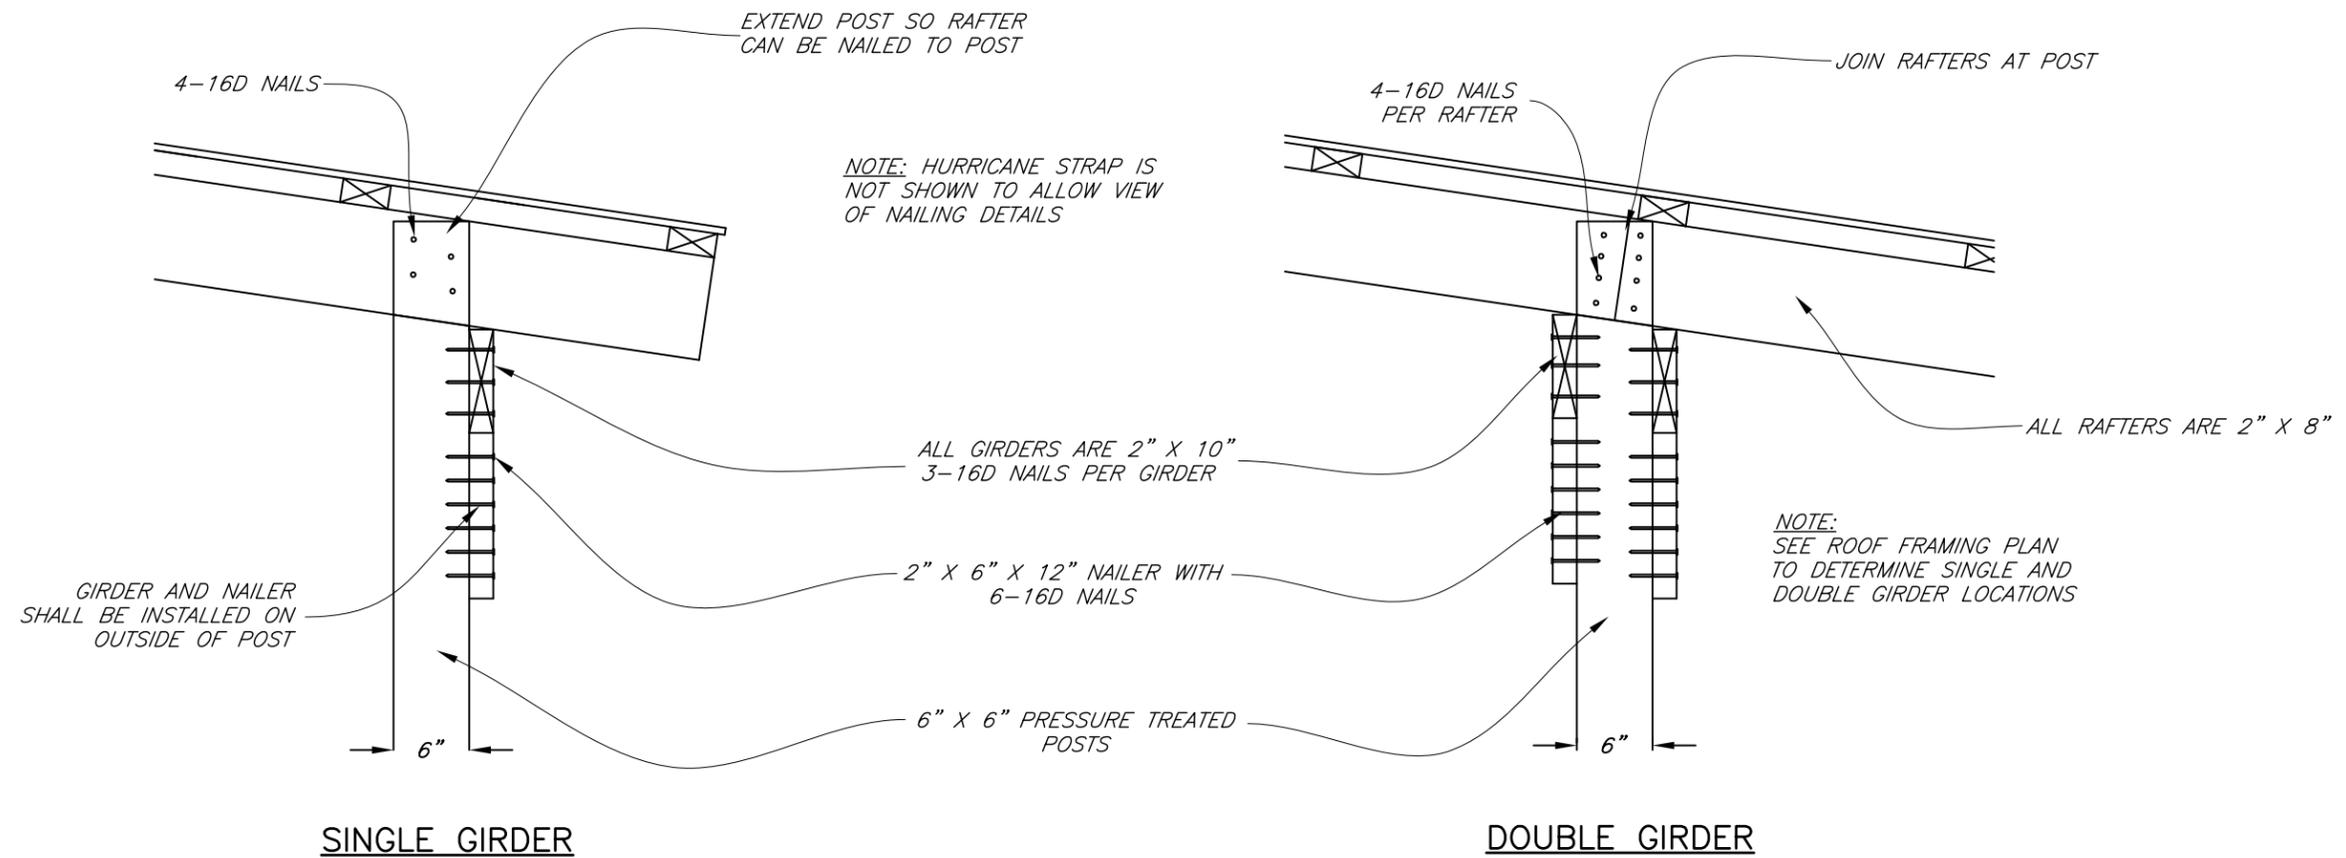


GIRDER AND RAFTER TO POST CONNECTIONS

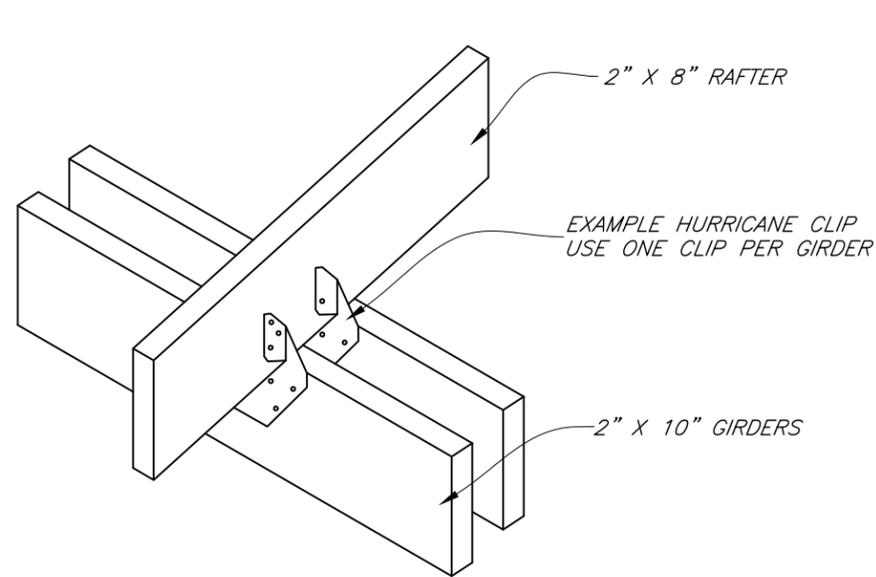

HURRICANE CLIP
(USE AT RAFTER TO GIRDER CONNECTIONS WITHOUT POSTS)

NOTES:

1. MINIMUM UPLIFT RESISTANCE FOR HURRICANE STRAP IS 1077 LBS.
2. STRAP SHALL BE 2" OR WIDER. CENTER STRAP ON RAFTER TO RAFTER BUTT JOINTS ON CENTER POSTS.
3. USE MANUFACTURED HURRICANE CLIP FOR RAFTER TO GIRDER CONNECTIONS (WITHOUT POSTS). MINIMUM UPLIFT RESISTANCE IS 392 LBS PER CLIP. AN EXAMPLE IS SHOWN AT LEFT. INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

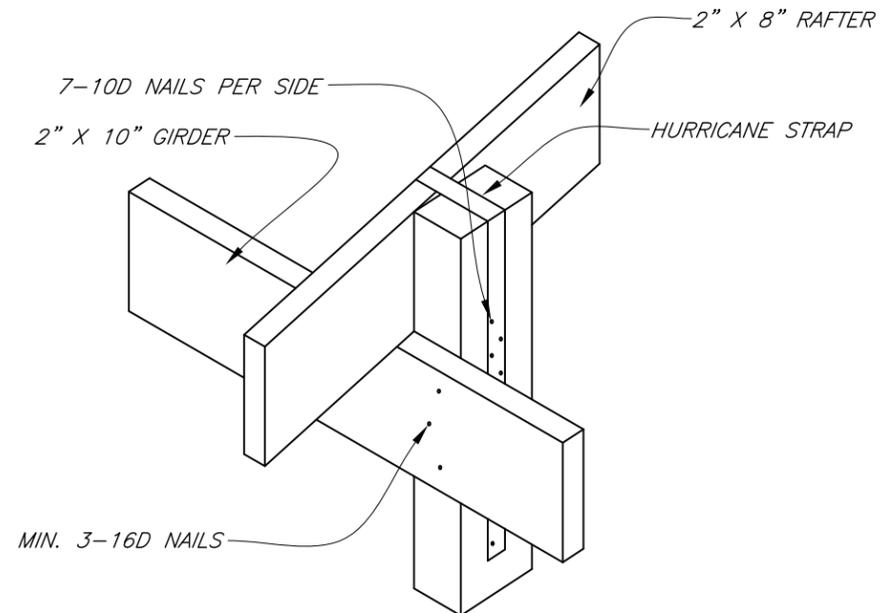

HURRICANE STRAP
(USE AT RAFTER TO GIRDER CONNECTIONS WITH POSTS)

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
10/07	H. MCFARLAND	STATE ENGINEER

Date	Designed	Drawn	Checked	Approved
10/07	W. Brown	S. Rogers	H. McFarland	H. McFarland
10/07		H. McFarland	J. Holloway	
10/07				


GEORGIA COMPOSTING FACILITY
16' Stand-Alone Structure



File No.
ga-eng-317-c9.pdf

Drawing No.
Detail 1

10/26/2007 2:53 PM
Sheet 4 of 5

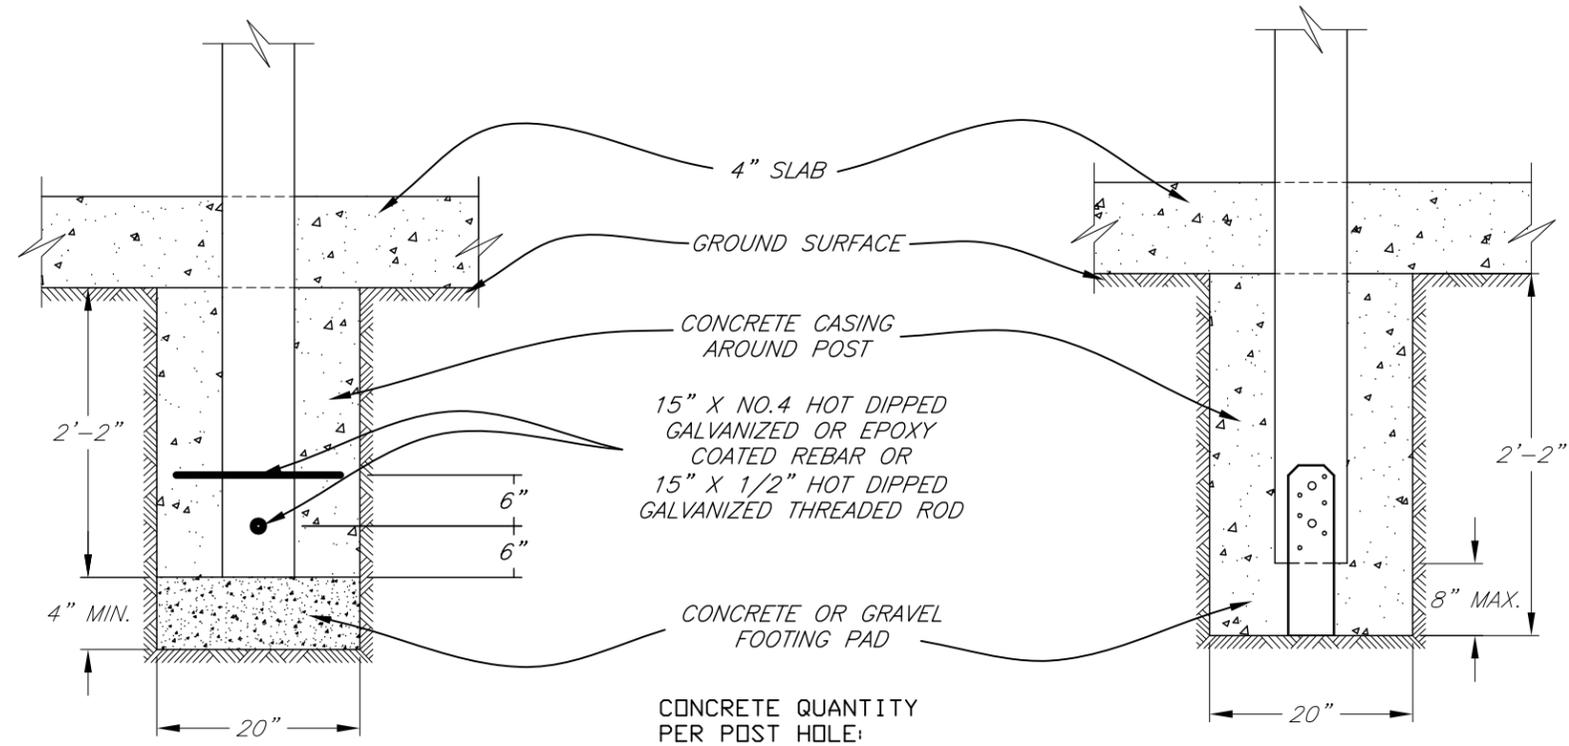


CONCRETE POST FOOTING DETAIL


MECHANICAL POST ANCHOR CONCRETE FOOTING DETAIL

CONCRETE QUANTITY PER POST HOLE:
 4" X 6" 0.19 C. Y.
 6" X 6" 0.20 C. Y.

- NOTES:**
1. EXAMPLE CONNECTOR SHOWN AT LEFT.
 2. MINIMUM UPLIFT RESISTANCE REQUIRED IS 1574 LBS.
 3. INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
 4. CONNECTOR SHALL BE GALVANIZED.
 5. MECHANICAL POST ANCHOR MAY BE USED INSTEAD OF REBAR.
 6. REBAR OR MECHANICAL POST ANCHOR REQUIRED FOR FULL POSTS ONLY.

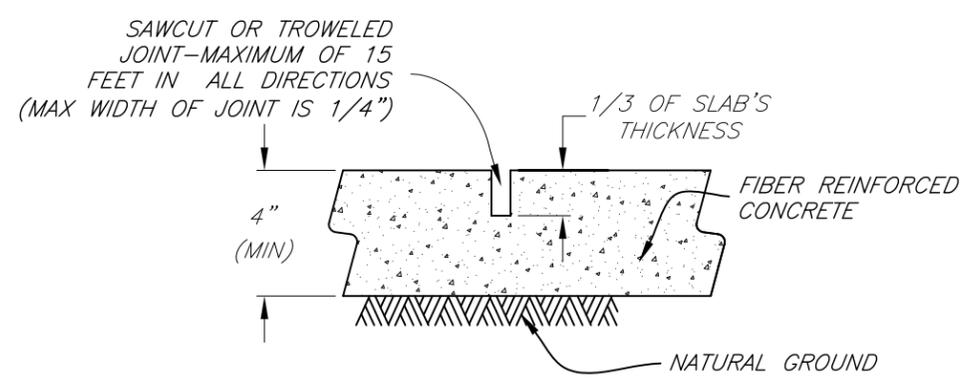

FIBER REINFORCED CONTRACTION JOINT

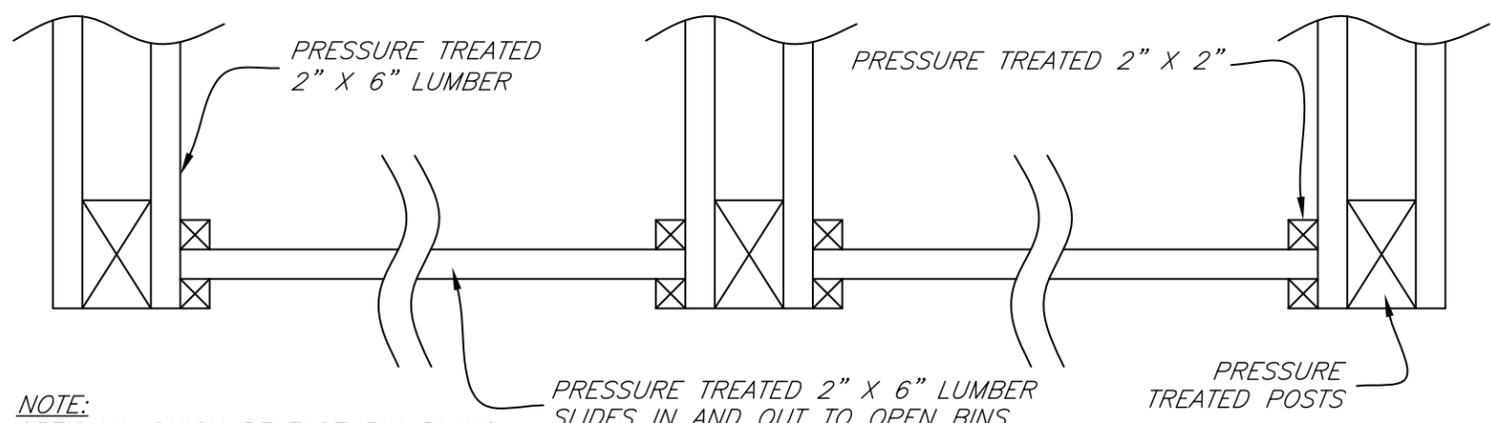

STANDARD BIN FRONT - TOP VIEW

NOTE:
 OPTIONAL QUICK RELEASE BIN PLANS ARE AVAILABLE. SEE YOUR NRCS REPRESENTATIVE FOR DETAILS.

WOOD TREATMENT TABLE

USE	MINIMUM RETENTION RATES IN PCF				
	CCA	ACQ-C/D	CBA-A	CA-B	MCA
GROUND CONTACT OR FRESH WATER	0.40	0.40	0.41	0.21	0.15
IMPORTANT STRUCTURAL MEMBERS	0.60	0.60	0.61	0.31	0.23

CCA - CHROMATED COPPER ARSENATE
 ACQ-C/D - ALKALINE COPPER QUATERNARY
 CBA-A & CA-B - COPPER AZOLE
 MCA - MICRONIZED COPPER AZOLE

- NOTES:**
1. ALL WOODEN WALLS, HALF POSTS, AND BIN FRONT WOOD SHALL MEET THE GROUND CONTACT RATES.
 2. ALL SUPPORT POSTS SHALL MEET THE IMPORTANT STRUCTURAL MEMBER RATES.

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
10/07	H. MCFARLAND	STATE ENGINEER
10/10	J. HOLLOWAY	STATE ENGINEER

Date 10/07
 Designed W. Brown
 Drawn S. Rogers
 Checked H. McFarland
 Approved H. McFarland

GEORGIA COMPOSTING FACILITY
 16' Stand-Alone Structure
 County, GA



File No. go-eng-317-c9_rev 102010.pdf
 Drawing No. Detail 2
 10/27/2010 5:32 PM
 Sheet 5 of 5