2 POST BRACE WITH DEADMAN

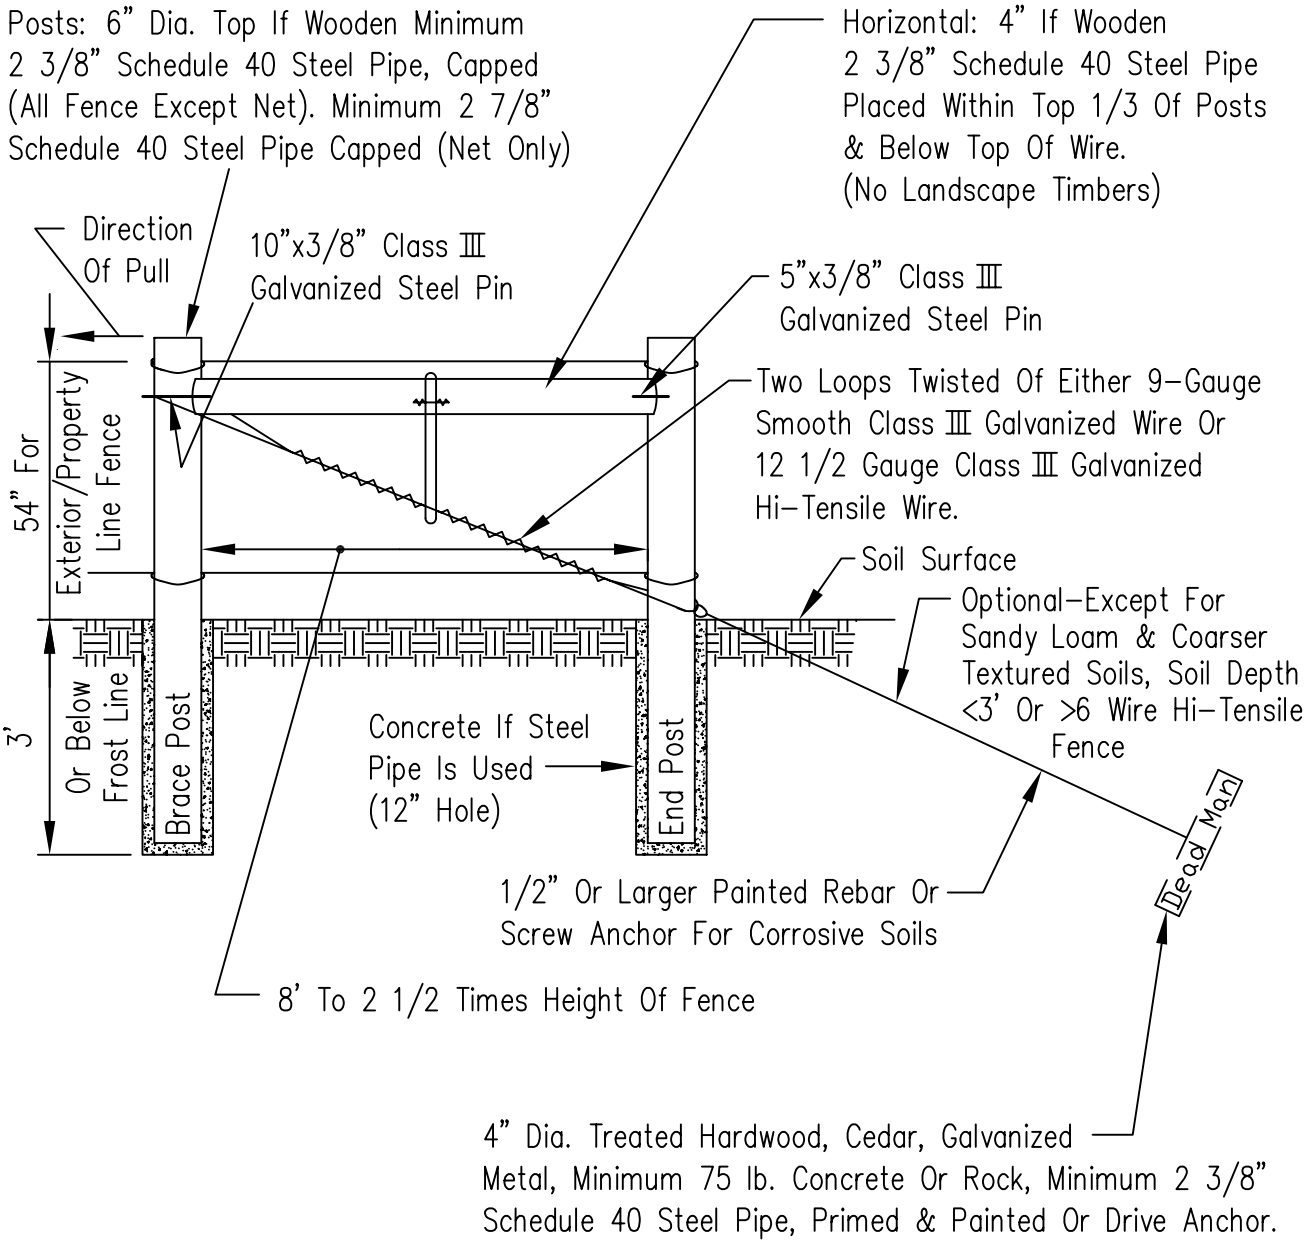

NOTES:

1. Post must be new red cedar, blueberry juniper, black locust, osage orange, treated hardwood; or steel pipe (concrete in place).
2. Use "western union" splices; figure "8" knots or crimping sleeves for malleable wire.
3. Use crimping sleeves or figure "8" knots for high tensile strength wire.
4. All steel pipe must be a minimum of 2 3/8 inch diameter Schedule 40 steel pipe either galvanized or primed & painted.

REFERENCE			
Project			
Designed		Date	
Checked		Date	
Approved		Date	

NRCS
Natural Resources Conservation Service
United States Department of Agriculture

STANDARD DWG. NO.
IL-810
SHEET 1 OF 1
DATE 12-06