



PLAN VIEW

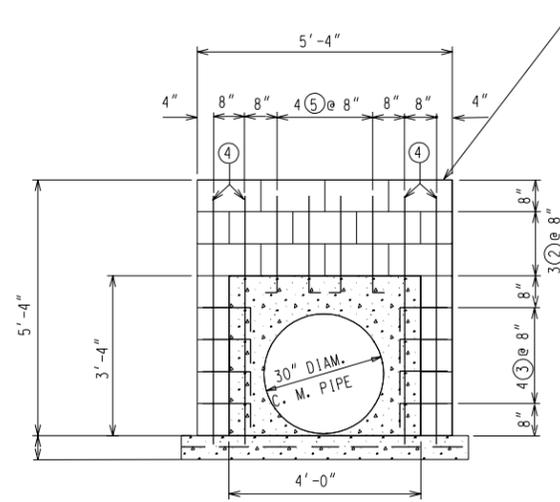

BACK WALL

NOTE: FILL ALL BLOCKS WITH CONCRETE AND TROWEL FINISH TOP TO SMOOTH SURFACE.

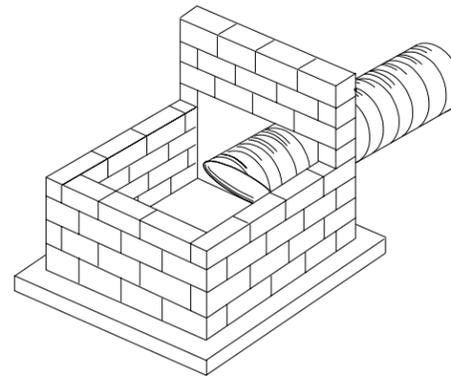

ISOMETRIC VIEW OF INLET BOX & PIPE


STEEL SCHEDULE
FOR TYPICAL BAR TYPES REFER TO ACI STANDARD 315-65.

LOCATION	MARK	SIZE	QUAN.	LENGTH	TYPE	A	B	TOTAL FT
FRONT & SIDE WALLS	1	3	20	3'-0"	2	0'-6"	2'-6"	60'-0"
FRONT, SIDE & BACK WALLS	2	MASONRY JOINT REINFORCEMENT						
BACK WALL	3	3	8	1'-6"	2	0'-6"	1'-0"	12'-0"
BACK WALL	4	3	4	5'-9"	2	0'-6"	5'-3"	23'-0"
BACK WALL	5	3	4	2'-6"	2	0'-3"	2'-3"	10'-0"


NOTE: MARK NO.2 SHALL BE MASONRY JOINT REINFORCEMENT JOINT REINFORCEMENT SHALL BE FABRICATED FROM STEEL WIRE CONFORMING TO ASTM A82. LONGITUDINAL WIRES MAY BE SMOOTH OR DEFORMED AND SHALL NOT BE LIGHTER THAN 0.1483IN. IN NOMINAL DIAMETER (9 GAGE). CROSS WIRES SHALL NOT BE LIGHTER THAN 0.1055IN. IN NOMINAL DIAMETER (12 GAGE).

LIST OF MATERIAL


CLASS 3000M CONCRETE 1.63 CU. YDS.
 5'-7"x5'-7" - 6X6 10/10 WELDED WIRE FABRIC 31.1 SQ.FT. = 6.5 LBS.
 REINFORCING STEEL #3 BARS 105.0 LIN. FT. = 39.5 LBS.
 MASONRY JOINT REINFORCEMENT 60 LIN. FT.
 CONCRETE BLOCKS, 8"x8"x16" = 53
 CONCRETE BLOCKS, 8"x8"x8" = 8

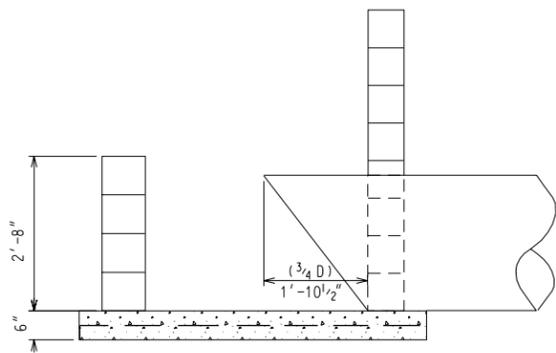


SECTION ALONG C OF PIPE

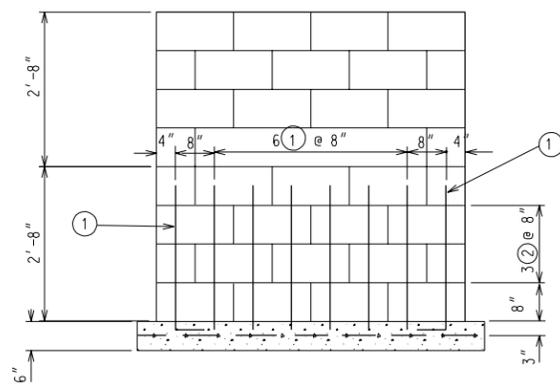

FRONT WALL

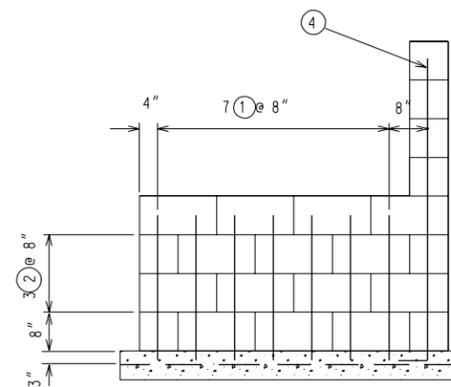


SIDE WALL

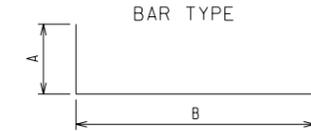

CONCRETE BLOCK BOX HOODED INLET FOR 30" DIAMETER PIPE			
STANDARD DWG. NO.	FL-410E3	SHEET	OF
DATE	12/02		

REVISIONS		
DATE	APPROVED	TITLE

Date _____
 Designed _____
 Drawn _____
 Checked _____
 Approved _____

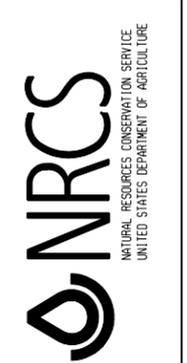

File No. _____
 Drawing No. _____
 Sheet of _____