


- Call Before You Dig
- Wait The Required Time
- Confirm Utility Response
- Respect the Marks
- Dig With Care

**CONSTRUCTION SPECIFICATIONS AND NOTES**

1. Trench excavations over (5) feet deep shall be sloped or shored in accordance with OSHA part 1926 and N.Y. Industrial Code 23.
2. End caps shall be of a compatible material with the existing drain pipe.
3. Backfill with excavated material and compact in lifts not to exceed (12) inches. Compaction shall consist of at least (1) pass of the construction equipment over the entire surface.
4. Remove all scrap drain material from the site when completed and dispose of properly.
5. If upstream portion of blocked drain line is higher than the planned water elevation of the proposed wetland site, then a standpipe with relief or gravel outflow area shall be installed at the upstream edge of the wetland. The gravel outflow area shall consist of #2 washed gravel, (3) feet in diameter, and extend from the bottom of the drain to the ground surface.
6. An animal guard shall be installed on the standpipe.
7. If blocked drain line needs to function up slope of proposed wetland, then re-route outlet according to attached plan.

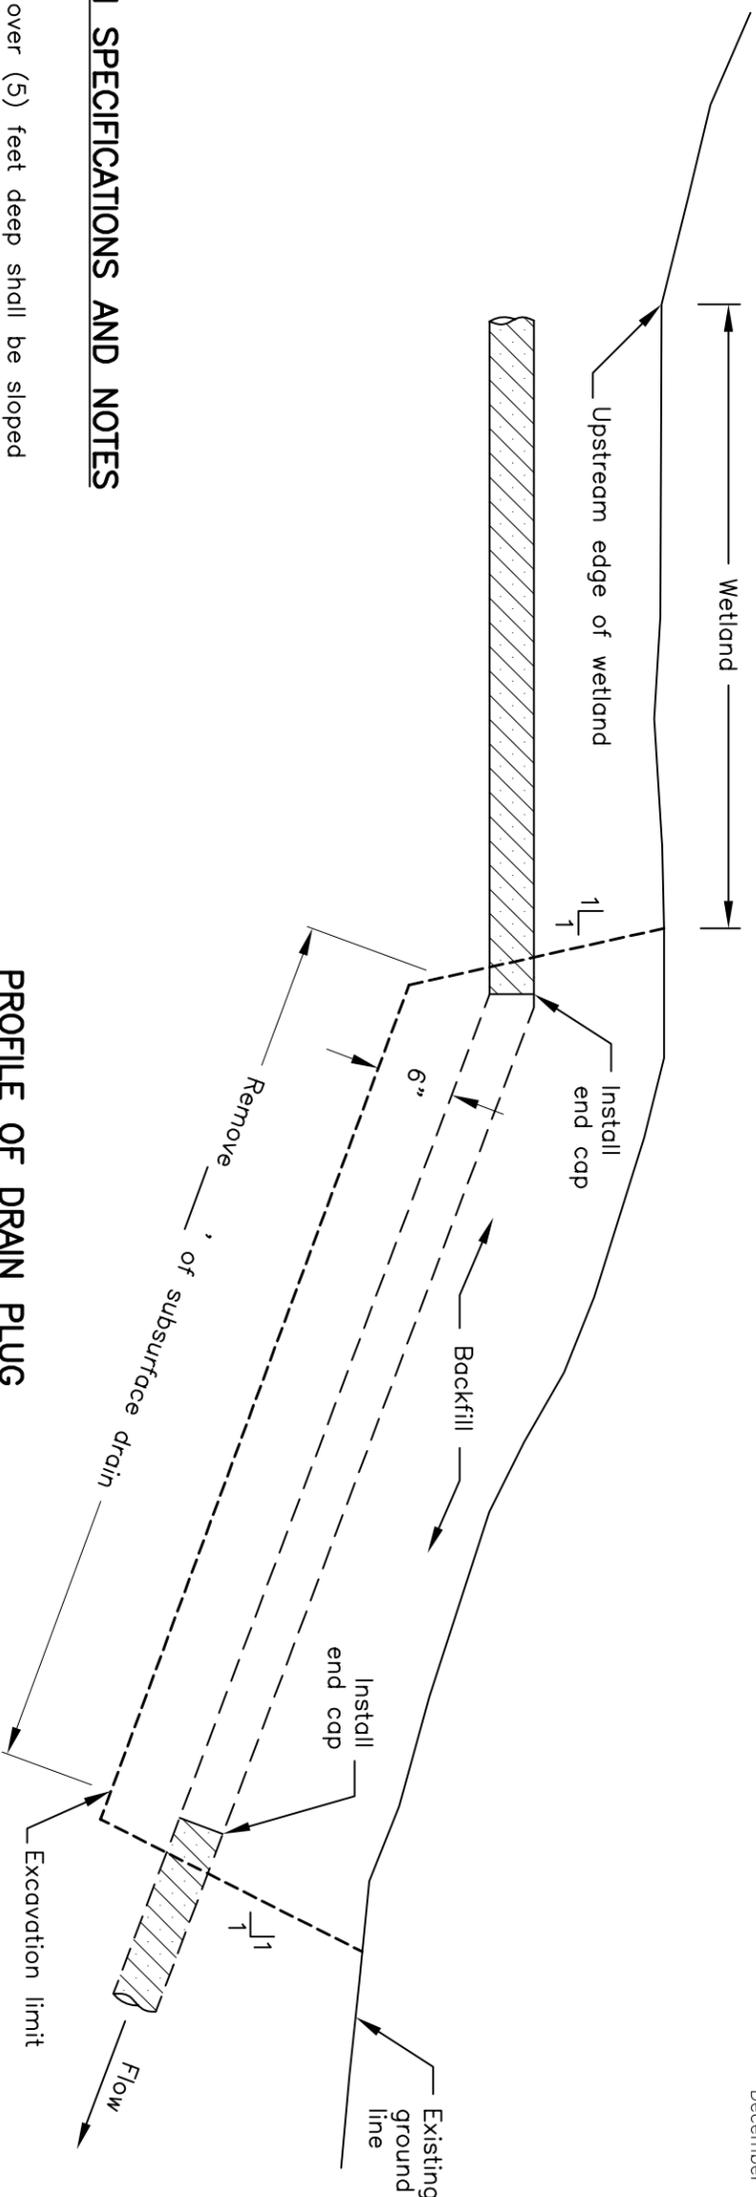

**PROFILE OF DRAIN PLUG**

Gravity outflow area	Required: Yes ___ No ___
Standpipe with animal guard	Required: Yes ___ No ___
Re-route outlet	Required: Yes ___ No ___

**PLAN VIEW**

B.M. Elev. \_\_\_\_\_

B.M. Desc. \_\_\_\_\_

NOT TO SCALE

**REVISIONS**

Date Revised	Item(s) Revised	Revised by	Approved by

Date	Designed	Drawn	Checked	Approved	Title

**WETLAND RESTORATION — 657A  
DRAIN PLUG**



NRCS Drawing Name	
NRCS Project ID	
Sheet of	