

UNITED STATES DEPARTMENT OF AGRICULTURE  
 NATURAL RESOURCES CONSERVATION SERVICE

GEORGIA STANDARD DRAWINGS - SIPHON SYSTEM

1. The following drawings were prepared in accordance with Practice Code 378 - Pond, Georgia Building Code (International Building Code 2000), and the State of Georgia Rules for Dam Safety. These plans may be used if all of the following conditions are met for the dam and reservoir:

- a) Structure is Low Hazard - failure will not result in loss of life; in damage to homes, commercial or industrial buildings, main highways, or railroads; or in interrupted use of public utilities.
- b) The effective height is less than 35 feet.
- c) The product of storage times effective height of the dam is less than 3,000 acre-feet<sup>2</sup>.
- d) Structure is single purpose.
- e) Structure is not classified as "Category I" by the Georgia EPD Safe Dams Program.

2. Hazard Classification shall be completed prior to construction by an NRCS Engineer in accordance with the Technical Release No. 60, the National Engineer Manual (NEM), and the Georgia Supplement to the NEM. Hazard Classification shall be completed under the supervision of the State Conservation Engineer.

**CERTIFICATION:**


THE \_\_\_\_\_ POND WILL BE CONSTRUCTED IN ACCORDANCE WITH THE FOLLOWING DRAWINGS AND PRACTICE CODE 378. ALL CHANGES HAVE BEEN APPROVED BY AN ENGINEER WITH JOB APPROVAL AUTHORITY LEVEL IV OR GREATER.

OWNER _____	DATE _____	NRCS REPRESENTATIVE _____	DATE _____	NRCS ENGINEER _____	DATE _____
-------------	------------	---------------------------	------------	---------------------	------------

\_\_\_\_\_ POND  
 \_\_\_\_\_ COUNTY, GEORGIA

**INDEX TO DRAWINGS:**

- SHEET 1 - COVER SHEET
- SHEET 2 - NOTES
- SHEET 3 - DAM AND PIPE SECTION
- SHEET 4 - PROFILE VIEW OF DAM AND AUXILIARY SPILLWAY
- SHEET 5 - PLAN VIEW OF DAM AND AUXILIARY SPILLWAY
- SHEET 6 - SIPHON DETAILS
- SHEET 7 - EROSION AND SEDIMENT CONTROL PLAN
- SHEET 8 - EROSION AND SEDIMENT CONTROL DETAILS
- SHEET 9 - VEGETATION NOTES



VICINITY MAP

The Natural Resources Conservation Service provides leadership in a partnership effort to help people conserve, maintain, and improve our natural resources and environment.

Date	_____
Designed	_____
Drawn	B WRIGHT 11/10
Checked	J HOLLOWAY 11/10
Approved	_____

GEORGIA STANDARD DRAWINGS  
 EMBANKMENT POND WITH SIPHON SYSTEM  
 PREPARED FOR: \_\_\_\_\_  
 COUNTY OF: \_\_\_\_\_



File Name	9d-eng-378-pd2.pdf
Drawing Name	Cover
Date	11/10/2010
Sheet	1 of 9

DATE	APPROVED	TITLE

**GENERAL**  
Detailed engineering plans of the proposed embankment, spillway(s), and reservoir on the attached sheets shall be included as part of these specifications.

**RESPONSIBILITIES OF**

**A. LANDOWNERS:**

The landowner is responsible for obtaining all required permits and easements prior to construction. The landowner must acquaint himself with these plans and specifications to determine that the completed structure will fulfill his present and future needs.

**B. CONTRACTOR:**

The contractor is to be acquainted with the provisions of these plans and specifications, conditions at the site that may affect the schedule of operation, and the location and meaning of all stakes on the site. All benchmarks, grade and line stakes must be left undisturbed and protected by the contractor to facilitate construction and inspection. The contractor is responsible for locating and replacing all utilities, irrigation lines, etc.

**C. U.S. DEPARTMENT OF AGRICULTURE - NATURAL RESOURCES**

**CONSERVATION SERVICE**

The United States and its employees are in no manner a party to any verbal or written contract between the landowner and the contractor. NRCS employee(s), within limit of personnel available, will assist the landowner with inspection and advise on technique during construction to assure satisfactory compliance with the plans and specifications.

**SPECIFICATIONS FOR CONSTRUCTION OF PONDS AND RESERVOIRS**

**CLEARING:** Reservoir areas are to be cleared at least up to the elevation of the crest of the principal spillway. Less clearing may be approved as stated in the National Engineering Manual §520.25. The minimum area cleared must extend the full length of the dam for a distance of 400 feet upstream from the dam and emergency spillway, including the area where the dam and plunge pool will be located. All trees and brush shall be cut as close to the ground as practical and removed from the site before water is impounded. Combustible material must be disposed of by burning, burying at approved locations, or removed from the site and stacked. Any material that will float shall be removed or anchored.

**FOUNDATION PREPARATION:** The foundation area shall be cleared of all trees, stumps, and debris. All topsoil containing excessive amounts of organic material shall be removed. All sharp breaks shall be sloped to not steeper than 1:1 and the foundation thoroughly scarified before placement of the embankment fill.

**CUTOFF TRENCH:** A cutoff trench shall be excavated to the depth, bottom width, and side slopes shown on the plans or as staked in the field. The cutoff trench shall be backfilled in layers not to exceed 6 inches in thickness. Standing water shall be removed from the trench before backfilling is started.

**SPILLWAY AND BORROW EXCAVATION:** Spillway(s) shall be excavated in undisturbed earth and conform to the grades, bottom width, and side slopes shown on the plans. All borrow areas shall be graded so as to be well drained and protected from erosion by the use of diversions or other conservation measures. Side slopes of borrow areas shall be left in such condition that establishment of vegetation, mowing, and maintenance operations will be facilitated. Surface soils excavated and saved from the foundation, spillway, and borrow areas shall be placed on the dam, borrow areas, and spillway to facilitate establishment of vegetation.

**EMBANKMENT CONSTRUCTION:** The material placed in the embankment shall be free of sod, roots, stones over 6 inches in diameter, and other objectionable materials. The fill material shall be placed and spread over the entire fill, starting at the lowest point of the foundation, in layers not to exceed 6 inches in thickness. Construction of the fill shall be undertaken only at such time that the moisture content of the fill material will permit satisfactory compaction, as determined by the NRCS Engineer on site. Special equipment will be used when the required compaction cannot be obtained by routing of the construction equipment. A minimum of 4 passes of compaction equipment is required.

**FILL MATERIAL:** Fill material shall be taken from borrow areas designated by NRCS. The NRCS field staff will advise the contractor regarding the maximum allowable depth of cut in each borrow area. In the event this depth is exceeded in the impoundment area, it shall be the responsibility of the contractor, to cover the exposed area with a minimum of 2 feet of impervious material. Approved material will be placed in the core, cutoff trench and pipe bed.

**PIPE:** All pipes shall be Schedule 40 - PVC unless otherwise specified and shall be PVC 1120 or PVC 1220 conforming to ASTM D1785 or ASTM D2241. All PVC pipe joints shall be glued with no gaskets. The pipes shall be installed to the elevations and grades as shown on the drawings. Select backfill shall be placed below and around the pipe and its components in layers not exceeding 4 inches and each successive layer thoroughly hand compacted using a manually directed hand tamper or equivalent. Plastic pipe that will be exposed to direct sunlight shall be protected by coating or shielding.

**VEGETATION:** Adapted vegetation shall be established on all exposed surfaces of the embankment, spillway, borrow, and spoil areas as soon as possible after construction. Vegetation will be applied as critical area planting and will include seeded preparation, seeding, liming, fertilizing, and mulching. The dam slopes shall be tracked with a dozer to facilitate vegetation establishment.

**EROSION AND SEDIMENT CONTROL:** During construction, erosion should be minimized and sediment controlled utilizing Best Management Practices listed in the Manual for Erosion and Sediment Control in Georgia.

Date	
Designed	_____
Drawn	B WRIGHT
Checked	J HOLLOWAY
Approved	_____

GEORGIA STANDARD DRAWINGS  
EMBANKMENT POND WITH SIPHON SYSTEM  
PREPARED FOR: \_\_\_\_\_  
COUNTY OF: \_\_\_\_\_



File Name	90-eng-378-pd2.pdf	
Drawing Name	Notes	
DATE	APPROVED	TITLE
11/10/2010		
Sheet	2	of 9

**CERTIFICATION**

I certify that I have made, or caused to be made, a final inspection of this pond project and that all work related thereto has been completed in accordance with these plans and with all other applicable specifications except as listed below.

SIGNED \_\_\_\_\_ TITLE \_\_\_\_\_ DATE \_\_\_\_\_

EXCEPTIONS:

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

CONTRACTOR CERTIFICATION

I certify that the cutoff trench, core wall and pipe were installed in accordance with these plans.

Contractor Signature \_\_\_\_\_

Date: \_\_\_\_\_

**GENERAL INFORMATION**

USES FOR IMPOUNDED WATER \_\_\_\_\_

NORMAL POOL AREA \_\_\_\_\_ ACRES MAX. DEPTH \_\_\_\_\_ FEET

CAPACITY @ NORMAL POOL ELEVATION = \_\_\_\_\_ ACRE-FEET

SOURCE OF WATER \_\_\_\_\_

HAZARD CLASS \_\_\_\_\_ JOB CLASS \_\_\_\_\_

**EARTHWORK**

EMBANKMENT \_\_\_\_\_ CUBIC YARDS

CUTOFF TRENCH \_\_\_\_\_ CUBIC YARDS

PIPE BED \_\_\_\_\_ CUBIC YARDS

AUX SW BERM(IF NEEDED) \_\_\_\_\_ CUBIC YARDS

EXCAVATION \_\_\_\_\_ CUBIC YARDS

OTHER \_\_\_\_\_ CUBIC YARDS

TOTAL \_\_\_\_\_ CUBIC YARDS

**SIPHON SYSTEM**

SIPHON PIPE, \_\_\_\_\_ DIA. SCHEDULE 40 PVC \_\_\_\_\_ LF

22 1/2° BENDS, \_\_\_\_\_ DIA SCHEDULE 40 PVC \_\_\_\_\_ EACH

45° BENDS, \_\_\_\_\_ DIA SCHEDULE 40 PVC \_\_\_\_\_ EACH

90° BENDS, \_\_\_\_\_ DIA SCHEDULE 40 PVC \_\_\_\_\_ EACH

\_\_\_\_\_ X \_\_\_\_\_ X \_\_\_\_\_ SCHEDULE 40 PVC TEE \_\_\_\_\_ EACH

\_\_\_\_\_ X \_\_\_\_\_ X \_\_\_\_\_ SCHEDULE 40 PVC TEE (VENT) \_\_\_\_\_ EACH

VENT PIPE, \_\_\_\_\_ DIA. SCHEDULE 40 PVC \_\_\_\_\_ LF


\_\_\_\_\_ ° ELBOW, \_\_\_\_\_ DIA. SCHEDULE 40 PVC \_\_\_\_\_ EACH

\_\_\_\_\_ DIA TRASH GUARD FOR SIPHON \_\_\_\_\_ EACH

4" X 4" TREATED WOOD POST 6' LONG \_\_\_\_\_ EACH

3000 PSI CONCRETE (FIBER REINFORCED) \_\_\_\_\_ CU YDS

1. See official "Bid Schedule" for complete listing of bid items not shown on this sheet.
2. Refer to construction specifications and "Pipe" notes on Sheet 2 for additional information.
3. Provide this sheet to pipe company.

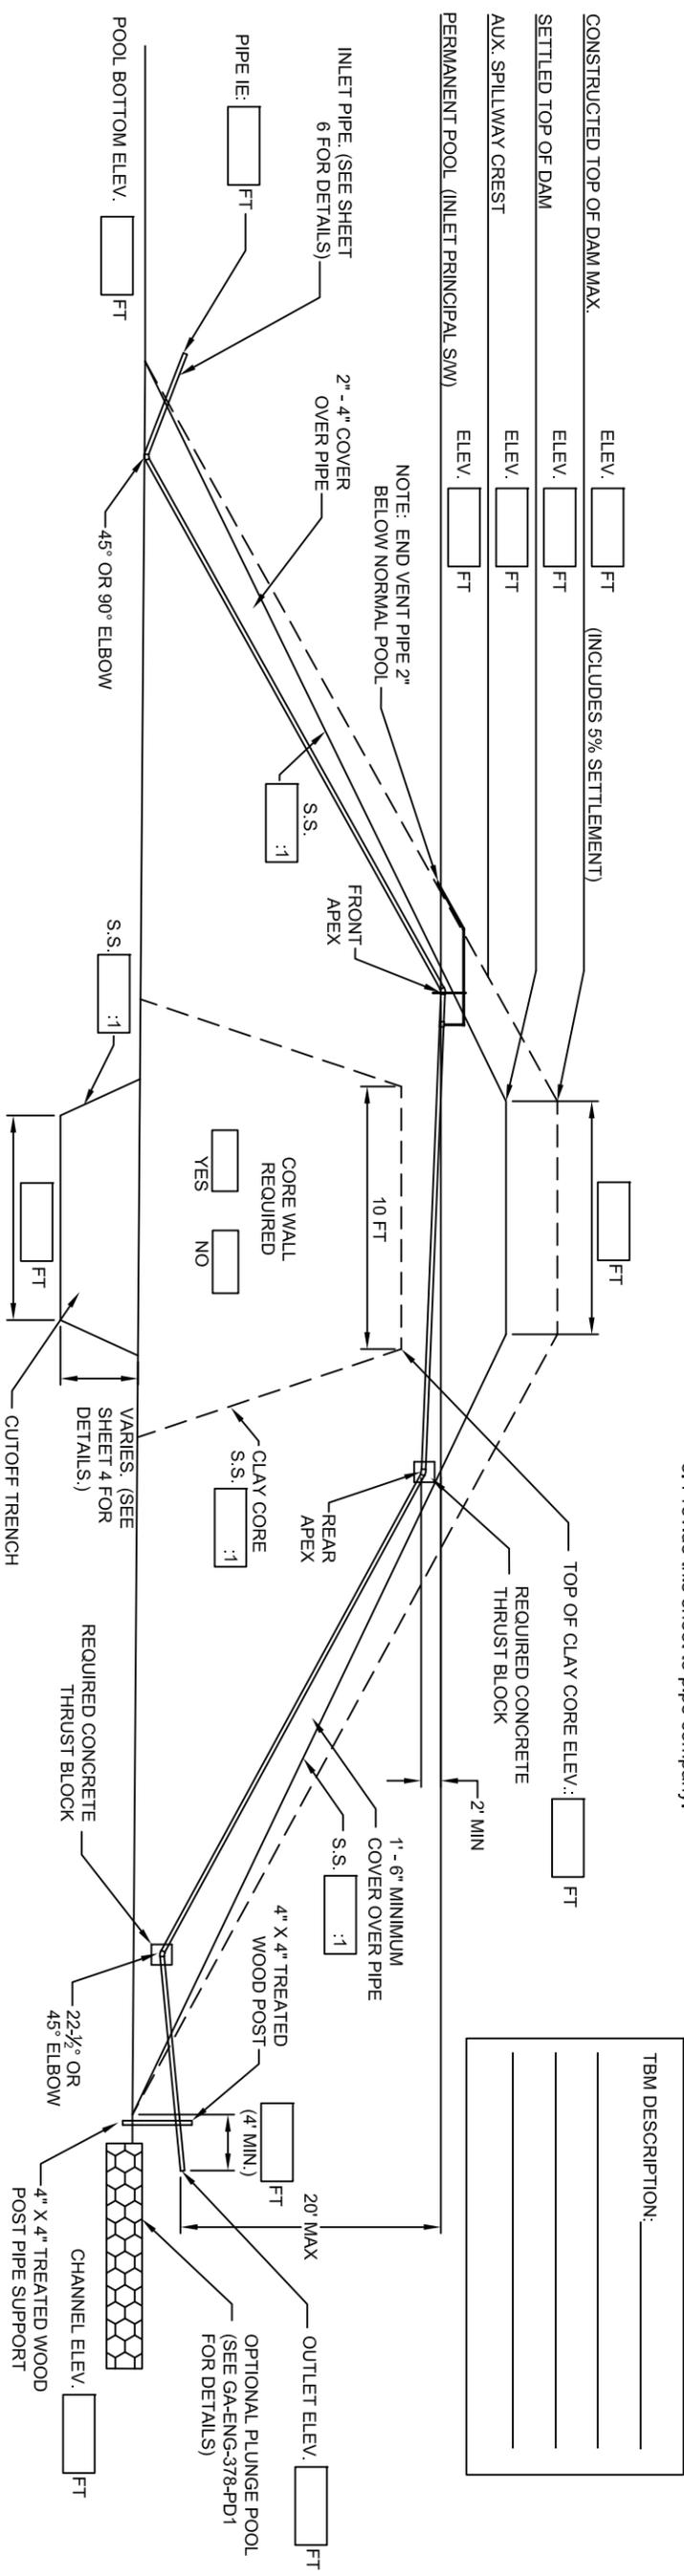

TBM DESCRIPTION: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

**DAM AND PIPE SECTION**

File Name	90-eng-378-pd2.pdf
Drawing Name	Siphon
Date	11/10/2010
Sheet	3 of 9



**GEORGIA STANDARD DRAWINGS**

**EMBANKMENT POND WITH SIPHON SYSTEM**


PREPARED FOR: \_\_\_\_\_

COUNTY OF: \_\_\_\_\_


Date	11/10
Designed	B WRIGHT
Drawn	J HOLLOWAY
Checked	
Approved	




NOTE: ENSURE DURING LAYOUT THAT PLUNGE POOL IS WITHIN THE PROPERTY LINE. ALSO, ENSURE THAT AUXILIARY SPILLWAY FLOW WILL RETURN TO THE STREAM CHANNEL BEFORE THE PROPERTY LINE.

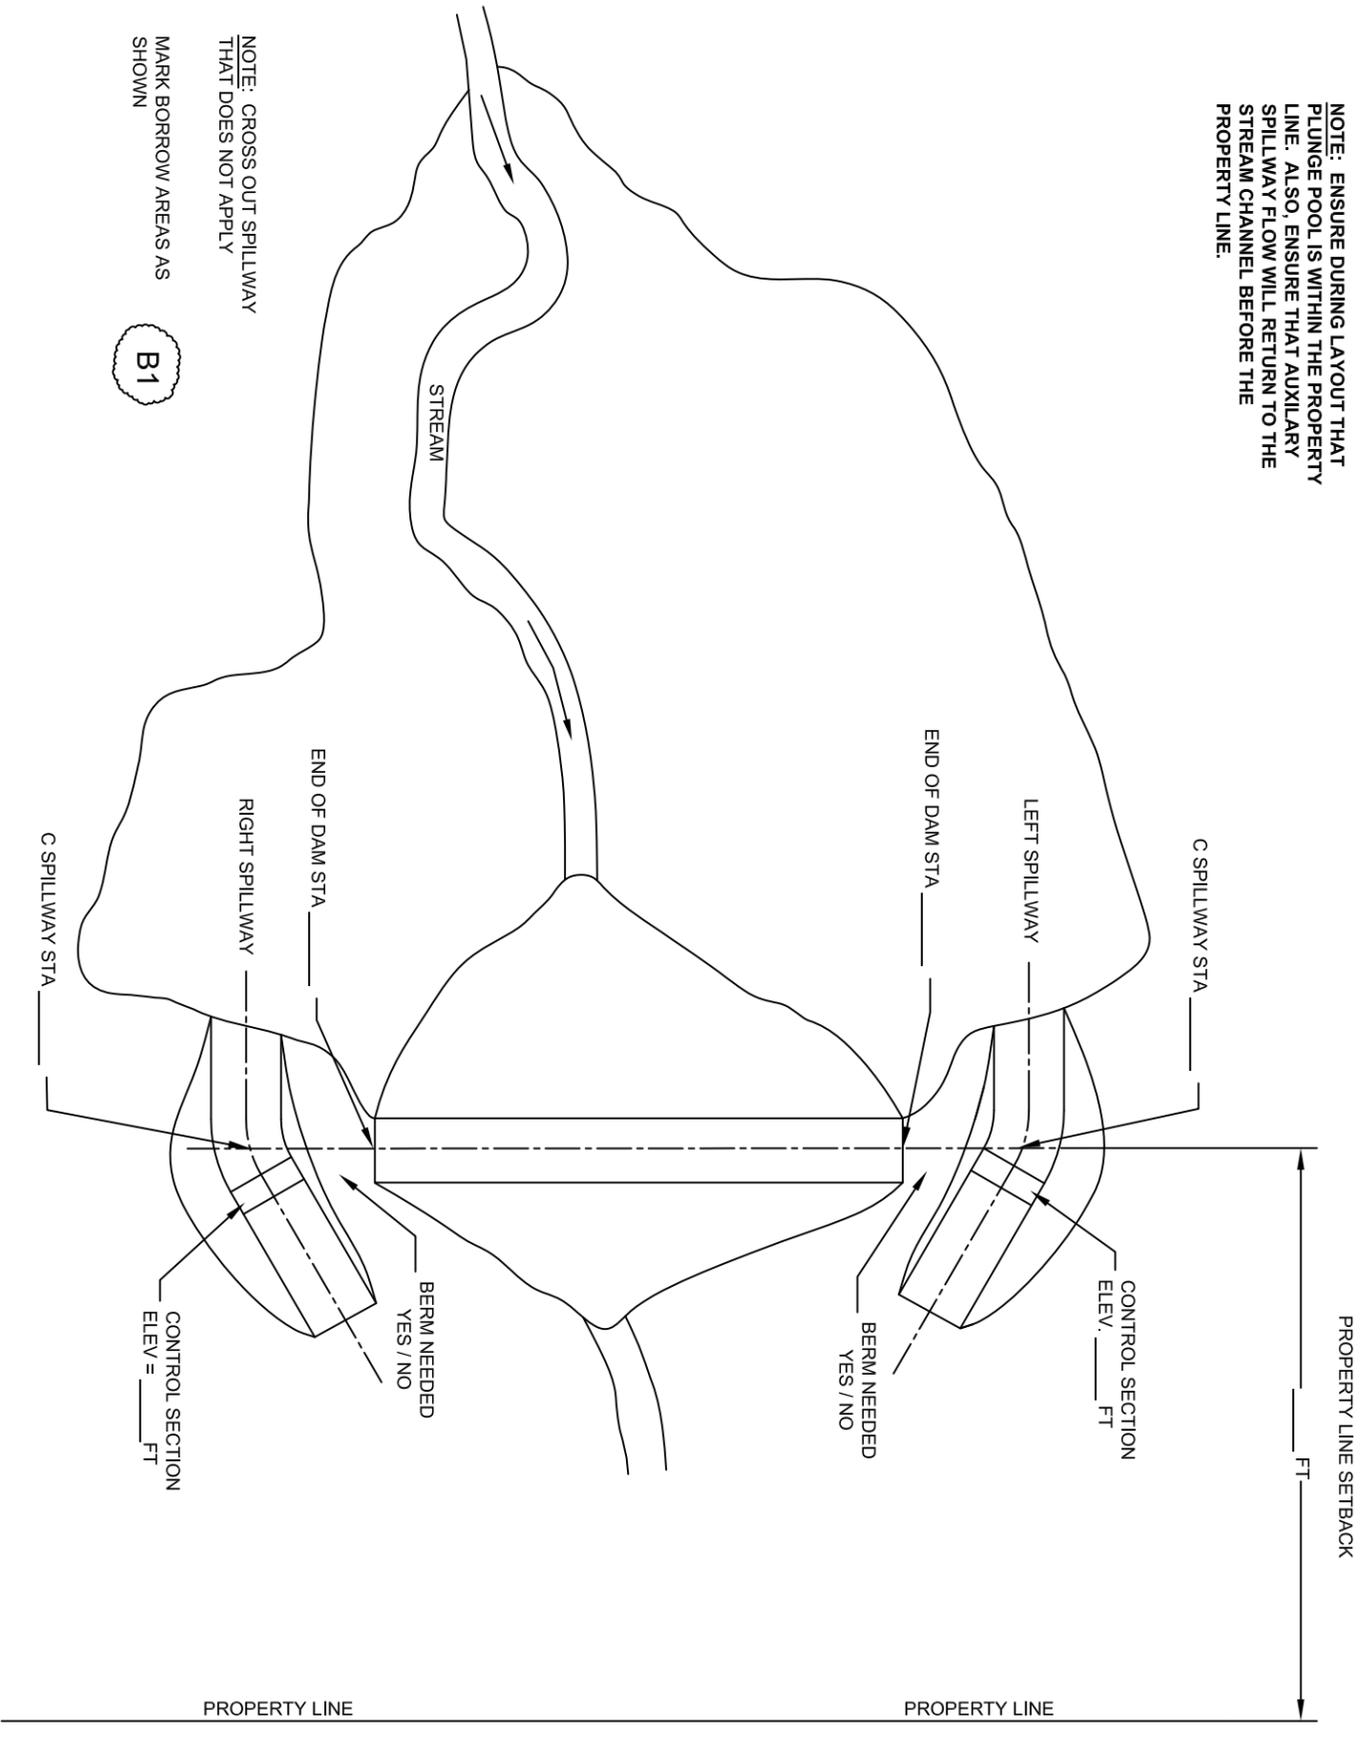


**PLAN VIEW OF DAM**  
NOT TO SCALE

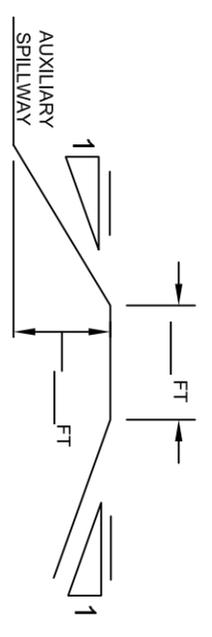

**SPILLWAY BERM CROSS SECTION**

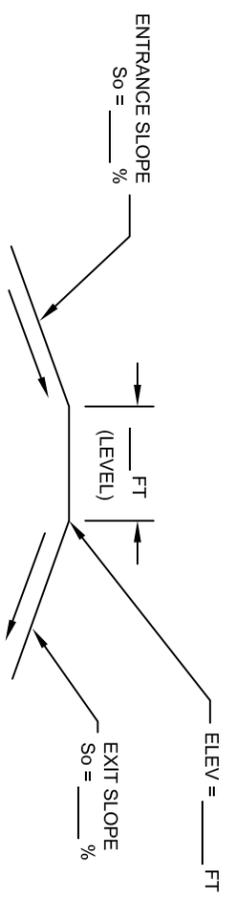

**SPILLWAY LONGITUDINAL SECTION**

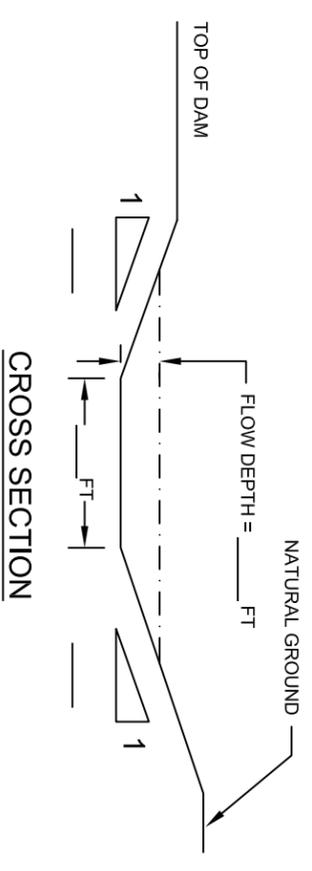

**AUXILIARY SPILLWAY DETAILS**  
NOT TO SCALE


Designed	_____	Date	_____
Drawn	B WRIGHT	11/10	11/10
Checked	J HOLLOWAY	11/10	11/10
Approved	_____	_____	_____

GEORGIA STANDARD DRAWINGS  
EMBANKMENT POND WITH SIPHON SYSTEM  
PREPARED FOR: \_\_\_\_\_  
COUNTY OF: \_\_\_\_\_




DATE	APPROVED	TITLE
11/10/2010	Plan	

File Name: 9d-eng-378-pd2.pdf  
Drawing Name: \_\_\_\_\_  
Sheet 5 of 9

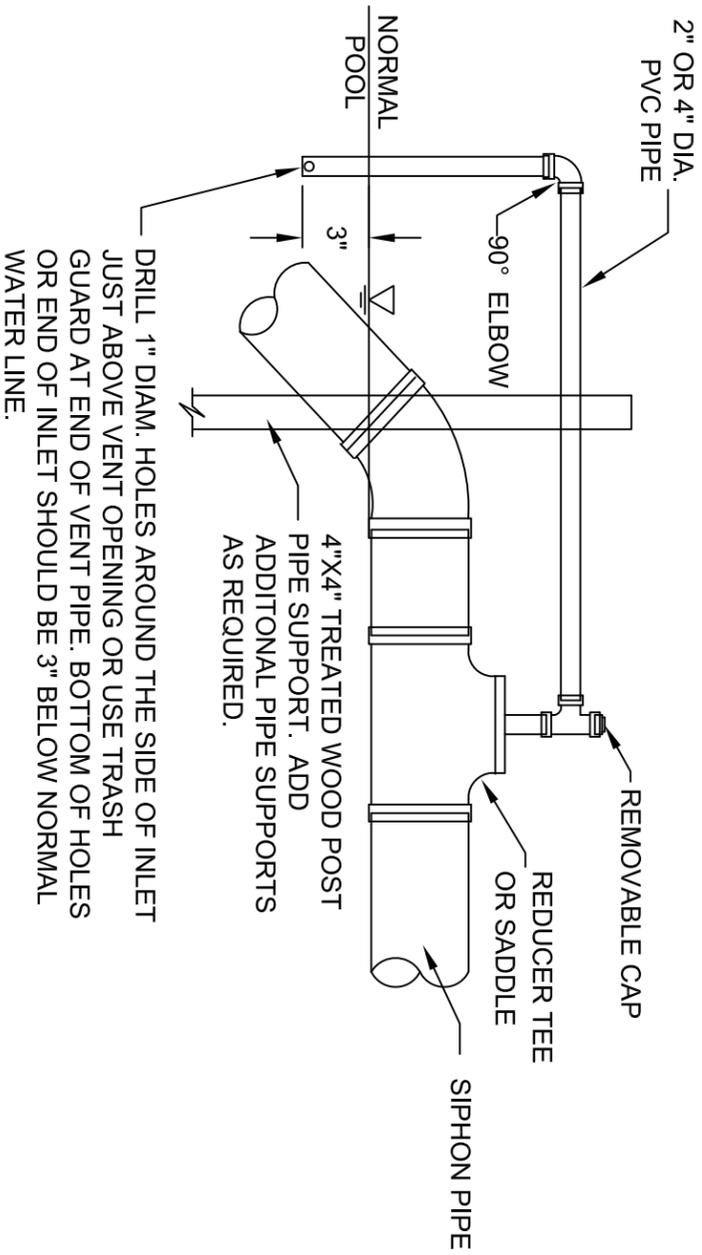


**ALTERNATE VENT**

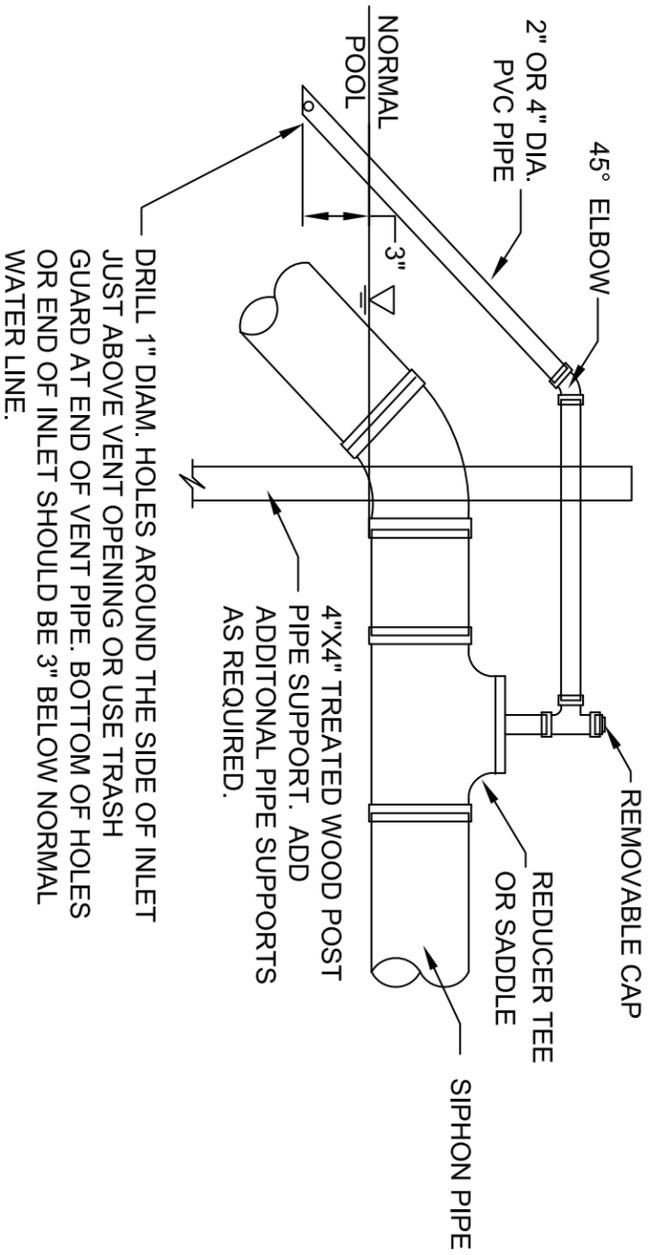

**VENT**

- NOTES:**
1. MAXIMUM DIAMETER OF SIPHON IS 12"
  2. MULTIPLE SIPHONS MAY BE USED
  3. ALL PIPE CONNECTIONS SHALL BE SOLVENT WELD JOINTS.
  4. IN LIEU OF CONVENTIONAL 22 1/2°, 30°, 45° BENDS, TWO 90° ELBOWS MAY BE USED AT THE FRONT APEX AND THE REAR APEX OF THE SIPHON PIPE TO ALLOW THE PIPE TO CONFORM TO THE FRONT AND REAR SLOPES OF THE DAM.
  4. SIPHON PIPE SHOULD BE BURIED IN FRONT OF DAM IF THE POND IS DRAINED.
  5. INLET PIPE PERFORATIONS SHALL HAVE AN AREA EQUAL TO FOUR TIMES PIPE CROSS-SECTIONAL AREA. SEE PRACTICE STANDARD 378 FOR ADDITIONAL REQUIREMENTS OF INLET PIPE.
  6. FOUR INCH VENT PIPES SHALL BE USED ON SIPHON PIPES WITH A DIAMETER OF 8 INCHES OR GREATER.

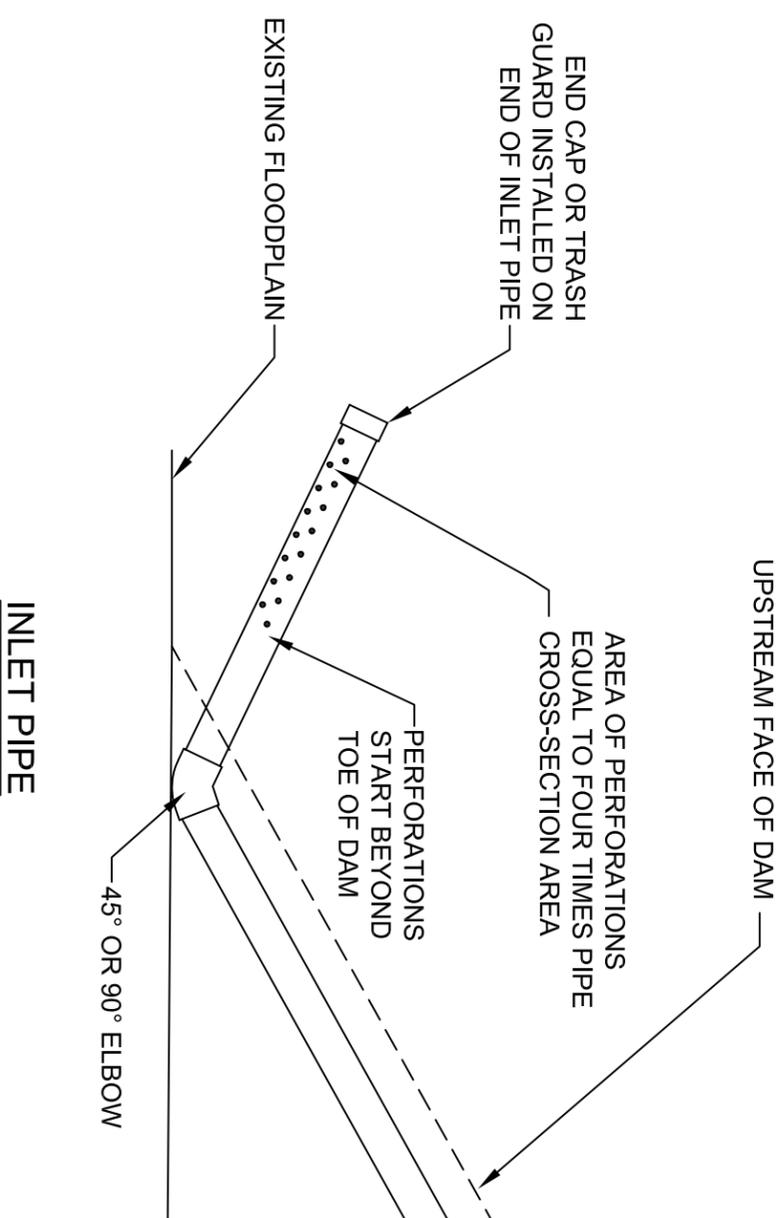

DATE	APPROVED	TITLE

REVISIONS	DATE

File Name  
90-eng-378-pd2.pdf  
Drawing Name  
Siphon




GEORGIA STANDARD DRAWINGS  
**EMBANKMENT POND WITH SIPHON SYSTEM**  
 PREPARED FOR: \_\_\_\_\_  
 COUNTY OF: \_\_\_\_\_

Date	
Designed	
Drawn	B WRIGHT 11/10
Checked	J HOLLOWAY 11/10
Approved	


**NOTES**

1. ALL DAM AND AUXILIARY SPILLWAY AREAS AND ANY OTHER DISTURBED AREAS GREATER THAN 3% SLOPE WILL RECEIVE TREATMENT FROM Ds1, Ds2, AND Ds3.
2. ANY DISTURBED AREA, OTHER THAN THE DAM AND AUXILIARY SPILLWAY AREA, THAT IS LESS THAN 3% SLOPE WILL RECEIVE TREATMENT FROM Ds2 AND Ds3.

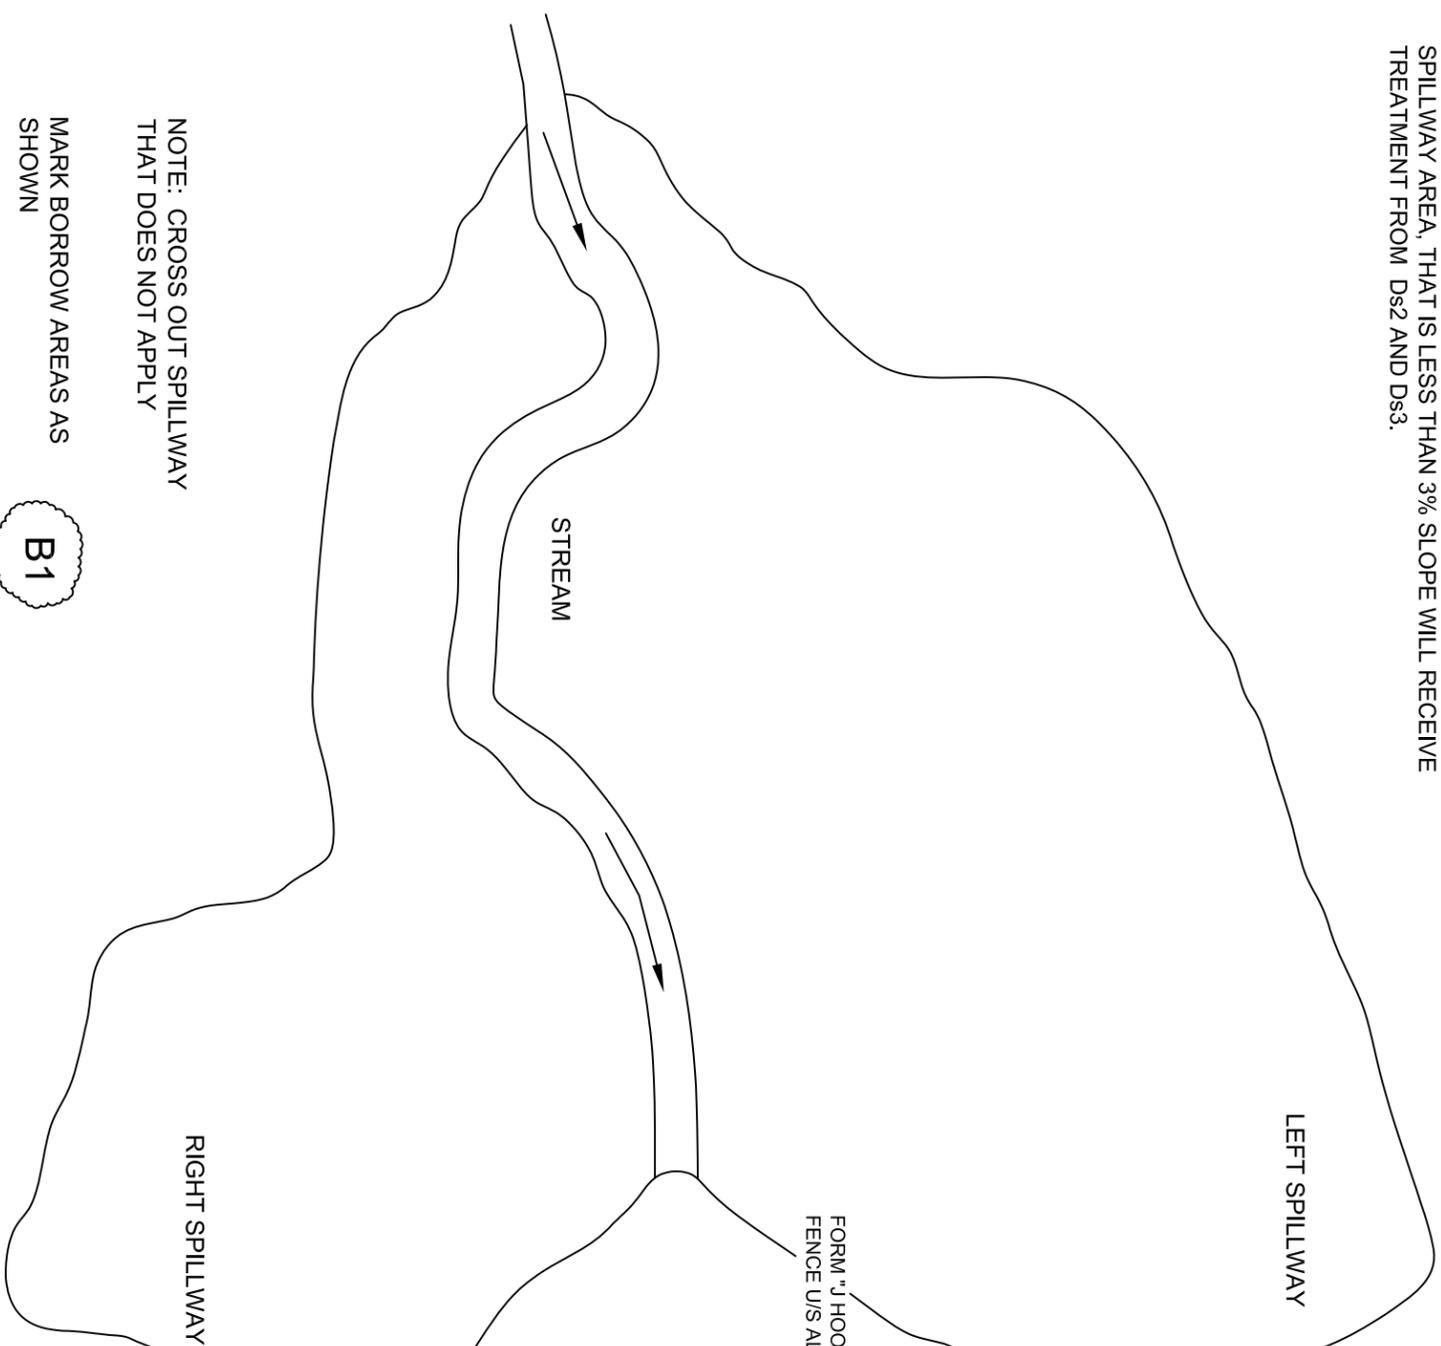

**NOTES**

1. INSTALL TWO ROWS OF TYPE C SILT FENCE ON THE DOWNSTREAM SIDE OF THE DAM. MINIMUM LENGTH OF EACH ROW IS \_\_\_\_ FT.
2. IF NEEDED, INSTALL A ROW OF TYPE A SILT FENCE AT THE OUTLET END OF THE AUXILIARY SPILLWAY. MINIMUM LENGTH OF ROW IS \_\_\_\_ FT.

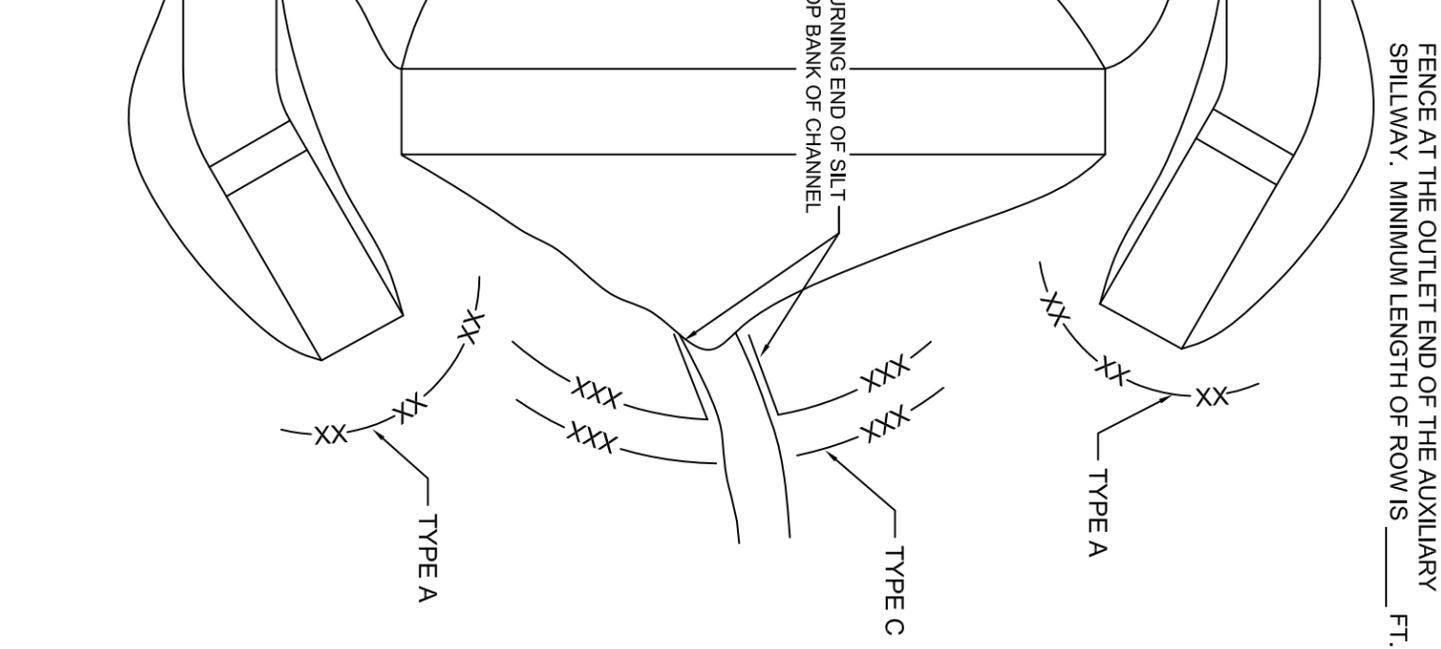

NOTE: CROSS OUT SPILLWAY THAT DOES NOT APPLY

MARK BORROW AREAS AS SHOWN

**B1**

**EROSION AND SEDIMENT CONTROL PLAN**

NOT TO SCALE

**STRUCTURAL PRACTICES**

SYMBOL	PRACTICE	DESCRIPTION
<b>Cd</b>	Checkdam	A small temporary barrier or dam constructed across a swale, drainage ditch, or area of concentrated flow.
<b>Ch</b>	Channel Stabilization	Improving, constructing, or stabilizing an open channel existing stream, or ditch.
<b>Co</b>	Construction Exit	A crushed stone pad located at the construction site exit to provide a place for removing mud from tires thereby protecting public streets.
<b>Cr</b>	Construction Road Stabilization	A travelway constructed as part of a construction plan including access roads, subdivision roads, parking areas, and other on-site vehicle transportation routes.
<b>Dc</b>	Stream Diversion Channel	A temporary channel constructed to convey flow around a construction site while a permanent structure is being constructed.
<b>Di</b>	Diversion	An earth channel or dike located above, below or across a slope to divert runoff. This may be a temporary or permanent structure.
<b>Rd</b>	Rock Filler Dam	A permanent or temporary stone filler dam installed across small streams or drainageways.
<b>Sd1</b>	Sediment Barrier	A barrier to prevent sediment from leaving the construction site. It may be sandbags, bales of straw or hay, brush, logs and poles, gravel, or a silt fence.
<b>Sr</b>	Temporary Stream Crossing	A temporary bridge or culvert type structure protecting a stream or watercourse from damage by crossing construction equipment.
<b>Su</b>	Surface Roughening	A rough soil surface with horizontal depressions on a contour or slope left in a roughened condition after grading.

**VEGETATIVE MEASURES**

SYMBOL	PRACTICE	DESCRIPTION
<b>Ds1</b>	Disturbed Area Stabilization (with Mulching Only)	Establishing temporary protection for disturbed areas where seeding may not have a suitable growing season to produce an erosion retarding cover.
<b>Ds2</b>	Disturbed Area Stabilization (with Seeding)	Establishing temporary vegetative cover with fast growing seedlings on disturbed areas.
<b>Ds3</b>	Disturbed Area Stabilization (with Permanent Vegetation)	Establishing permanent vegetative cover such as trees, shrubs, vines, grasses, sod, or legumes on disturbed areas.
<b>Tb</b>	Tackifiers and Binders	Substance used to anchor straw or hay mulch by causing the organic material to bind together.


NOTE: THE PRACTICES SHOWN IN THE LEGEND ABOVE ARE THE MOST COMMONLY USED FOR POND CONSTRUCTION. FOR COMPLETE LIST OF BEST MANAGEMENT PRACTICES AND GUIDANCE ON DESIGN AND USE OF THESE PRACTICES PLEASE SEE THE MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA, 2000 EDITION.

Date	11/10
Designed	B WRIGHT
Drawn	J HOLLOWAY
Checked	
Approved	

GEORGIA STANDARD DRAWINGS  
 EMBANKMENT POND WITH SIPHON SYSTEM  
 PREPARED FOR: \_\_\_\_\_  
 COUNTY OF: \_\_\_\_\_




File Name	90-eng-378-p42.pdf
Drawing Name	E&S Plan
DATE	11/10/2010
APPROVED	
TITLE	
REVISIONS	
Sheet	7 of 9

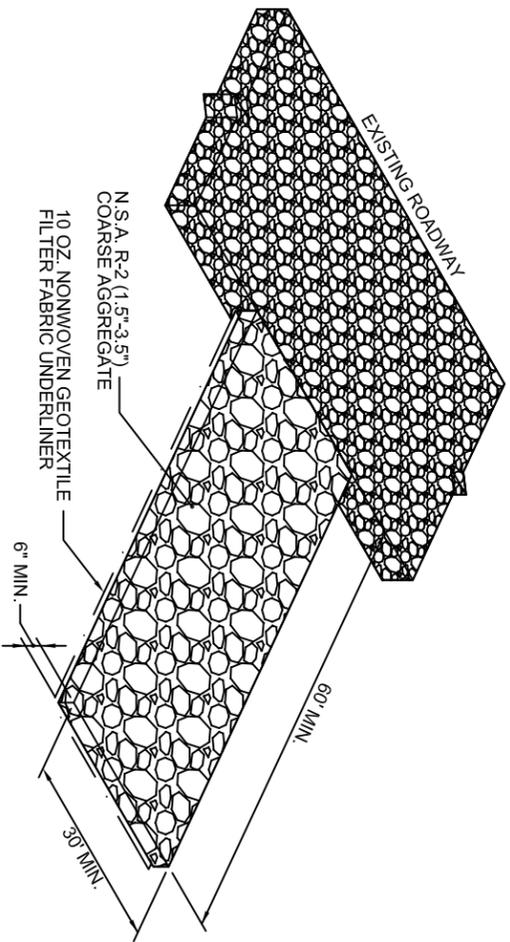


- NOTES:
1. THE EXIT SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOW OF MUD ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH 1.5-3.5 INCH STONE, AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEANNOUT OF ANY STRUCTURES TO TRAP SEDIMENT.
  2. ALL MATERIALS SPILLED, DROPPED, WASHED OR TRACKED FROM VEHICLES ONTO ROADWAYS OR INTO STORM DRAINS MUST BE REMOVED IMMEDIATELY. UPON COMPLETION OF CONSTRUCTION, STONE AND GEOTEXTILE WILL BE REMOVED.

**Co** CONSTRUCTION ENTRANCE  
NTS

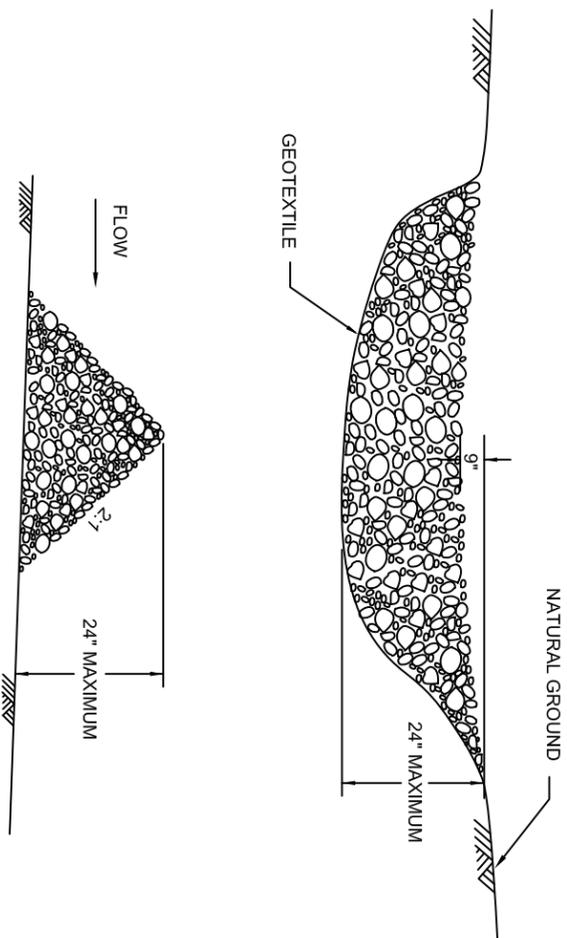




- NOTES:
1. STONE CHECK DAMS SHALL BE CONSTRUCTED OF GRADED SIZE 2-10 INCH STONE. MECHANICAL OR HAND PLACEMENT SHALL BE REQUIRED TO INSURE COMPLETE COVERAGE OF ENTIRE WIDTH OF DITCH OR SWALE AND THAT CENTER OF DAM IS LOWER THAN THE EDGES.
  2. PERIODIC INSPECTION AND REQUIRED MAINTENANCE MUST BE PROVIDED. SEDIMENT SHALL BE REMOVED WHEN IT REACHES A DEPTH OF ONE-HALF THE ORIGINAL DAM HEIGHT OR BEFORE. IF THE AREA IS TO BE MOVED, CHECK DAMS SHALL BE REMOVED ONCE FINAL STABILIZATION HAS OCCURRED. OTHERWISE, CHECK DAMS MAY REMAIN IN PLACE PERMANENTLY.
  3. AFTER REMOVAL, THE AREA BENEATH THE DAM SHALL BE SEEDED AND MULCHED IMMEDIATELY.

**Cd** CHECK DAM  
NTS

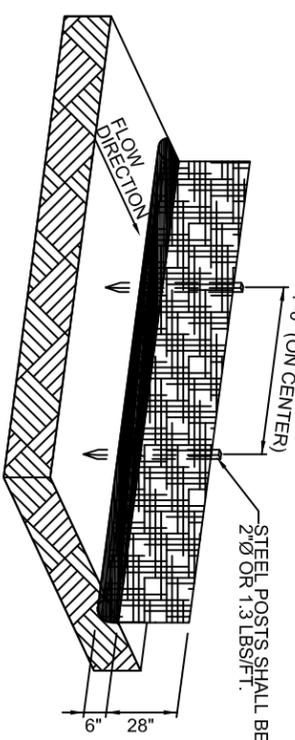

- NOTES:
1. TEMPORARY PLANTING MUST BE REPLACED BY PERMANENT GRASS DURING THE FIRST AVAILABLE PLANTING SEASON.
  2. SILT CONTROL SHALL BE IN EFFECT PRIOR TO ANY GRADING OR CONSTRUCTION.
  3. USE TYPE 'C' WIRE-REINFORCED SILT FENCE AS STATED IN THE STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION DEPARTMENT OF TRANSPORTATION, STATE OF GEORGIA (DEC. 19, 1991). FILTER FABRIC FOR TYPE 'C' FENCE SHALL BE A NON-CALENDERED WOVEN FABRIC CONSTRUCTED WITH MONOFLAMENT YARNS. THE WOVEN WIRE-REINFORCEMENT FENCE SHALL BE AT LEAST 32 INCHES HIGH AND BE AT LEAST 10 GAUGE FOR THE TOP AND BOTTOM WIRES AND 12.5 GAUGE FOR THE REST OF THE WIRE.
  4. SPLICED JOINTS SHALL OVERLAP 18" WITH MATCHING POST.
  5. DRIVE 4' (48") MIN. POSTS 12"-18" INTO SOIL.
  6. DIG DITCH 12" WIDE, 6" DEEP. LAY FABRIC 6"-8" DEEP, THEN BACKFILL.
  7. ALONG STREAM BUFFERS AND OTHER SENSITIVE AREAS, TWO ROWS OF TYP C SILT FENCE OR ONE ROW OF TYPE C SILT FENCE BACKED BY HAYBALES SHALL BE USED.
  8. TYPE A SILT FENCE MAY BE USED IN AREAS OTHER THAN ALONG THE STREAM BUFFER.

**Sd1** TYPE C SILT FENCE DETAIL  
NTS

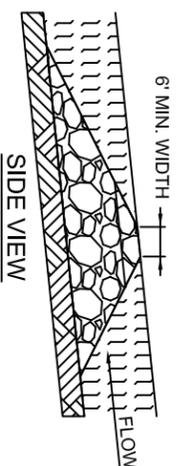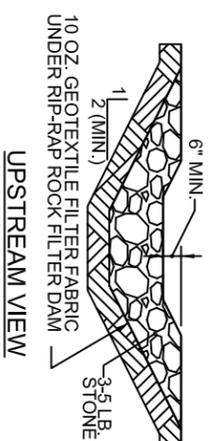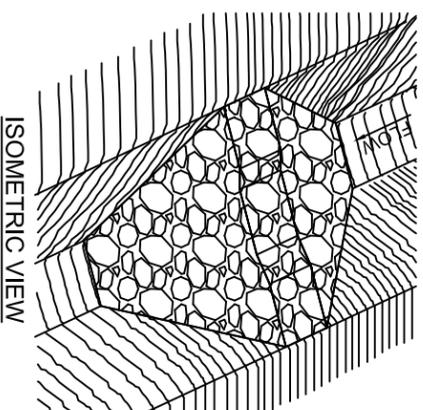

**Rd** ROCK FILTER DAM  
NTS

DATE	APPROVED	TITLE

REVISIONS	TITLE



GEORGIA STANDARD DRAWINGS  
EMBANKMENT POND WITH SIPHON SYSTEM  
PREPARED FOR: \_\_\_\_\_  
COUNTY OF: \_\_\_\_\_

Designed	Drawn	Checked	Approved	Date
	B WRIGHT	J HOLLOWAY		11/10
				11/10

File Name  
9d-eng-378-pd2.pdf  
Drawing Name  
E&S Details  
11/10/2010  
Sheet 8 of 9

**EROSION CONTROL MEASURES**

1. CONFIRM LOCATION OF AND CONSTRUCT/INSTALL SILT FENCES AND CHECK DAMS AS SHOWN ON THE DRAWINGS AND IN ACCORDANCE WITH MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA.
2. ADD TOPSOIL/SURFACE ROUGHEN AS REQUIRED TO PROVIDE BED FOR PERMANENT
3. APPLY PERMANENT SOIL STABILIZATION.
4. AREAS TO BE LEFT DORMANT FOR LONGER THAN 7 DAYS THAT HAVE NOT ALREADY BEEN PERMANENTLY SEEDED MUST BE TEMPORARILY STABILIZED.
5. AFTER GROUND COVER IS WELL ESTABLISHED AND THE SITE IS STABILIZED, RETURN TO THE SITE AND REMOVE ALL TEMPORARY MEASURES AND INSTALL PERMANENT VEGETATION TO ALL AREAS DISTURBED BY TEMPORARY MEASURES.
6. REMOVE EROSION CONTROL MEASURES WITHIN 30 CALENDAR DAYS AFTER FINAL SITE STABILIZATION.

**MANAGEMENT PLAN**

EROSION CONTROL MEASURES WILL BE MAINTAINED AT ALL TIMES. ALL EROSION CONTROL MEASURES SHALL BE INSPECTED DAILY AND AFTER EACH HEAVY RUNOFF PRODUCING RAINFALL. ALL NEEDED REPAIRS SHALL BE MADE IMMEDIATELY TO MAINTAIN A FUNCTIONING EROSION CONTROL SYSTEM. THE FAILURE OF ANY EROSION CONTROL DEVICE TO FUNCTION AS INTENDED, FOR ANY REASON, SHALL BE CORRECTED IMMEDIATELY. ADDITIONAL EROSION AND SEDIMENT CONTROL MEASURES WILL BE INSTALLED IF DEEMED NECESSARY BY ON-SITE INSPECTION. STRUCTURES THAT SHALL BE INSPECTED INCLUDE:

**SEEDING (Ds2) AND FERTILIZING (Ds3)**  
 SEEDED AREA SHALL BE INSPECTED FOR FAILURE AND NECESSARY REPAIRS SHALL BE MADE WITHIN THE SAME SEASON, IF POSSIBLE.

**SILT FENCE (Sd1)**  
 ANY FABRIC WHICH COLLAPSES, TEARS, DECOMPOSES, OR BECOMES INEFFECTIVE WILL BE REPLACED IMMEDIATELY. REMOVE SEDIMENT DEPOSITS BEHIND FENCE WHEN SEDIMENT ACCUMULATES TO 6 INCHES.

**ROCK FILTER DAM (Rd), CHECK DAM (Cd) OR BRUSH BARRIERS (Sd1-Bb)**  
 INSPECT FOR SIGNIFICANT EROSION AROUND THE EDGES AND BETWEEN BARRIERS. REMOVE SEDIMENT ACCUMULATED BEHIND THE DAMS AS REQUIRED TO PREVENT DAMAGE TO CHANNEL VEGETATION. ADD STONES TO DAMS AS REQUIRED TO MAINTAIN DESIGN HEIGHT AND CROSS SECTION.

**FERTILIZER SCHEDULE**

TYPE OF SPECIES	APPLICATION/ YEAR	ANALYSIS OR EQUIVALENT N-P-K	RATE LBS./AC.	TOP DRESSING RATE LBS./AC.
COOL SEASON GRASSES	FIRST	6-12-12	1500	50-100
	SECOND	6-12-12	1000	1 / 2 /
COOL SEASON LEGUMES & COVER	FIRST	10-10-10	400	30
	SECOND	6-12-12	1500	0-50
WARM SEASON GRASSES & LEGUMES	FIRST	0-10-10	1300	-
	SECOND	6-12-12	400	-
PINE SEEDLINGS	FIRST	10-10-10	1300	3 /
	SECOND	10-10-10	1100	-
SHRUB LESPEDEZA	FIRST	20-10-5	SEE NOTE 1	-
	SECOND	0-10-10	700	-
TEMPORARY COVER CROPS SEEDED ALONE	FIRST	0-10-10	700	4 /
	SECOND	10-10-10	500	30
WARM SEASON GRASSES	FIRST	6-12-12	1500	50-100
	SECOND	6-12-12	800	2 / 6 /
WARM SEASON GRASSES & LEGUMES	FIRST	10-10-10	1500	30
	SECOND	6-12-12	1500	50
		0-10-10	400	6 /

NOTE:  
 1. ONE 21-GRAM PELLET PER SEEDLING PLACED IN THE CLOSING HOLE.

- FOOTNOTES:  
 1/ APPLY IN SPRING FOLLOWING SEEDING.  
 2/ APPLY IN SPLIT APPLICATION WHEN HIGH RATES ARE USED.  
 3/ APPLY IN 3 SPLIT APPLICATIONS.  
 4/ APPLY WHEN PLANTS ARE PRUNED.  
 5/ APPLY TO GRASS SPECIES ONLY.  
 6/ APPLY WHEN PLANTS GROW TO A HEIGHT OF 2 TO 4 INCHES.

**VEGETATIVE PLAN**

TEMPORARY EROSION CONTROL DEVICES SHALL BE MAINTAINED UNTIL PERMANENT COVER IS ESTABLISHED AND THEN REMOVED SO THAT DRAINAGE FROM THE SITE IS NOT IMPEDED.

ALL VEGETATIVE STABILIZATION SHALL BE ACCOMPLISHED AS SOON AS CONSTRUCTION PERMITS.

**TEMPORARY SEEDING (Ds2)**

LIME: 2 TONS PER ACRE

FERTILIZER: APPLY FERTILIZER PER FERTILIZER SCHEDULE

SEEDING: APPLY SEED FOR TEMPORARY VEGETATION PER VEGETATIVE COVER SCHEDULE

**MULCH:** SHALL BE UNCHOPPED, UNROTTED, SMALL GRAIN STRAW APPLIED AT A RATE OF 2.0 TONS PER ACRE OR 2.5 TONS PER ACRE IF HAY IS USED. MULCH MATERIAL SHALL BE RELATIVELY FREE OF ALL KINDS OF WEEDS. SPREAD MULCH MECHANICALLY OR UNIFORMLY BY HAND. MULCH ANCHORING SHALL BE ACCOMPLISHED IMMEDIATELY AFTER MULCH PLACEMENT TO MINIMIZE LOSS BY WIND OR WATER. THIS MAY BE DONE BY MULCH ANCHORING TOOL, NETTING OR LIQUID MULCH BINDERS. APPROVED TACKIFIERS AND BINDERS ARE LISTED IN THE TACKIFIERS AND BINDERS TABLE.

**PERMANENT SEEDING (Ds3)**

LIME: 2 TONS PER ACRE

FERTILIZER: APPLY FERTILIZER PER FERTILIZER SCHEDULE

SEEDING: APPLY SEED FOR PERMANENT VEGETATION PER VEGETATIVE COVER SCHEDULE

**SEEDBED PREPARATION:** AREA TO BE SEEDED SHALL BE LOOSE AND PLIABLE TO A DEPTH OF AT LEAST 4 INCHES. THE TOP LAYER SHALL BE LOOSENEED BY RAKING, DISCING OR TRACKING WITH DOZER BEFORE SEEDING OCCURS. IN LIEU OF SOIL TEST RESULTS, APPLY 1 TO 2 TONS OF DOLOMITIC LIMESTONE AND 1500 POUNDS OF 10-10-10 FERTILIZER PER ACRE. HARROW OR DISC LIME AND FERTILIZER INTO THE SOIL TO A DEPTH OF AT LEAST 4 INCHES.

**SEEDING:** APPLY SEED FOR PERMANENT VEGETATION PER VEGETATIVE COVER SCHEDULE. APPLY SEED UNIFORMLY BY MECHANICALLY OR BY HYDROSEEDER ON A MOIST, FIRM SEEDBED.

**MULCH:** SHALL BE UNCHOPPED, UNROTTED, SMALL GRAIN STRAW APPLIED AT A RATE OF 2.0 TONS PER ACRE OR 2.5 TONS PER ACRE IF HAY IS USED. MULCH MATERIAL SHALL BE RELATIVELY FREE OF ALL KINDS OF WEEDS. SPREAD MULCH MECHANICALLY OR UNIFORMLY BY HAND. CLEAN COTTON GIN TRASH MAY BE USED IN LIEU OF STRAW OR HAY MULCH. APPLY GIN TRASH A MAXIMUM OF 1/2 INCH THICK COVERING 75% OF THE AREA. MULCH ANCHORING SHALL BE ACCOMPLISHED IMMEDIATELY AFTER MULCH PLACEMENT TO MINIMIZE LOSS BY WIND OR WATER. THIS MAY BE DONE BY MULCH ANCHORING TOOL, NETTING OR LIQUID MULCH BINDERS. APPROVED TACKIFIERS AND BINDERS ARE LISTED IN THE TACKIFIERS AND BINDERS TABLE.

**VEGETATIVE COVER SCHEDULE**

MONTH	TEMPORARY	RATE/ACRE		RESOURCE AREA	PERMANENT	RATE/ACRE		RESOURCE AREA
		ALONE	MIX			ALONE	MIX	
JAN.	RE ANNUAL RYEGRASS	3 BU.	0.5 BU.	C	UNHULLED BERMU DA	-	6 LBS.	P, C
	ANNUAL LESPEDEZA	40 LBS.	10 LBS.	M, P, C <sup>1/2</sup>	PENSACOLA BAHIA	60 LBS.	30 LBS.	P, C
FEB.	RE ANNUAL RYEGRASS	3 BU.	1.5 BU.	C	SERICA LESPEDEZA 1/2	-	79 LBS.	C
	ANNUAL LESPEDEZA	40 LBS.	10 LBS.	M, P, C	UNHULLED BERMU DA	-	6 LBS.	P, C
	ANNUAL RYEGRASS	40 LBS.	10 LBS.	M, P, C	PENSACOLA BAHIA	60 LBS.	30 LBS.	P, C
MARCH	ANNUAL RYEGRASS	40 LBS.	1.5 BU.	C	SERICA LESPEDEZA 1/2	10 LBS.	10 LBS.	M, P, C
	RE	3 BU.	-	M, P, C	HULLED BERMU DA	30 LBS.	30 LBS.	M, P, C
					PENSACOLA BAHIA	60 LBS.	30 LBS.	P, C
APRIL	ANNUAL LESPEDEZA	40 LBS.	10 LBS.	M, P	SAME AS MARCH	60 LBS.	60 LBS.	M, P, C
	BROWN TOP MILLET	40 LBS.	10 LBS.	M, P, C	HULLED BERMU DA	10 LBS.	6 LBS.	P, C
MAY	SAME AS APRIL				PENSACOLA BAHIA	10 LBS.	30 LBS.	P, C
JUNE	BROWN TOP MILLET	40 LBS.	10 LBS.	M, P, C	SAME AS MAY	60 LBS.	60 LBS.	M, P, C
JULY	RE PEARL MILLET	3 BU.	1.5 BU.	M, P, C	PENSACOLA BAHIA	10 LBS.	30 LBS.	P, C
	BROWN TOP MILLET	40 LBS.	10 LBS.	M, P, C	HULLED BERMU DA	10 LBS.	6 LBS.	P, C
AUG.	PEARL MILLET	50 LBS.	-	P, C	PENSACOLA BAHIA	60 LBS.	30 LBS.	P, C
	ANNUAL RYEGRASS	40 LBS.	1.5 BU.	M, P, C	SAME AS AUGUST	60 LBS.	60 LBS.	M, P, C
SEPT.	ANNUAL RYEGRASS	40 LBS.	-	M, P, C	SAME AS AUGUST	60 LBS.	60 LBS.	M, P, C
	RE	3 BU.	1.5 BU.	M, P, C	UNHULLED BERMU DA	60 LBS.	30 LBS.	P, C
OCT.	ANNUAL RYEGRASS	40 LBS.	-	M, P, C	PENSACOLA BAHIA	60 LBS.	30 LBS.	M, P, C
NOV.	SAME AS OCTOBER				SAME AS JANUARY	60 LBS.	60 LBS.	M, P, C
DEC.	SAME AS OCTOBER				SAME AS JANUARY	60 LBS.	60 LBS.	M, P, C

- FOOTNOTES:  
 1/ SEED WILL BE SCARIFIED.  
 2/ INNOCULATE SEED.  
 3/ M - MOUNTAIN, P - PIEDMONT, C - COASTAL

**TACKIFIERS AND BINDERS TABLE**

THE FOLLOWING LIST OF TACKIFIERS AND BINDERS ARE APPROVED TO ANCHOR STRAW OR HAY MULCH ON CRITICAL AREAS. A TACKIFIER MAY BE SUBSTITUTED FOR EMULSIFIED ASPHALT. THESE TACKIFIERS ARE ALSO APPROVED TO ANCHOR WOOD CELLULOSE, WOOD PULP FIBER, AND OTHER MULCH MATERIALS APPLIED WITH HYDROSEEDING EQUIPMENT.

PRODUCT OR TRADE NAME	RECOMMENDED APPLICATION RATE
A500 HYDRO-STIK	40 LB./AC.
AGRO TACK MP	PER MANUFACTURERS RECOMMENDATIONS
CONVED CON-TAC	40 LB./AC.
ECOTAK-OP	PER MANUFACTURERS RECOMMENDATIONS
ECOTAK-SATI	PER MANUFACTURERS RECOMMENDATIONS
EMULSIFIED ASPHALT	100 GAL. OF SS-1H OR CSS-1H & 100 GAL. OF WATER/TON OF MULCH
HERCULES SOILLOC-E	PER MANUFACTURERS RECOMMENDATIONS
HYDRO-BOND	35 LB./AC.
RMB-PLUS	80-120 LB./AC.
TACPAK GT	PER MANUFACTURERS RECOMMENDATIONS
TERRA-MULCH TACKING	PER MANUFACTURERS RECOMMENDATIONS
AGENT III	PER MANUFACTURERS RECOMMENDATIONS

Date	
Designed	
Drawn	B WRIGHT 11/10
Checked	J HOLLOWAY 11/10
Approved	

GEORGIA STANDARD DRAWINGS  
 EMBANKMENT POND WITH SIPHON SYSTEM  
 PREPARED FOR: \_\_\_\_\_  
 COUNTY OF: \_\_\_\_\_



File Name	9d-eng-378-p42.pdf
Drawing Name	Vegetation
Date	11/10/2010
Sheet	9 of 9

DATE	APPROVED	TITLE