




TRENCH DETAIL

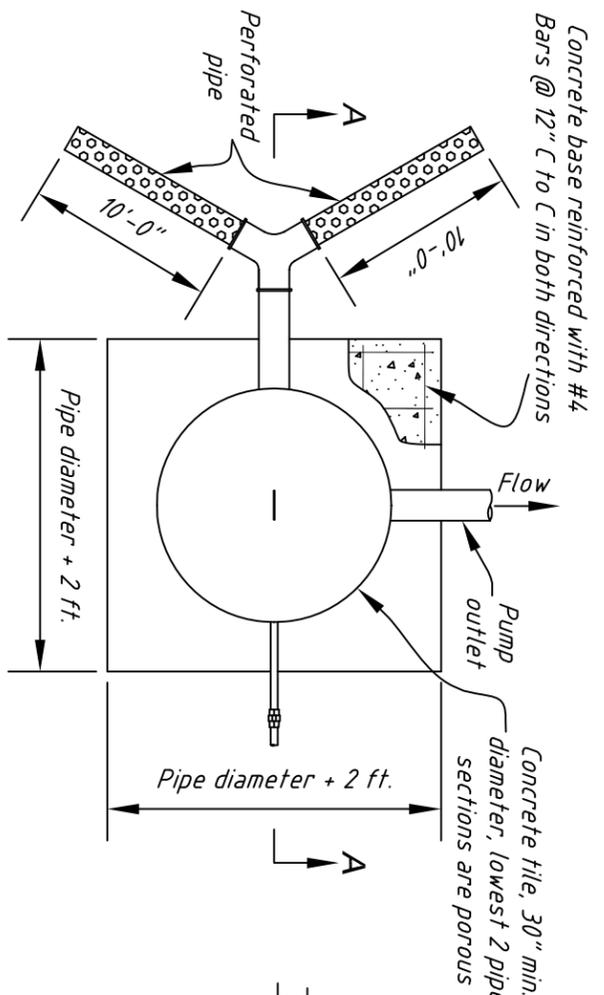

Plan

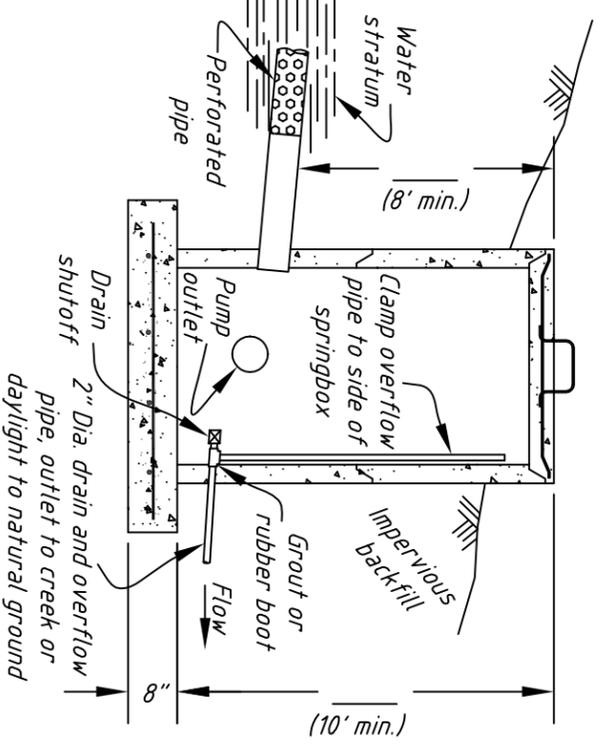

Section A-A

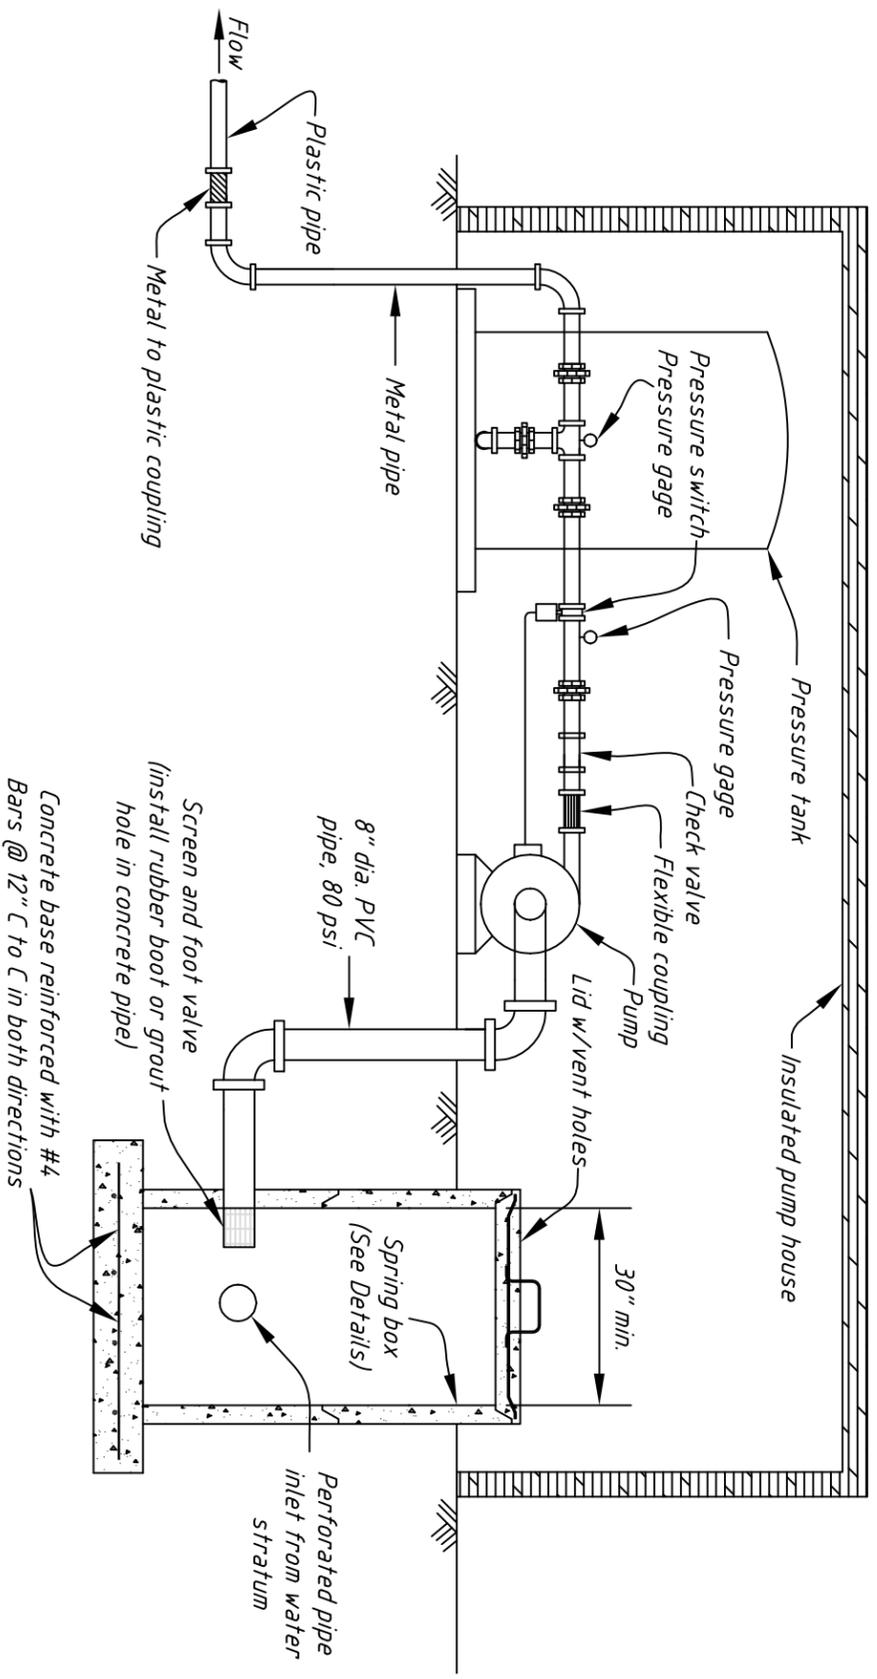

SPRING BOX SECTION & PUMP MANIFOLD

TABLE OF QUANTITIES				
Item	Pipe Type	Dia. (in.)	Unit	Quantity
Spring Box			Ft.	
Perforated Pipe			Ft.	
Overflow/Drain Pipe			Ft.	
8" Dia. PVC Pipe, 80 psi	PVC		Ft.	
Sand/Gravel Envelope			C.Y.	
Concrete			C.Y.	

- Notes:
1. Place perforated pipe sections within the water bearing strata.
 2. Provide air passage inot spring box by placing three 1/2" holes in cover.
 3. HDPE corrugated pipe or corrugated metal pipe may be used for the spring box in lieu of concrete pipe.



Arizona Drawing Template
Spring Development (Under Pressure)

Date _____

Designed _____

Drawn _____

Checked _____

Approved _____