


**ANIMAL MORTALITY FACILITY
 GEORGIA STANDARD DRAWINGS, STAND ALONE STRUCTURE
 20' WIDE, STANDARD COMPOSTING BIN
 6" X 6" POST CONSTRUCTION**

- THE FOLLOWING DRAWINGS WERE PREPARED IN ACCORDANCE WITH PRACTICE CODES 316--ANIMAL MORTALITY FACILITY, 561 - HEAVY USE AREA, 367 - ROOFS AND COVERS AND GEORGIA BUILDING CODE (INTERNATIONAL BUILDING CODE 2006)
- DESIGN DATA REQUIRED BY IBC 2006:
 - ROOF LIVE LOAD - 20 PSF.
 - BASIC WIND SPEED OF 90 MPH AND GROUND SNOW LOAD OF 10 PSF OR BASIC WIND SPEED OF 100 MPH AND NO SNOW LOAD.
 - IMPORTANCE FACTOR, I=0.87
 - WIND EXPOSURE CATEGORY C.
 - INTERNAL PRESSURE COEFFICIENT = 0.55
- THIS DESIGN IS NOT INTENDED FOR USE IN EXTREME SOUTH AND EAST COUNTIES OF THE STATE THAT ARE SUBJECT TO HURRICANE WIND LOADS (SEE MAP BELOW)
- THIS DESIGN IS NOT INTENDED FOR CONSTRUCTION ON AN ISOLATED HILL, RIDGE, OR ESCARPMENT IN ANY REGION OF THE STATE.
- ANY CHANGES TO THESE DRAWINGS MUST BE APPROVED BY AN ENGINEER WITH JOB APPROVAL LEVEL IV OR GREATER.
- NO ADDITIONS SHOULD BE MADE TO STRUCTURE WITHOUT APPROVAL FROM NRCS.
- THESE DRAWINGS MUST BE SITE SPECIFIC TO ACCOUNT FOR WASTE PRODUCTION VALUES; LENGTH MUST BE DETERMINED.

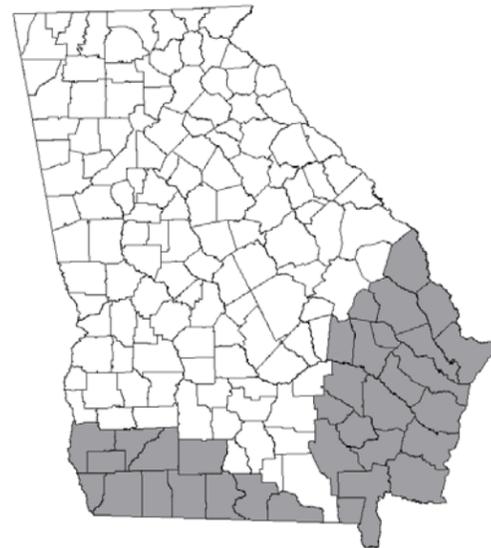

SITE LOCATION MAP

THIS DESIGN IS NOT INTENDED FOR USE IN COUNTIES SUBJECT TO HURRICANE WIND LOADS SHADED GRAY ABOVE.

**UNITED STATES DEPARTMENT OF AGRICULTURE
 NATURAL RESOURCES CONSERVATION SERVICE
 HELPING PEOPLE HELP THE LAND**

ANIMAL MORTALITY FACILITY

COUNTY, GEORGIA

PRE-CONSTRUCTION CERTIFICATION:

THE _____ ANIMAL MORTALITY FACILITY HAS BEEN CONSTRUCTED IN ACCORDANCE WITH THE FOLLOWING DRAWINGS AND PRACTICE CODES 316, 367, AND 561. ALL CHANGES HAVE BEEN APPROVED BY AN ENGINEER WITH JOB APPROVAL AUTHORITY LEVEL IV OR GREATER. ALL ADDITIONS HAVE BEEN APPROVED BY NRCS.

OWNER _____	DATE _____	NRCS REPRESENTATIVE _____	DATE _____	ENGINEER (IF REQUIRED) _____	DATE _____
-------------	------------	---------------------------	------------	------------------------------	------------

AS-BUILT CERTIFICATION:

THIS PRACTICE HAS BEEN CONSTRUCTED IN ACCORDANCE TO THESE PLANS AND MEETS NRCS STANDARDS AND SPECIFICATIONS.

NRCS REPRESENTATIVE _____	DATE _____	ENGINEER (IF REQUIRED) _____	DATE _____
---------------------------	------------	------------------------------	------------

ANIMAL MORTALITY FACILITY:

JOB CLASS: _____

HEAVY USE AREA:

JOB CLASS: _____

ROOFS AND COVERS:

JOB CLASS: _____

INDEX TO DRAWINGS:

- SHEET 1 - COVER SHEET
- SHEET 2 - PLAN VIEW
ELEVATION VIEW
FRONT VIEW
GENERAL NOTES
- SHEET 3 - ROOF FRAMING PLAN
- SHEET 4 - GIRDER AND RAFTER TO POST CONNECTIONS
HURRICANE STRAP
HURRICANE CLIP
- SHEET 5 - WOOD TREATMENT TABLE
STANDARD BIN FRONT-TOP VIEW
CONCRETE POST FOOTING DETAIL
MECHANICAL ANCHOR POST CONCRETE FOOTING DETAIL
FIBER REINFORCED CONTRACTION JOINT



REVISIONS		
DATE	APPROVED	TITLE
09/05	H MCFARLAND	STATE ENGINEER
01/06	H MCFARLAND	STATE ENGINEER
09/07	H MCFARLAND	STATE ENGINEER
06/11	J HOLLOWAY	STATE ENGINEER
07/13	D ROBERTS	ACTING STATE ENGINEER
06/16	D GUTHRIE	STATE ENGINEER

Date _____	Date _____
Approved _____	Designed _____
Checked _____	Drawn _____
Designed (Length) _____	Checked _____
_____ W. Brown	_____ H. McFarland
_____ S. Rogers	_____ J. Holloway
_____ H. McFarland	_____ H. McFarland
_____ 09/07	_____ 09/07
_____ 09/07	_____ 09/07
_____ 09/07	_____ 09/07


**ANIMAL MORTALITY FACILITY
 Stand Alone Structure
 With Standard Composting Bins**




File No. ga-eng-316-c2_rev_062016

Drawing No. Cover

July 2013
 Sheet 1 of 5

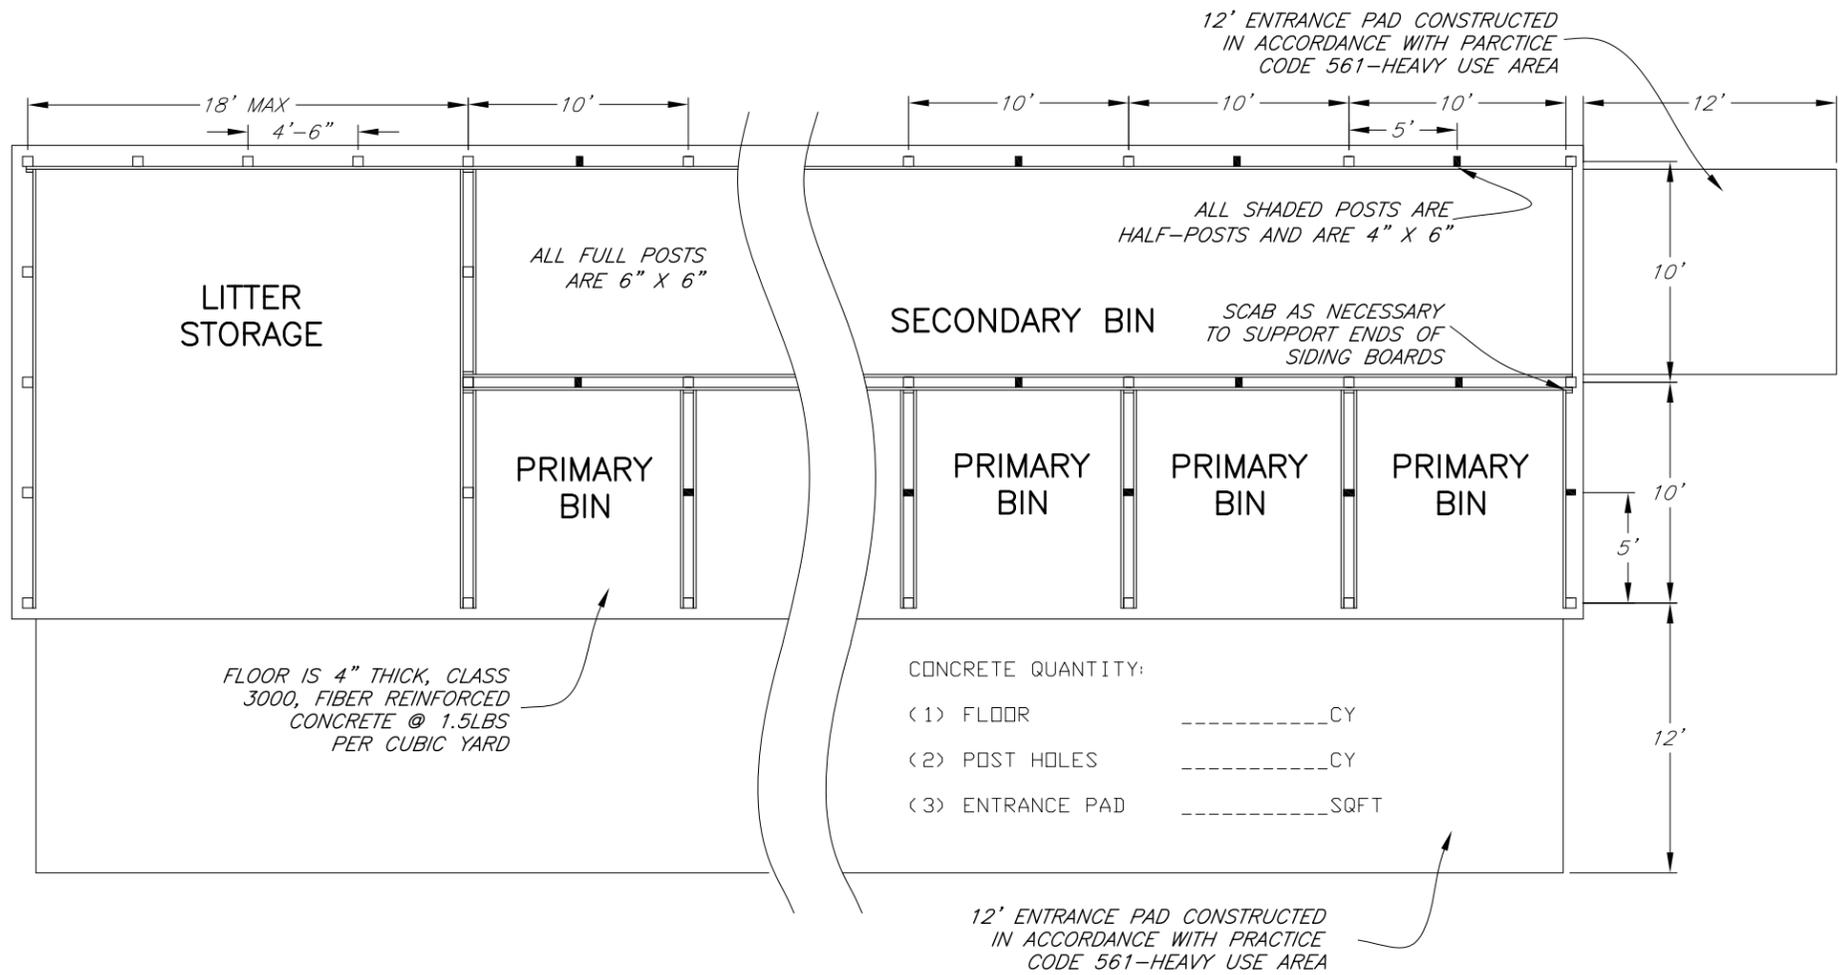


PLAN VIEW

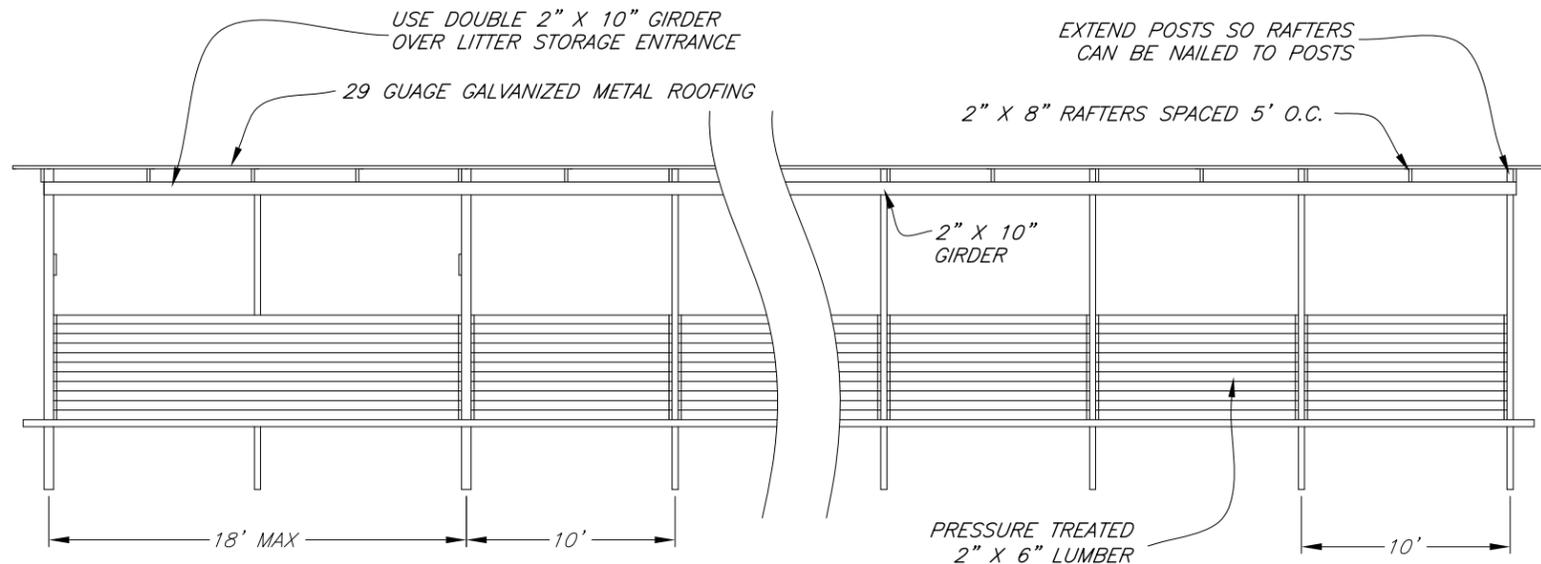

FRONT VIEW

NOTES:

1. ALL ENTRANCE AREAS SHALL BE STABILIZED USING PRACTICE STANDARD 561 - HEAVY USE AREA.
2. ALL POSTS SHALL BE SET IN CONCRETE WITH CONCRETE OR GRAVEL FOOTING PAD (SEE CONCRETE POST FOOTING DETAIL ON SHEET 5).
3. THE BUILDING SITE SHALL BE CLEARED AND GRUBBED AS REQUIRED. PROPER DRAINAGE SHALL BE PROVIDED AROUND THE ENTIRE BUILDING SO THAT RUNOFF WATER DOES NOT ENTER OR POND NEAR BUILDING. DESIGN FOR ROOF RUNOFF IN ACCORDANCE WITH PRACTICE CODE 558 - ROOF RUNOFF MANAGEMENT OR STABILIZE SOIL AROUND BUILDING USING PRACTICE CODE 342 - CRITICAL AREA PLANTING.
4. CONCRETE FLOORS AND FOOTINGS SHALL BE PLACED ON FIRM SOIL. ALL LOOSE SOIL SHALL BE REMOVED. IF FILL MATERIAL IS USED, PLACE IN 9" THICK LAYERS AND COMPACT WITH SHEEPSFOOT ROLLER OR OTHER EQUIVALENT COMPACTION METHOD.
5. ALL LUMBER, INCLUDING THE POSTS, IN CONTACT WITH LITTER, COMPOST, OR CONCRETE SHALL BE PRESSURE TREATED (SEE WOOD TREATMENT TABLE ON SHEET 5).
6. ALL DIMENSION LUMBER SHALL BE SOUTHERN PINE NO. 2 OR BETTER.
7. ALL NAILS, BOLTS AND OTHER CONNECTORS SHALL BE OF HOT-DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE, OR COPPER. NAILS SHALL HAVE SPIRALED OR RINGED (ANNULAR) SHANKS. ALL REFERENCES TO "GALVANIZED" IN THIS SET OF DRAWINGS REFERS TO THE ABOVE LISTED COATINGS.
8. ROOFING SHALL BE 29 GAUGE GALVANIZED METAL. SEALANT SHALL BE APPLIED TO ALL LAPS.
9. ON SITE WATER SOURCE IS NECESSARY TO MAINTAIN MOISTURE CONTENT OF COMPOST.
10. ALL DISTURBED AREAS SHALL BE VEGETATED USING PRACTICE CODE 342 - CRITICAL AREA PLANNING.
11. CALL BEFORE YOU DIG: 811, 1-800-282-7411 OR 770-623-4344.

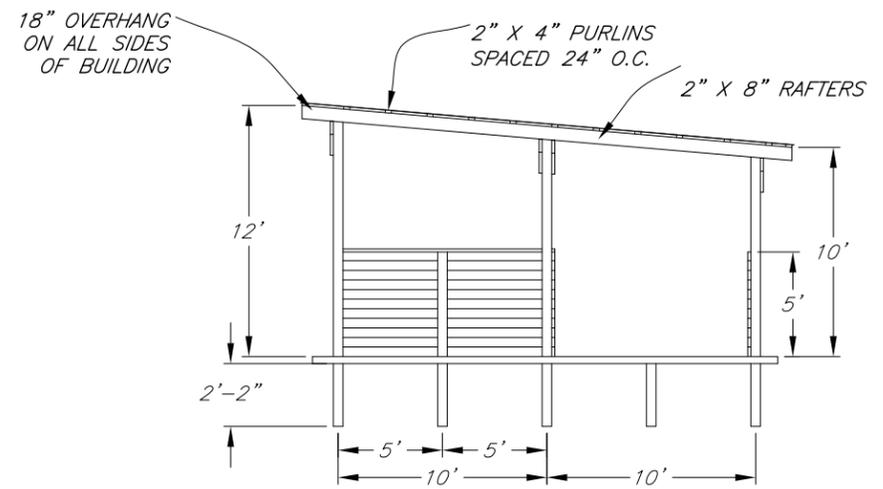

ELEVATION VIEW

Date	09/07
Designed	W. Brown
Drawn	S. Rogers
Checked	H. McFarland
Approved	J. Holloway
	H. McFarland

ANIMAL MORTALITY FACILITY
Stand Alone Structure
With Standard Composting Bins




File No.
ga-eng-316-c2_rev_062016

Drawing No.
Plan & Elevation

July 2013
Sheet 2 of 5

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
09/07	H. MCFARLAND	STATE ENGINEER
07/13	D. ROBERTS	ACTING STATE ENGINEER

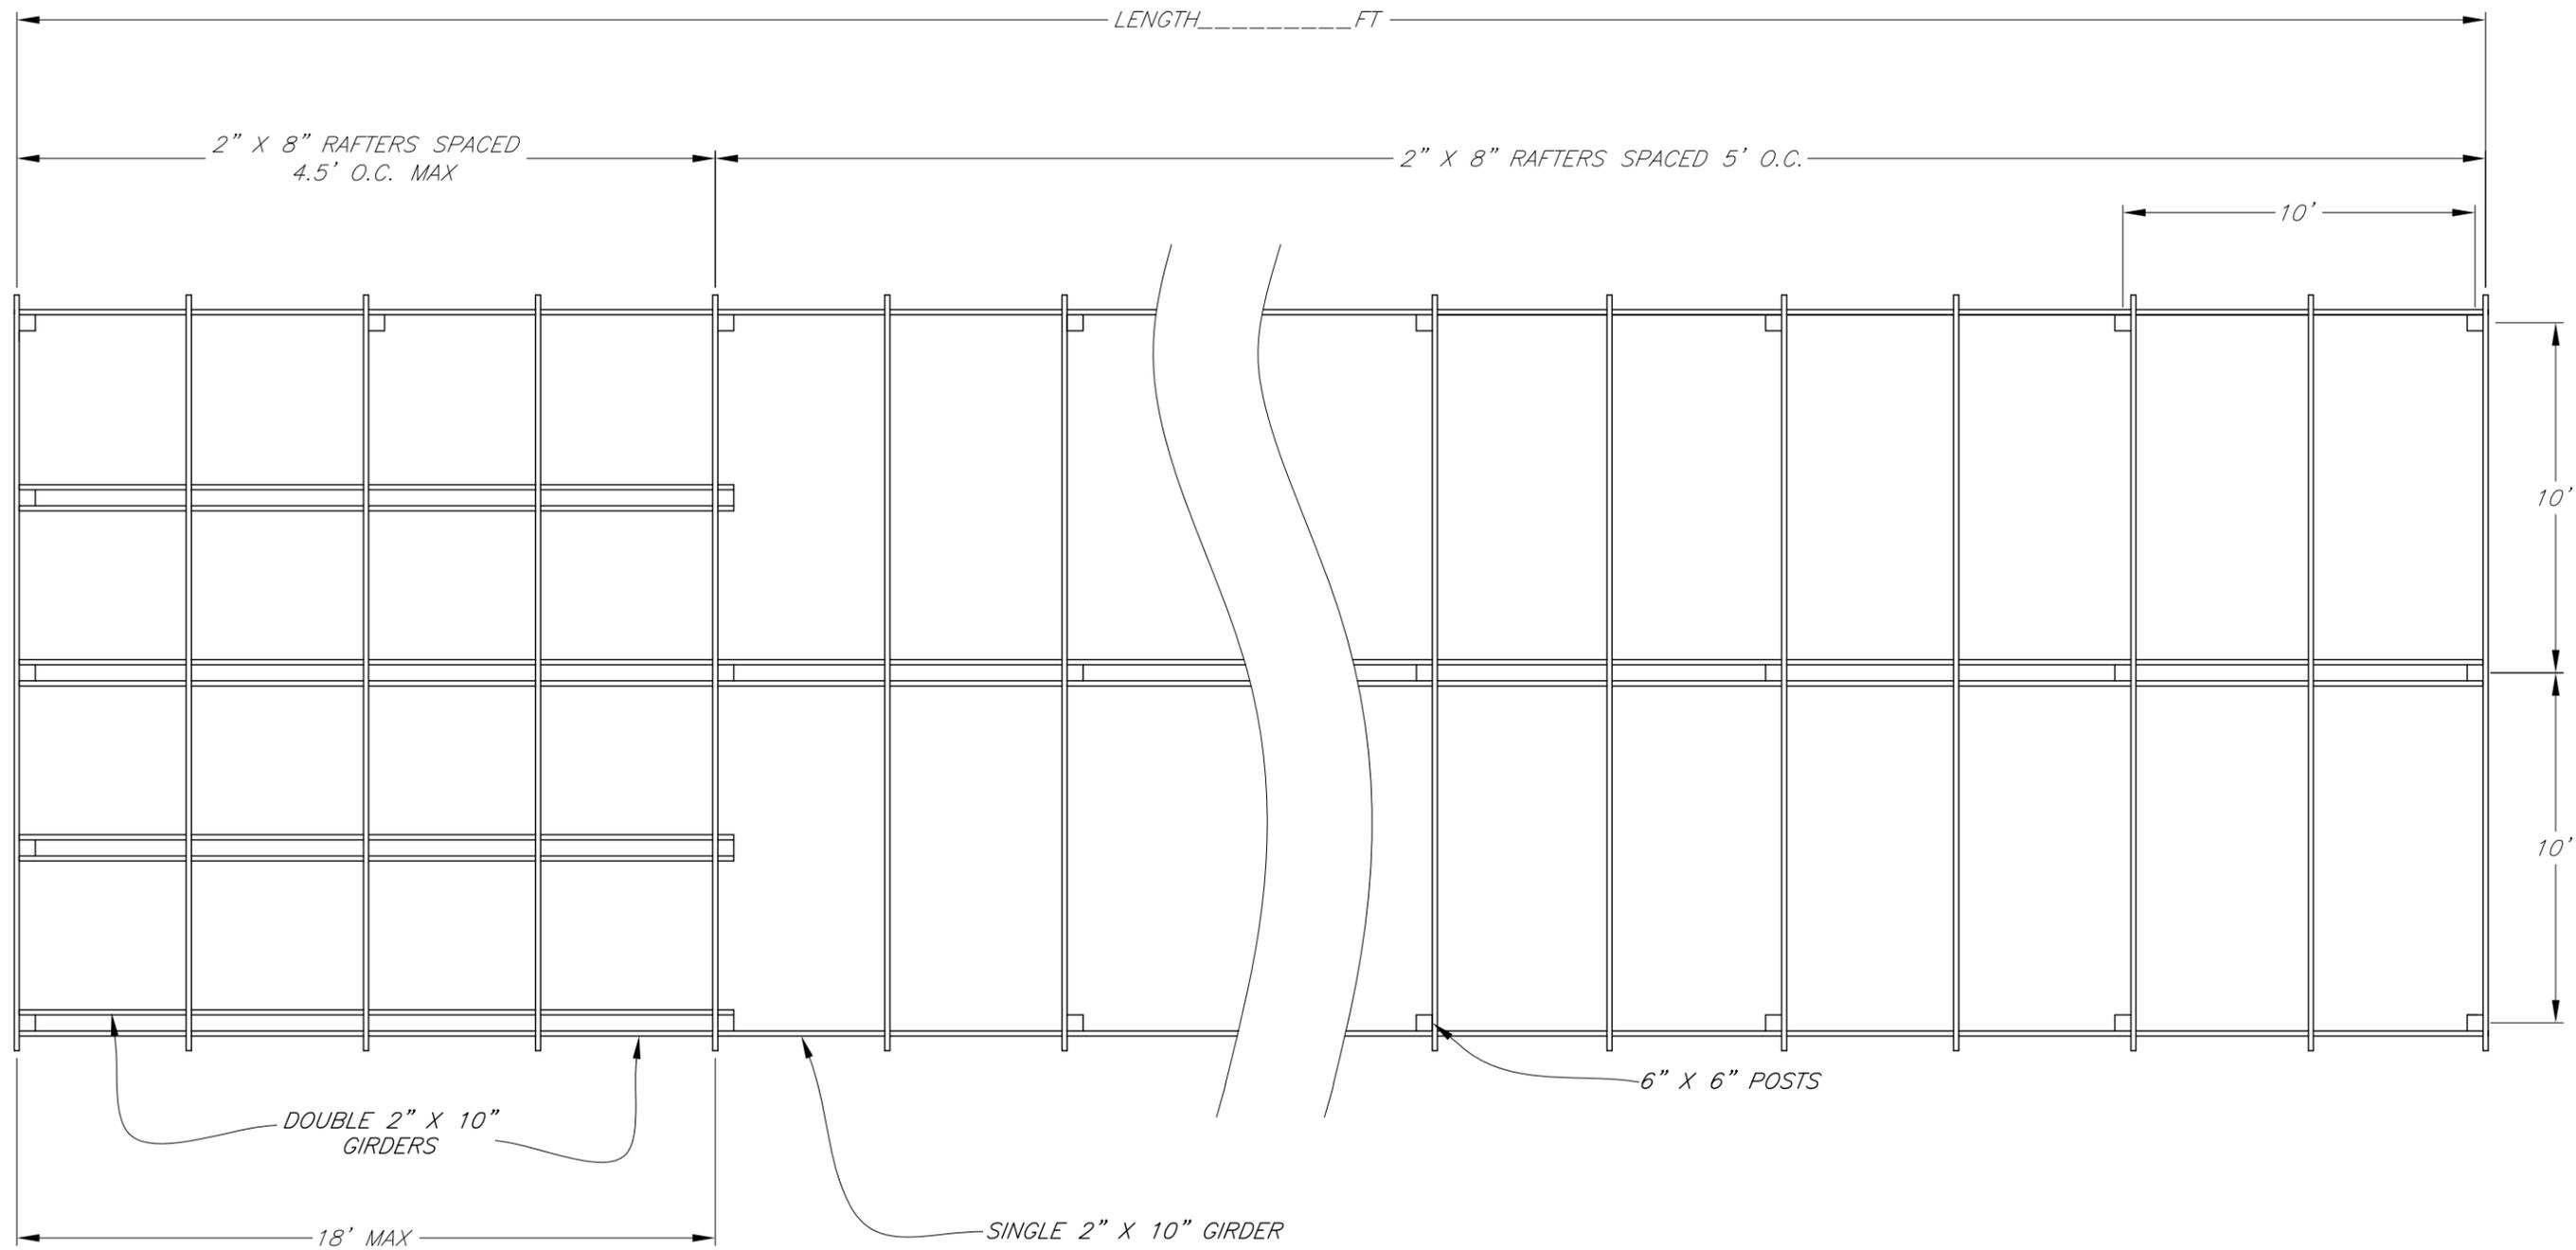

ROOF FRAMING PLAN

Designed	W. Brown	Date	09/07
Drawn	S. Rogers H. McFarland	Date	09/07
Checked	J. Holloway	Date	09/07
Approved	H. McFarland	Date	09/07

ANIMAL MORTALITY FACILITY
 Stand Alone Structure
 With Standard Composting Bins




File No.
ga-eng-316-c2_rev_062016


Drawing No.
Roof Plan

July 2013
Sheet 3 of 5

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
09/07	H. MCFARLAND	STATE ENGINEER
07/13	D. ROBERTS	ACTING STATE ENGINEER

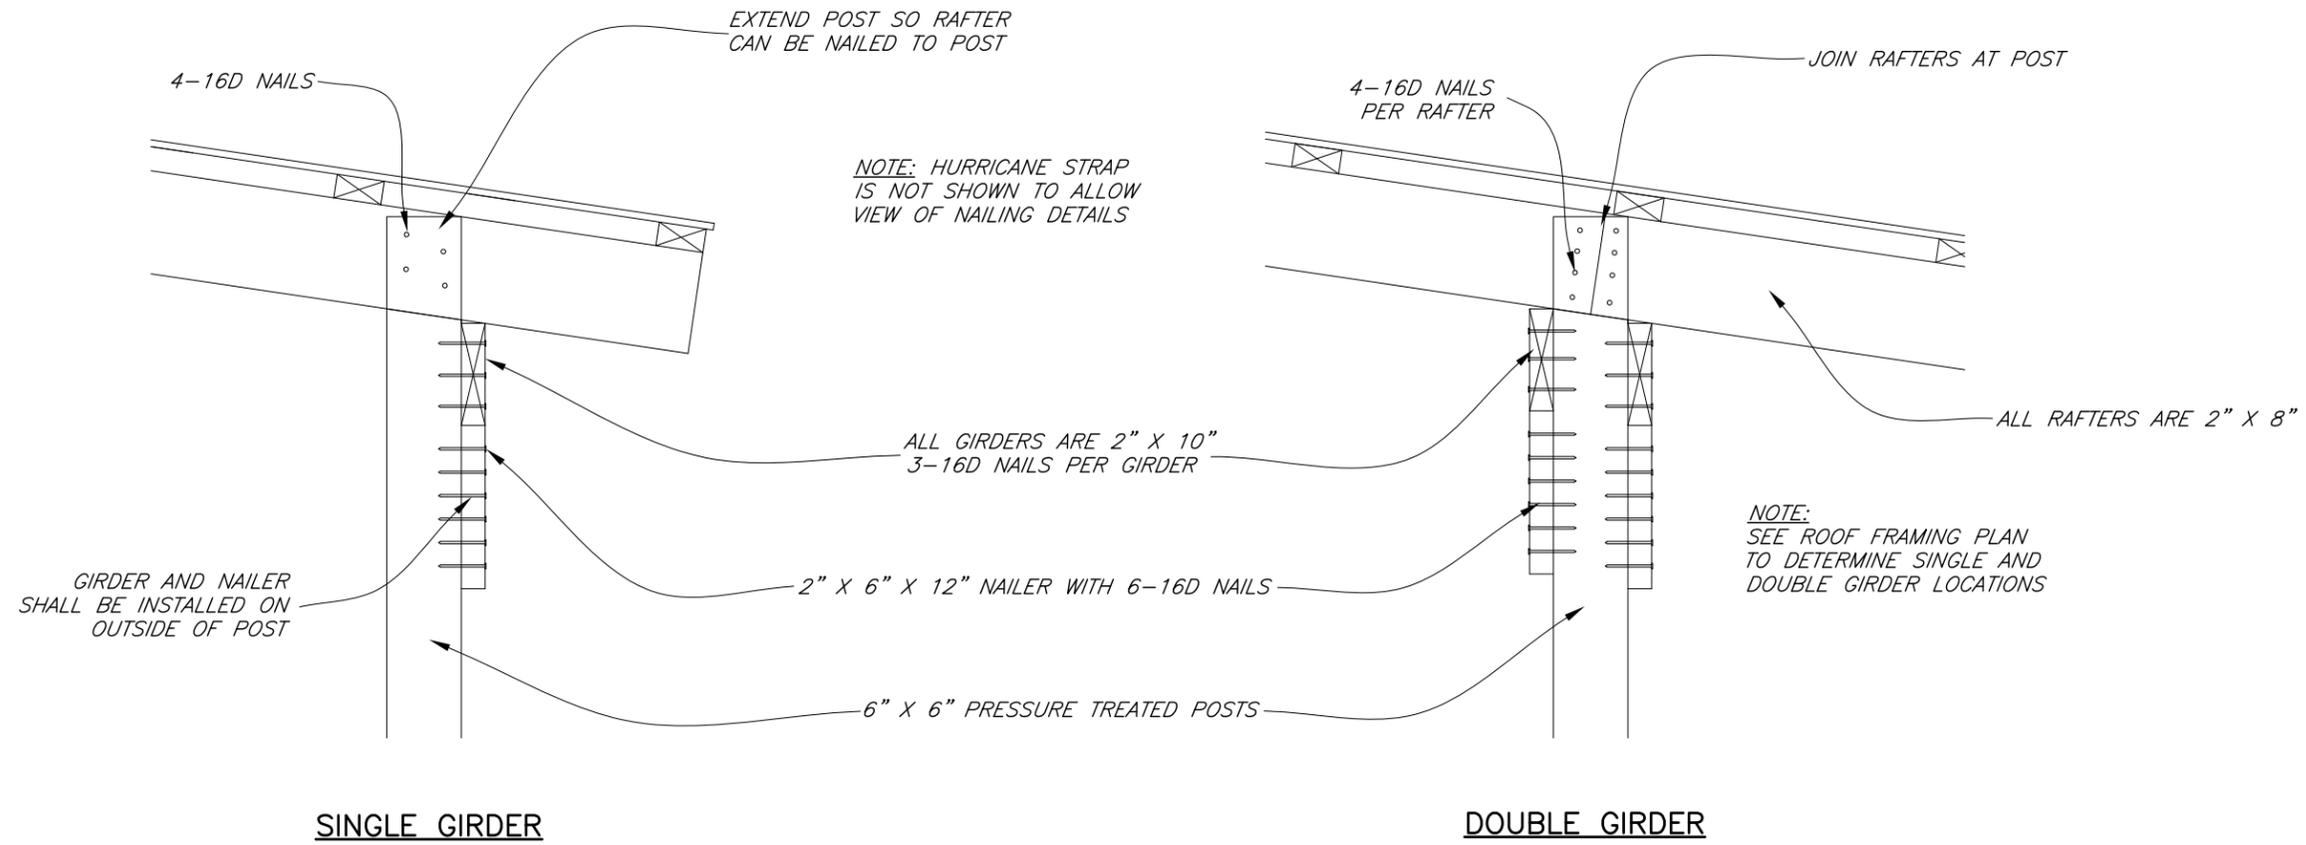


GIRDER AND RAFTER TO POST CONNECTIONS

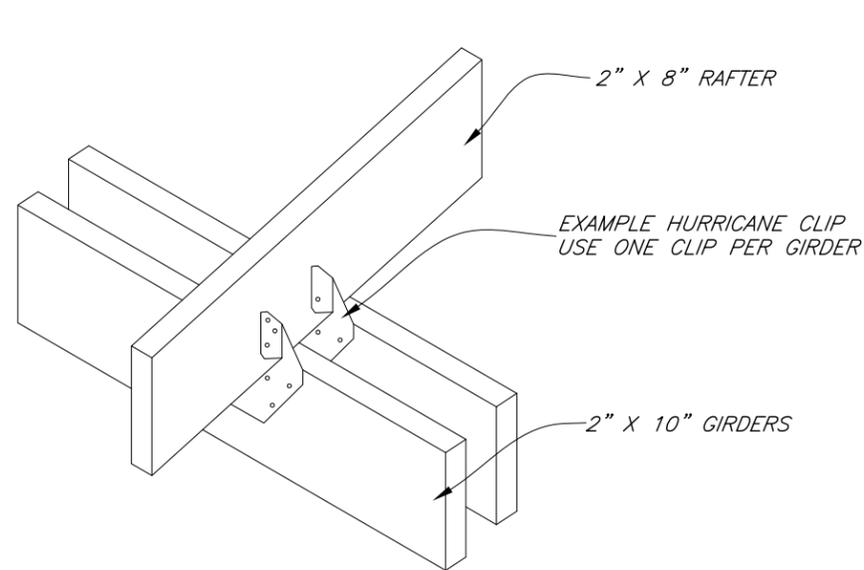

HURRICANE CLIP
(USE AT RAFTER TO GIRDER CONNECTIONS WITHOUT POSTS)

NOTES:

1. MINIMUM UPLIFT RESISTANCE FOR HURRICANE STRAP IS 746 LBS.
2. STRAP SHALL BE 2" OR WIDER. CENTER STRAP ON RAFTER TO RAFTER BUTT JOINTS ON CENTER POSTS.
3. USE MANUFACTURED HURRICANE CLIP FOR RAFTER TO GIRDER CONNECTIONS (WITHOUT POSTS). MINIMUM UPLIFT RESISTANCE IS 251 LBS PER CLIP. AN EXAMPLE IS SHOWN AT LEFT. INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

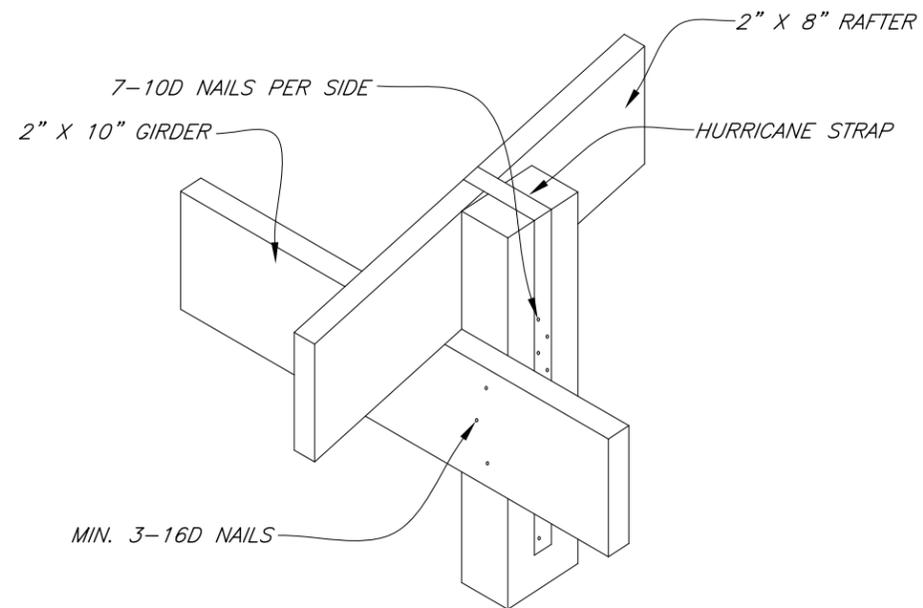

HURRICANE STRAP
(USE AT RAFTER TO GIRDER CONNECTIONS WITH POSTS)

Date	09/07
Designed	W. Brown
Drawn	S. Rogers
Checked	H. McFarland
Approved	J. Holloway
	H. McFarland

ANIMAL MORTALITY FACILITY
Stand Alone Structure
With Standard Composting Bins




File No.
ga-eng-316-c2_rev_062016

Drawing No.
Detail 1

July 2013
Sheet 4 of 5

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
09/07	H. MCFARLAND	STATE ENGINEER
07/13	D. ROBERTS	ACTING STATE ENGINEER

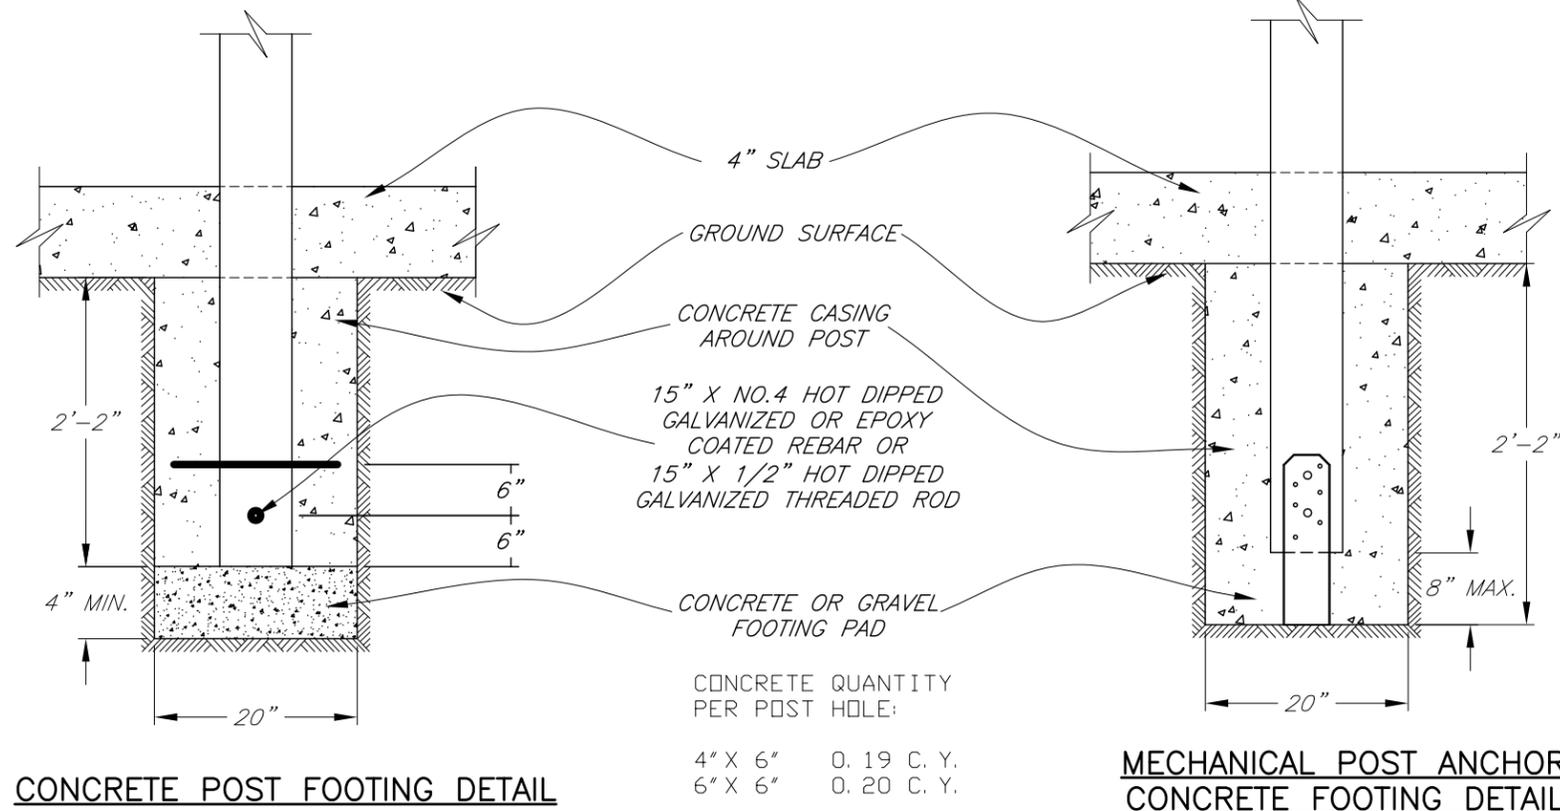


CONCRETE POST FOOTING DETAIL

MECHANICAL POST ANCHOR CONCRETE FOOTING DETAIL


CONCRETE QUANTITY PER POST HOLE:
 4" X 6" 0.19 C. Y.
 6" X 6" 0.20 C. Y.

NOTES:

1. EXAMPLE CONNECTOR SHOWN AT LEFT.
2. MINIMUM UPLIFT RESISTANCE REQUIRED IS 1574 LBS.
3. INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
4. CONNECTOR SHALL BE GALVANIZED.
5. MECHANICAL POST ANCHOR MAY BE USED INSTEAD OF REBAR.
6. REBAR OR MECHANICAL POST ANCHOR REQUIRED FOR FULL POSTS ONLY.

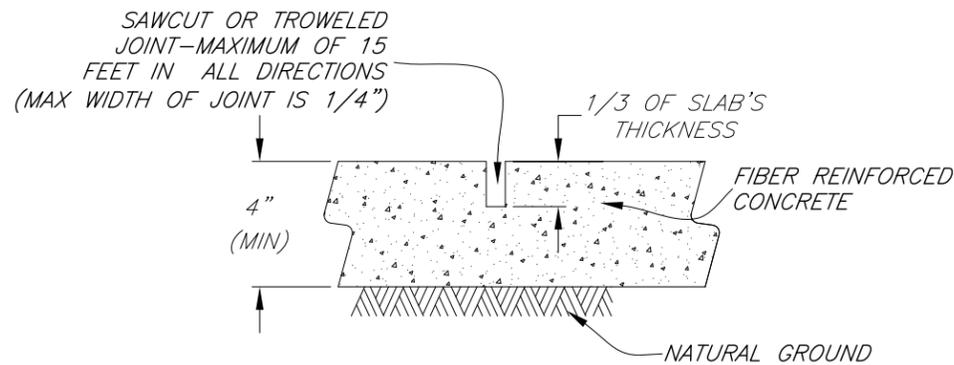

FIBER REINFORCED CONTRACTION JOINT

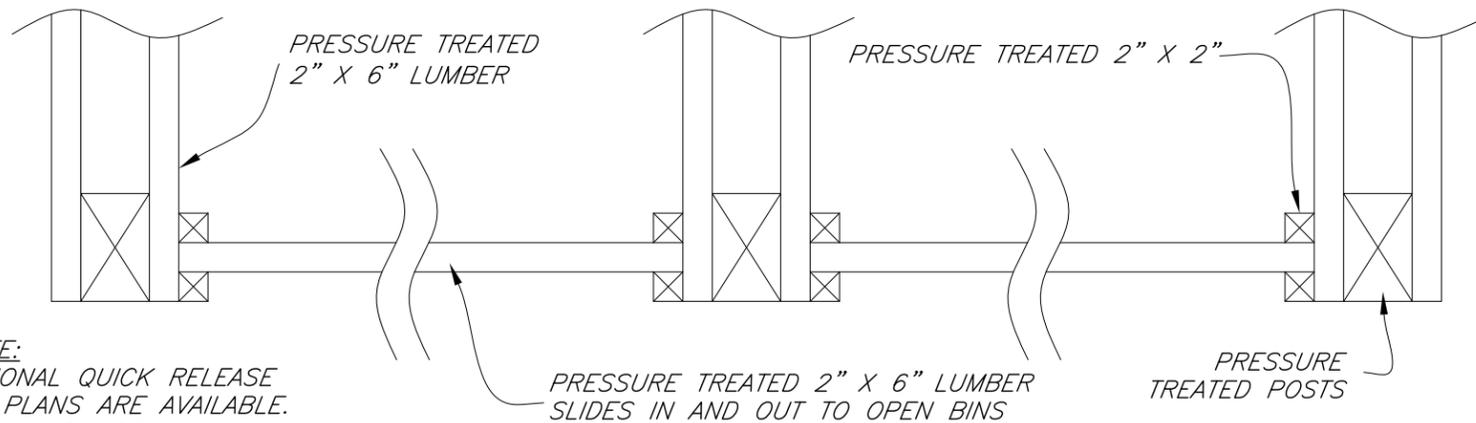

STANDARD BIN FRONT - TOP VIEW

NOTE:
 OPTIONAL QUICK RELEASE BIN PLANS ARE AVAILABLE. SEE YOUR NRCS REPRESENTATIVE FOR DETAILS.

WOOD TREATMENT TABLE

USE	MINIMUM RETENTION RATES IN PCF				
	CCA	ACQ-C/D	CBA-A	CA-B	MCA
GROUND CONTACT OR FRESH WATER	0.40	0.40	0.41	0.21	0.15
IMPORTANT STRUCTURAL MEMBERS	0.60	0.60	0.61	0.31	0.23

CCA - CHROMATED COPPER ARSENATE
 ACQ-C/D - ALKALINE COPPER QUATERNARY
 CBA-A & CA-B - COPPER AZOLE
 MCA - MICRONIZED COPPER AZOLE

NOTES:

1. ALL WOODEN WALLS, HALF POSTS, AND BIN FRONT WOOD SHALL MEET THE GROUND CONTACT RATES.
2. ALL SUPPORT POSTS SHALL MEET THE IMPORTANT STRUCTURAL MEMBER RATES.

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
09/07	H. MCFARLAND	STATE ENGINEER
10/10	J. HOLLOWAY	STATE ENGINEER
07/13	D. ROBERTS	ACTING STATE ENGINEER

Date	Designed	Drawn	Checked	Approved
09/07	W. Brown	S. Rogers	J. Holloway	H. McFarland
09/07		H. McFarland		
09/07				

ANIMAL MORTALITY FACILITY
 Stand Alone Structure
 With Standard Composting Bins



File No.
ga-eng-316-c2_rev_062016

Drawing No.
Detail 2

July 2013
Sheet 5 of 5