


**COMPOST FACILITY
 GEORGIA STANDARD DRAWINGS, STAND ALONE STRUCTURE
 20' WIDE, DEEP COMPOSTING BIN
 6" X 6" POST CONSTRUCTION**

- THE FOLLOWING DRAWINGS WERE PREPARED IN ACCORDANCE WITH PRACTICE CODES 317 – COMPOSTING FACILITY, 561 – HEAVY USE AREA, 367 – ROOFS AND COVERS, AND GEORGIA BUILDING CODE (INTERNATIONAL BUILDING CODE 2006)
- DESIGN DATA REQUIRED BY IBC 2006:
 - ROOF LIVE LOAD – 20 PSF.
 - BASIC WIND SPEED OF 90 MPH AND GROUND SNOW LOAD OF 10 PSF OR BASIC WIND SPEED OF 100 MPH AND NO SNOW LOAD.
 - IMPORTANCE FACTOR, I=0.87
 - WIND EXPOSURE CATEGORY C.
 - INTERNAL PRESSURE COEFFICIENT = 0.55
- THIS DESIGN IS NOT INTENDED FOR USE IN EXTREME SOUTH AND EAST COUNTIES OF THE STATE THAT ARE SUBJECT TO HURRICANE WIND LOADS (SEE MAP BELOW)
- THIS DESIGN IS NOT INTENDED FOR CONSTRUCTION ON AN ISOLATED HILL, RIDGE, OR ESCARPMENT IN ANY REGION OF THE STATE.
- ANY CHANGES TO THESE DRAWINGS MUST BE APPROVED BY AN ENGINEER WITH JOB APPROVAL LEVEL IV OR GREATER.
- NO ADDITIONS SHOULD BE MADE TO STRUCTURE WITHOUT APPROVAL FROM NRCS.
- THESE DRAWINGS MUST BE SITE SPECIFIC TO ACCOUNT FOR WASTE PRODUCTION VALUES; LENGTH MUST BE DETERMINED.

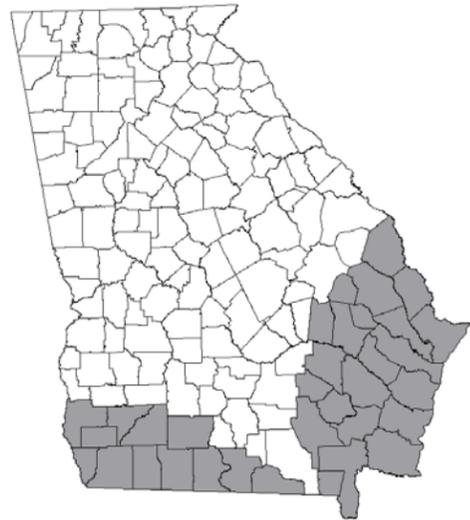

SITE LOCATION MAP

THIS DESIGN IS NOT INTENDED FOR USE IN COUNTIES SUBJECT TO HURRICANE WIND LOADS SHADED GRAY ABOVE.

**UNITED STATES DEPARTMENT OF AGRICULTURE
 THE NATURAL RESOURCES CONSERVATION SERVICE
 HELPING PEOPLE HELP THE LAND**

**COMPOST FACILITY
 COUNTY, GEORGIA**

PRE-CONSTRUCTION CERTIFICATION:

THE _____ COMPOSTING FACILITY HAS BEEN CONSTRUCTED IN ACCORDANCE WITH THE FOLLOWING DRAWINGS AND PRACTICE CODES 317, 367, AND 561. ALL CHANGES HAVE BEEN APPROVED BY AN ENGINEER WITH JOB APPROVAL AUTHORITY LEVEL IV OR GREATER. ALL ADDITIONS HAVE BEEN APPROVED BY NRCS.

OWNER	DATE	NRCS REPRESENTATIVE	DATE	ENGINEER (IF REQUIRED)	DATE
-------	------	---------------------	------	------------------------	------

AS-BUILT CERTIFICATION:

THIS PRACTICE HAS BEEN CONSTRUCTED IN ACCORDANCE TO THESE PLANS AND MEETS NRCS STANDARDS AND SPECIFICATIONS.

NRCS REPRESENTATIVE	DATE	ENGINEER (IF REQUIRED)	DATE
---------------------	------	------------------------	------

COMPOSTING FACILITY:

JOB CLASS: _____

HEAVY USE AREA:

JOB CLASS: _____

ROOFS AND COVERS:

JOB CLASS: _____

INDEX TO DRAWINGS:

- SHEET 1 - COVER SHEET
- SHEET 2 - PLAN VIEW
ELEVATION VIEW
FRONT VIEW
GENERAL NOTES
- SHEET 3 - ROOF FRAMING PLAN
- SHEET 4 - GIRDER AND RAFTER TO POST CONNECTIONS
HURRICANE STRAP
HURRICANE CLIP
- SHEET 5 - WOOD TREATMENT TABLE
FIBER REINFORCED CONTRACTION JOINT
CONCRETE POST FOOTING DETAIL
MECHANICAL ANCHOR POST CONCRETE FOOTING DETAIL



REVISIONS		
DATE	APPROVED	TITLE
09/05	H MCFARLAND	STATE ENGINEER
01/06	H MCFARLAND	STATE ENGINEER
07/07	H MCFARLAND	STATE ENGINEER
06/11	J HOLLOWAY	STATE ENGINEER
07/13	D ROBERTS	ACTING STATE ENGINEER
06/16	D GUTHRIE	STATE ENGINEER

**COMPOSTING FACILITY
 Stand Alone Structure
 With Deep Composting Bins**




File No. ga-eng-317-c1_rev_062016


Drawing No. Cover

July 2013
 Sheet 1 of 5


Approved	_____	Date	_____
Checked	_____	Date	_____
Designed (Length)	_____	Date	_____
Designed	W. Brown	Date	07/07
Drawn	S. Rogers	Date	07/07
Checked	H. McFarland	Date	07/07
Approved	H. McFarland	Date	07/07

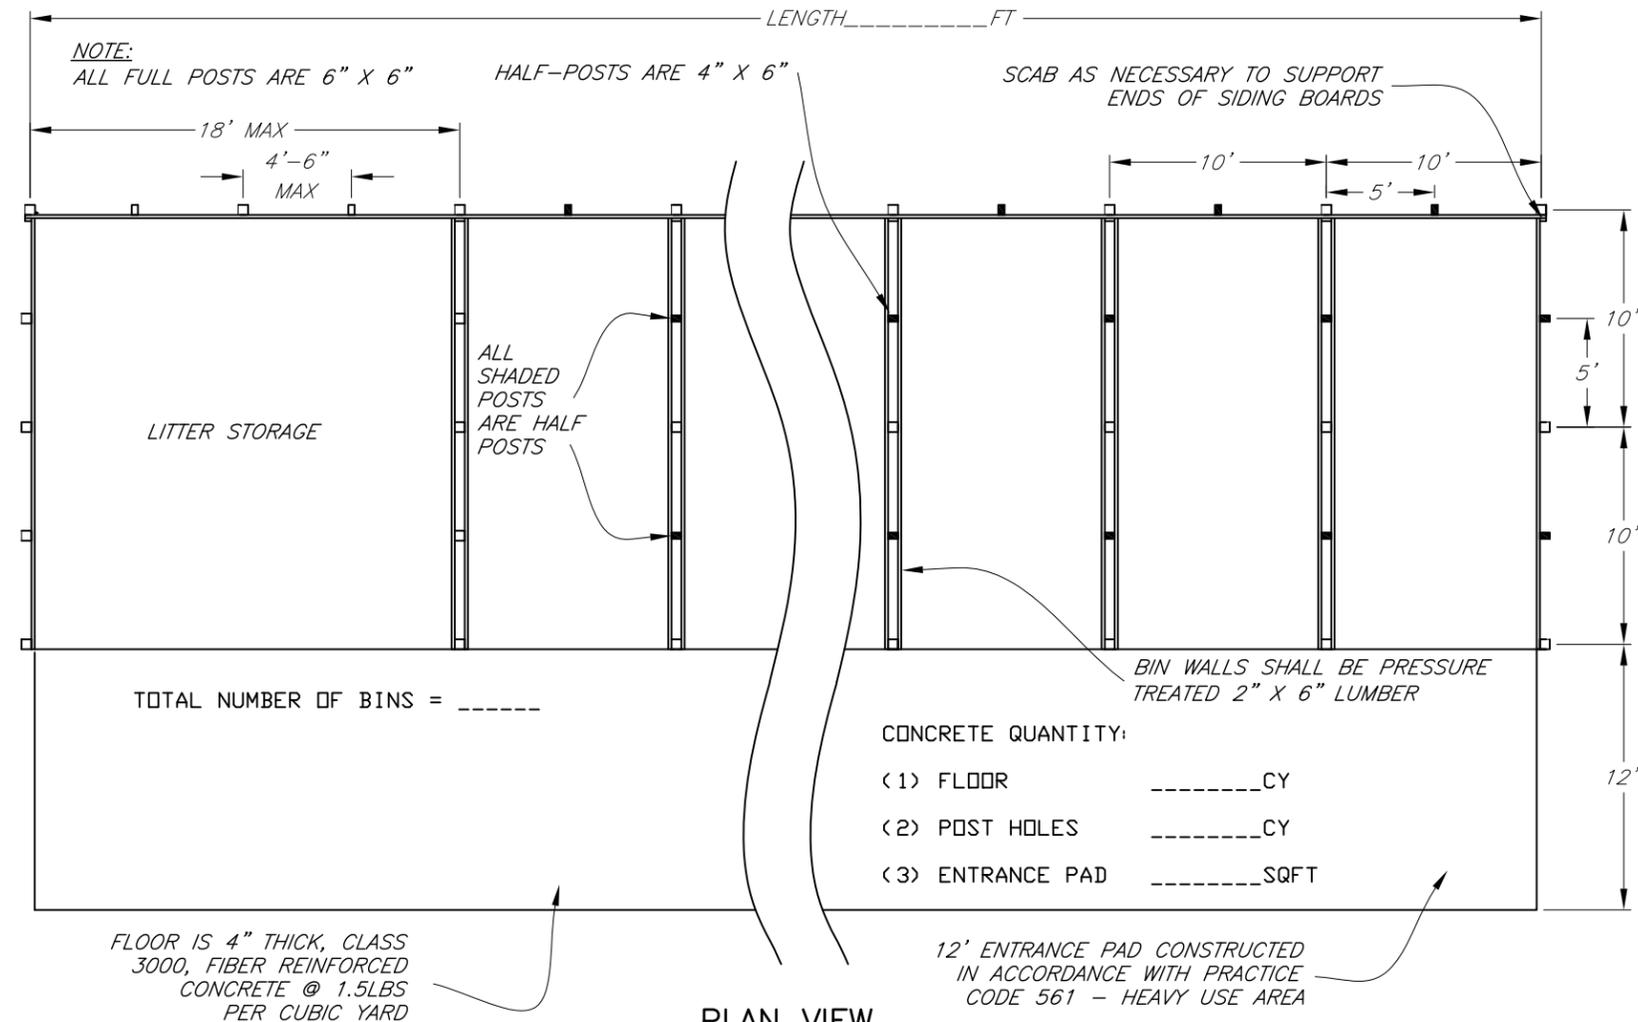

PLAN VIEW

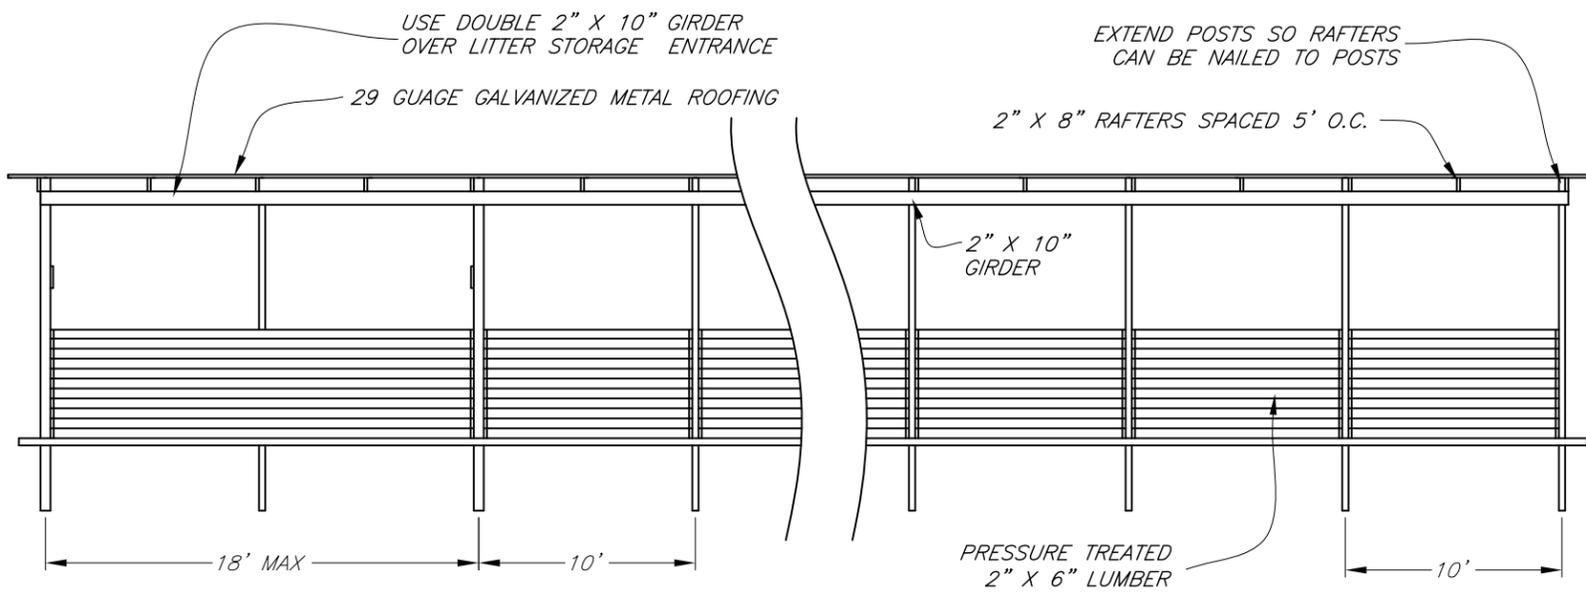

FRONT VIEW

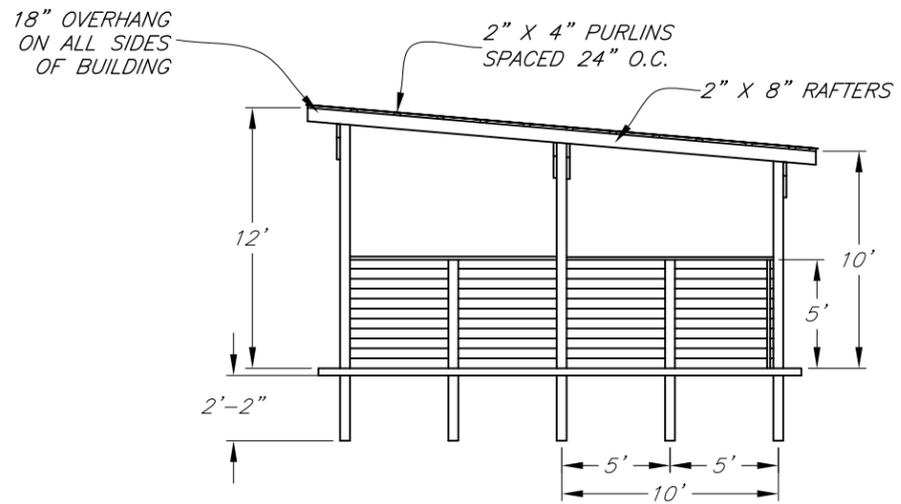

ELEVATION VIEW

NOTES:

- ALL ENTRANCE AREAS SHALL BE STABILIZED USING PRACTICE STANDARD 561 - HEAVY USE AREA.
- ALL POSTS SHALL BE SET IN CONCRETE WITH CONCRETE OR GRAVEL FOOTING PAD (SEE CONCRETE POST FOOTING DETAIL ON SHEET 5).
- THE BUILDING SITE SHALL BE CLEARED AND GRUBBED AS REQUIRED. PROPER DRAINAGE SHALL BE PROVIDED AROUND THE ENTIRE BUILDING SO THAT RUNOFF WATER DOES NOT ENTER OR POND NEAR BUILDING. DESIGN FOR ROOF RUNOFF IN ACCORDANCE WITH PRACTICE CODE 558 - ROOF RUNOFF MANAGEMENT OR STABILIZE SOIL AROUND BUILDING USING PRACTICE CODE 342 - CRITICAL AREA PLANTING.
- CONCRETE FLOORS AND FOOTINGS SHALL BE PLACED ON FIRM SOIL. ALL LOOSE SOIL SHALL BE REMOVED. IF FILL MATERIAL IS USED, PLACE IN 9" THICK LAYERS AND COMPACT WITH SHEEPSFOOT ROLLER OR OTHER EQUIVALENT COMPACTION METHOD.
- ALL LUMBER, INCLUDING THE POSTS, IN CONTACT WITH LITTER, COMPOST, OR CONCRETE SHALL BE PRESSURE TREATED (SEE WOOD TREATMENT TABLE ON SHEET 5).
- ALL DIMENSION LUMBER SHALL BE SOUTHERN PINE NO. 2 OR BETTER.
- ALL NAILS, BOLTS AND OTHER CONNECTORS SHALL BE OF HOT-DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE, OR COPPER. NAILS SHALL HAVE SPIRALED OR RINGED (ANNULAR) SHANKS. ALL REFERENCES TO "GALVANIZED" IN THIS SET OF DRAWINGS REFERS TO THE ABOVE LISTED COATINGS.
- ROOFING SHALL BE 29 GAUGE GALVANIZED METAL. SEALANT SHALL BE APPLIED TO ALL LAPS.
- ON SITE WATER SOURCE IS NECESSARY TO MAINTAIN MOISTURE CONTENT OF COMPOST.
- CALL BEFORE YOU DIG: 811, 1-800-282-7411 OR 770-623-4344.

Date	07/07
Designed	W. Brown
Drawn	S. Rogers H. McFarland
Checked	J. Holloway
Approved	H. McFarland


COMPOSTING FACILITY
Stand Alone Structure
With Deep Composting Bins



File No.
ga-eng-317-c1_rev_062016

Drawing No.
Plan & Elevation


REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
07/07	H. MCFARLAND	STATE ENGINEER
07/13	D. ROBERTS	ACTING STATE ENGINEER

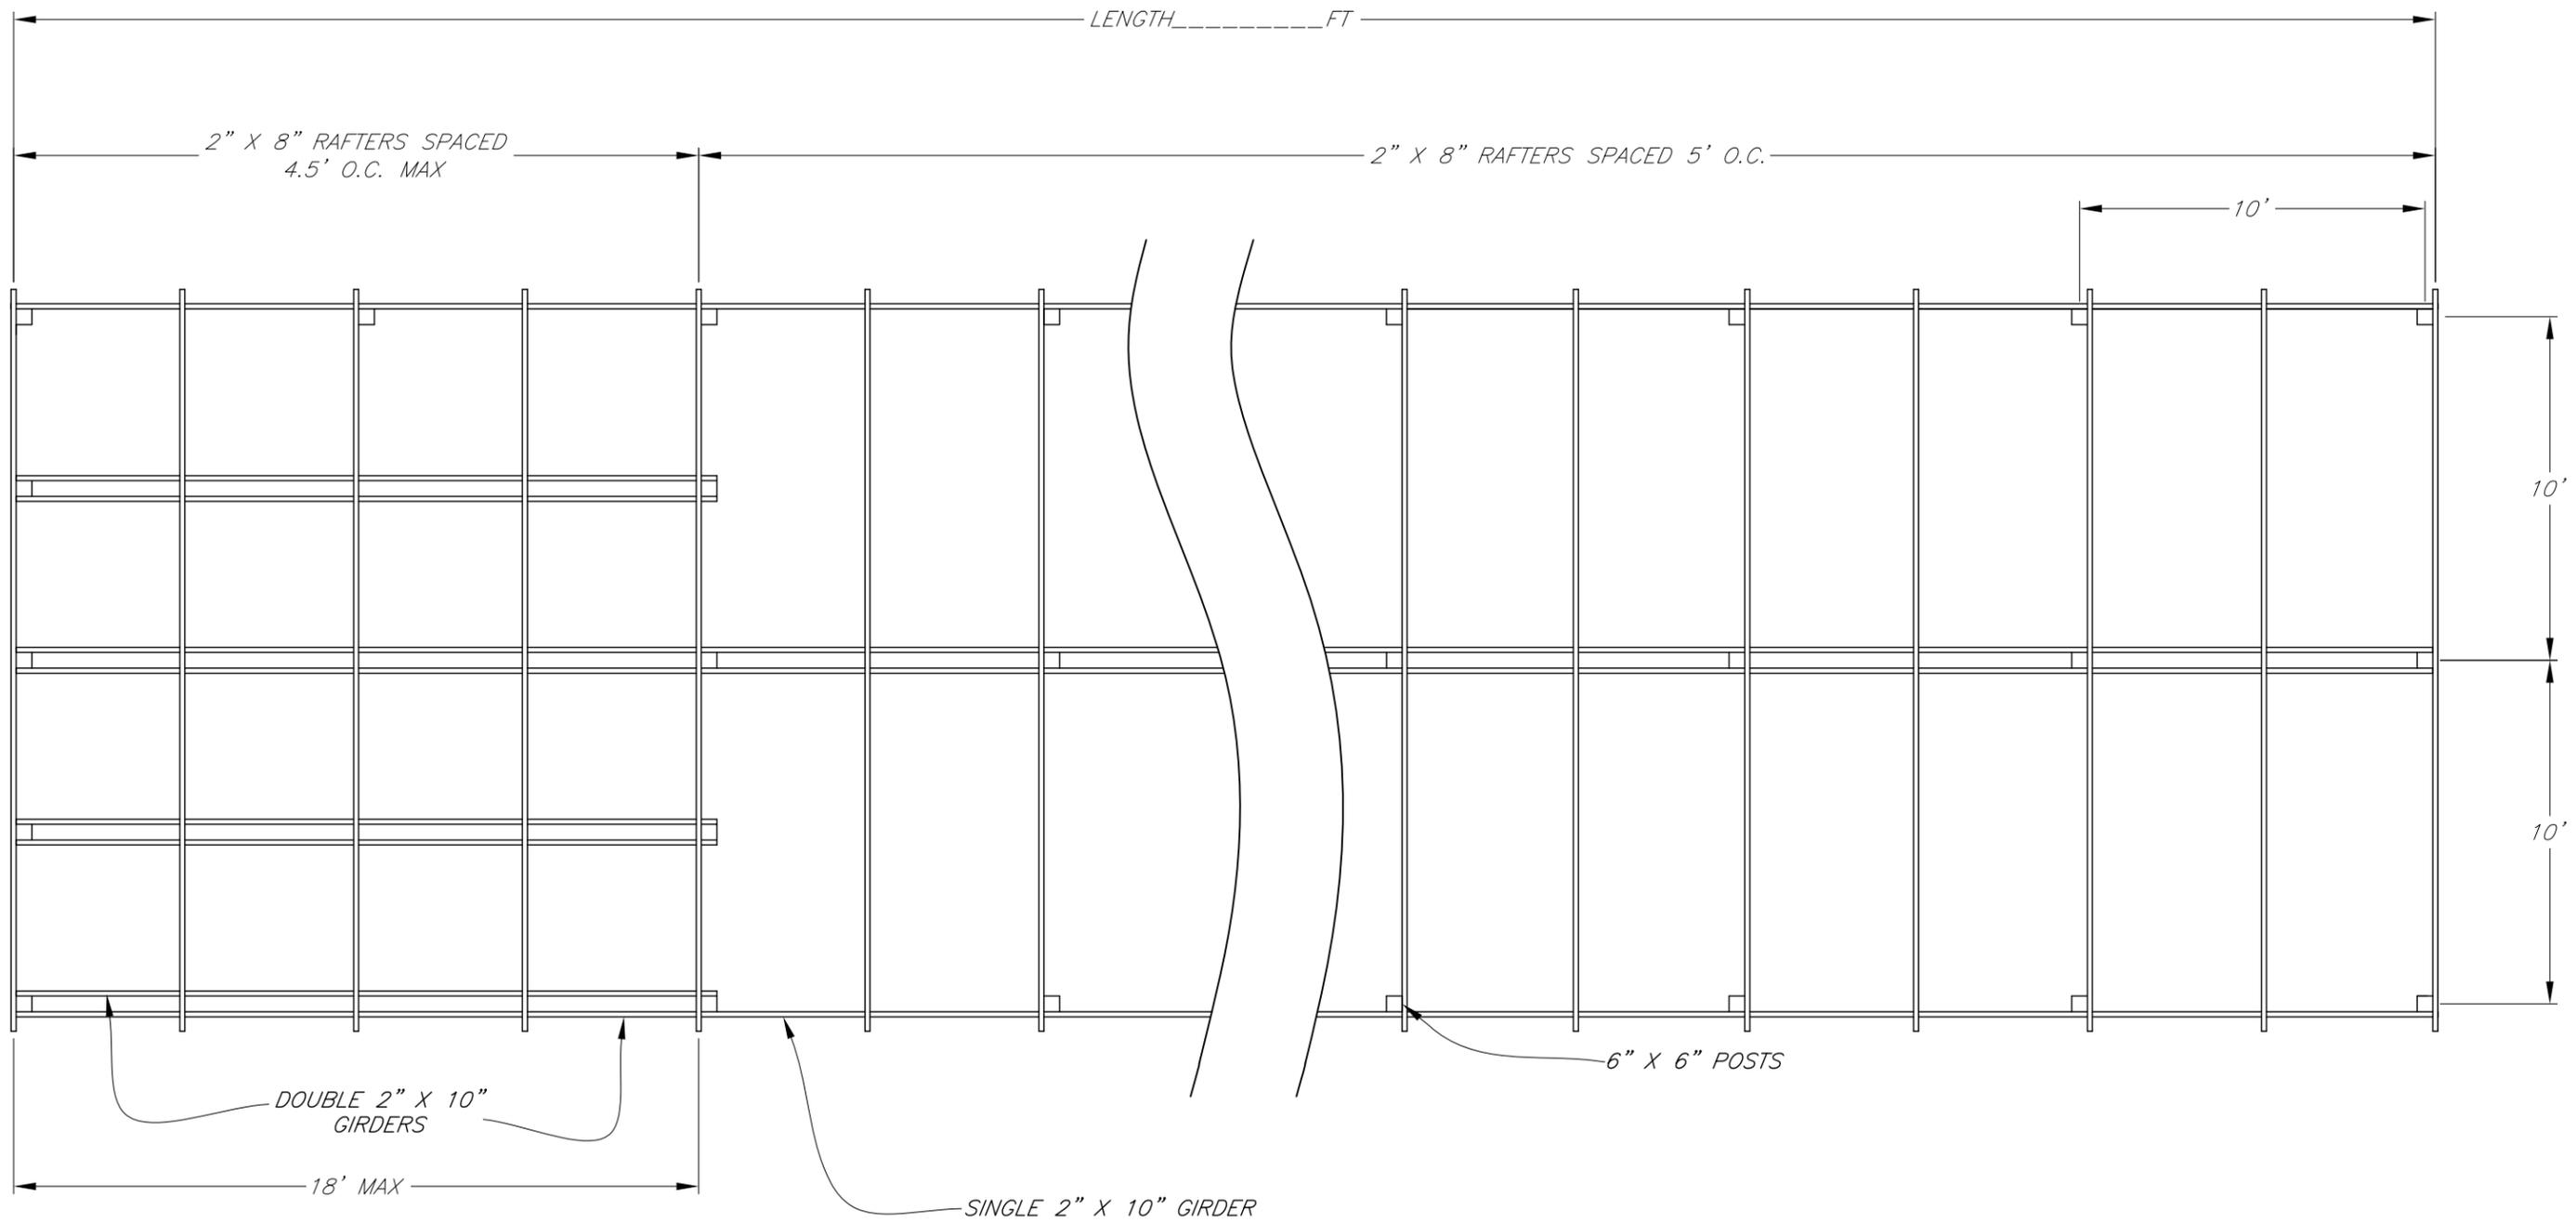

ROOF FRAMING PLAN

Date 07/07
 Designed W. Brown
 Drawn S. Rogers
 Checked H. McFarland
 Approved J. Holloway
 Date 07/07
 Drawn H. McFarland
 Checked J. Holloway
 Approved H. McFarland
 Date 07/07
 Drawn H. McFarland
 Checked J. Holloway
 Approved H. McFarland

COMPOSTING FACILITY
 Stand Alone Structure
 With Deep Composting Bins

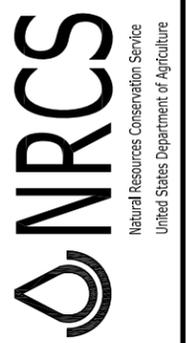


File No.
ga-eng-317-c1_rev_062016


Drawing No.
Roof Plan

01/07/2013
Sheet 3 of 5

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
07/07	H. MCFARLAND	STATE ENGINEER

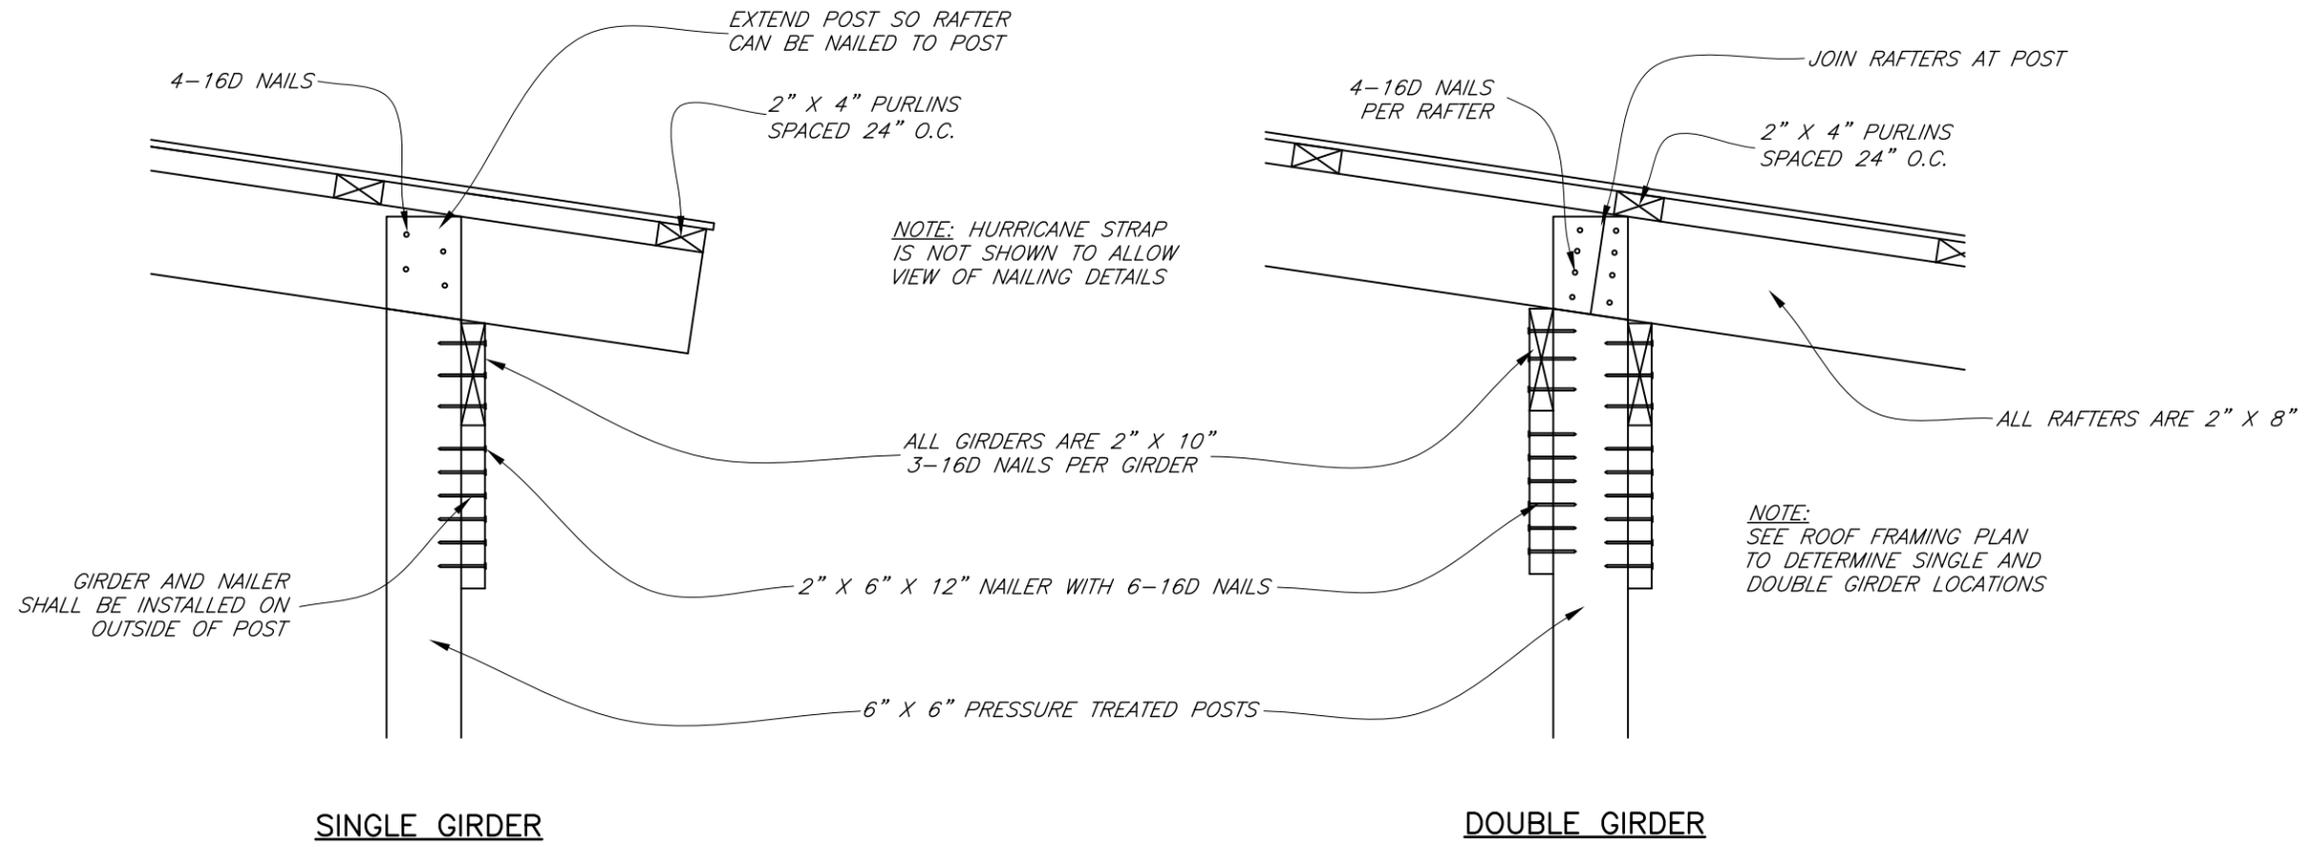


GIRDER AND RAFTER TO POST CONNECTIONS

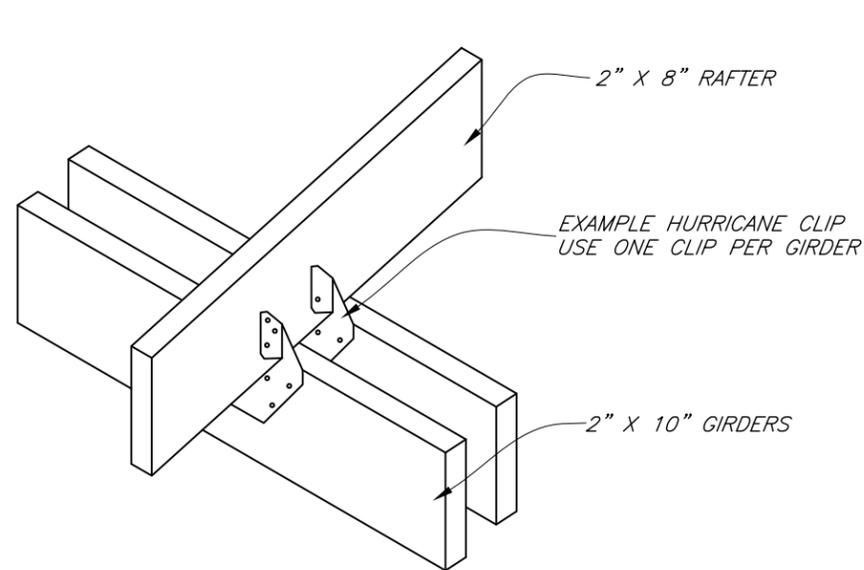

HURRICANE CLIP
(USE AT RAFTER TO GIRDER CONNECTIONS WITHOUT POSTS)

NOTES:

1. MINIMUM UPLIFT RESISTANCE FOR HURRICANE STRAP IS 746 LBS.
2. STRAP SHALL BE 2" OR WIDER. CENTER STRAP ON RAFTER TO RAFTER BUTT JOINTS ON CENTER POSTS.
3. USE MANUFACTURED HURRICANE CLIP FOR RAFTER TO GIRDER CONNECTIONS (WITHOUT POSTS). MINIMUM UPLIFT RESISTANCE IS 251 LBS PER CLIP. AN EXAMPLE IS SHOWN AT LEFT. INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

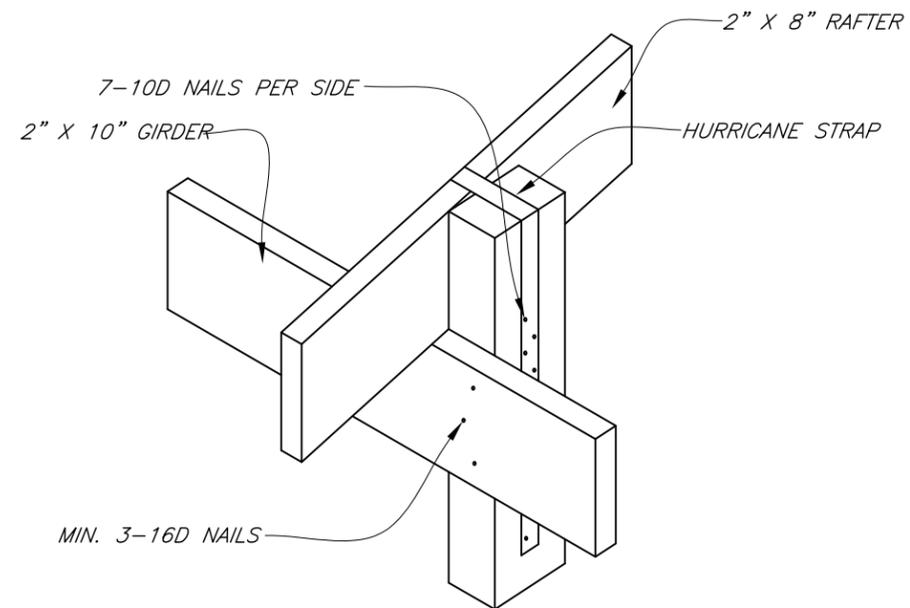

HURRICANE STRAP
(USE AT RAFTER TO GIRDER CONNECTIONS WITH POSTS)

Date	07/07
Designed	W. Brown
Drawn	S. Rogers
Checked	H. McFarland
Approved	J. Holloway
	H. McFarland


COMPOSTING FACILITY
Stand Alone Structure
With Deep Composting Bins



File No.
ga-eng-317-c1_rev_062016

Drawing No.
Detail 1

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
07/07	H. MCFARLAND	STATE ENGINEER

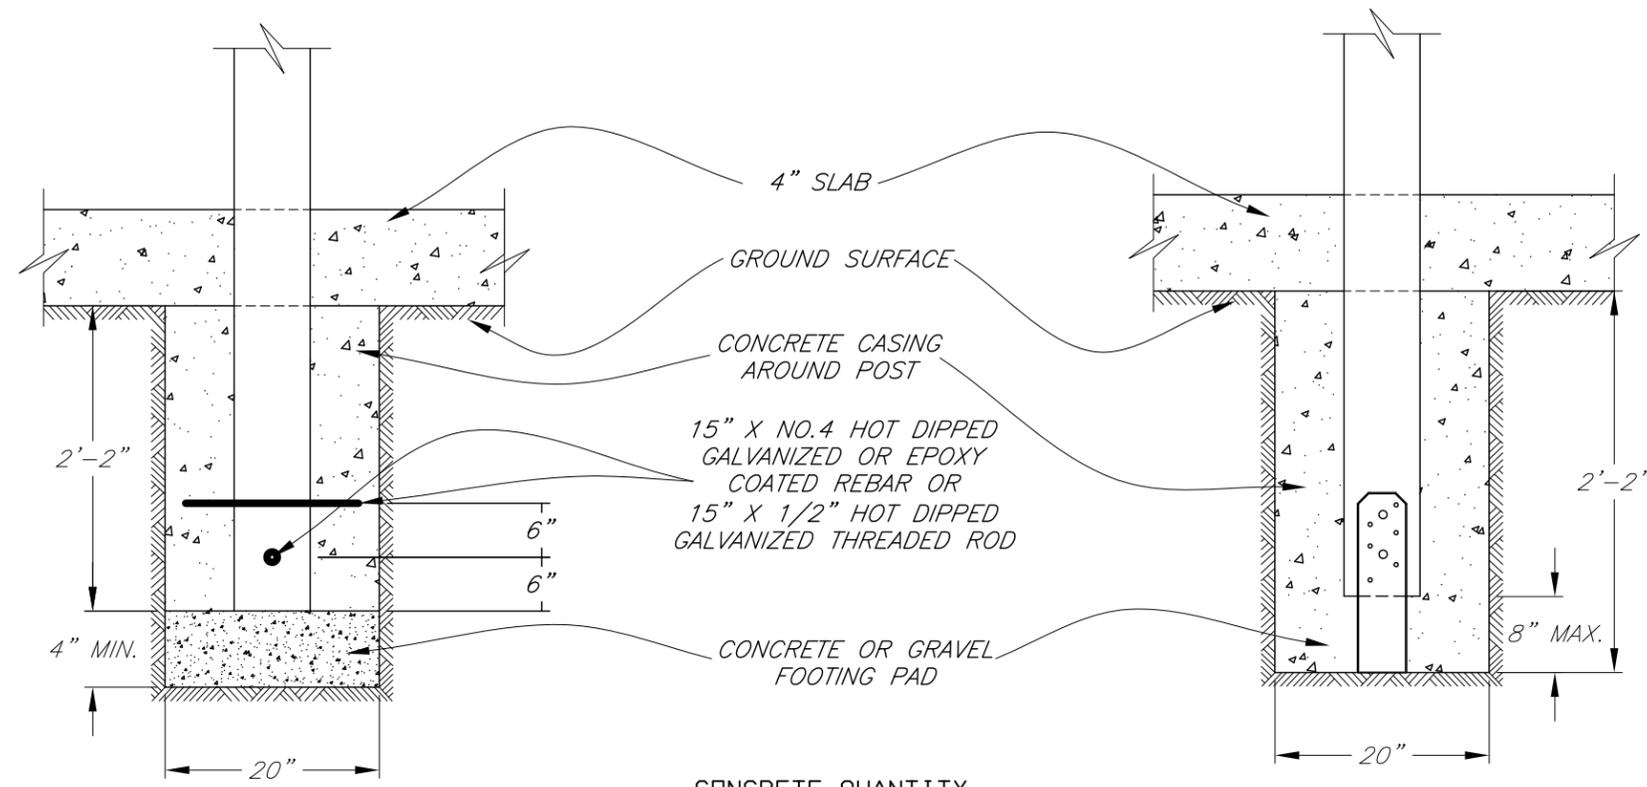


CONCRETE QUANTITY
PER POST HOLE: 0.19 C. Y.

CONCRETE POST FOOTING DETAIL

MECHANICAL POST ANCHOR
CONCRETE FOOTING DETAIL

NOTES:

1. EXAMPLE CONNECTOR SHOWN AT LEFT.
2. MINIMUM UPLIFT RESISTANCE REQUIRED IS 1574 LBS.
3. INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
4. CONNECTOR SHALL BE GALVANIZED.
5. REBAR OR MECHANICAL POST ANCHOR REQUIRED FOR FULL POSTS ONLY.
6. MECHANICAL POST ANCHOR MAY BE USED INSTEAD OF REBAR.

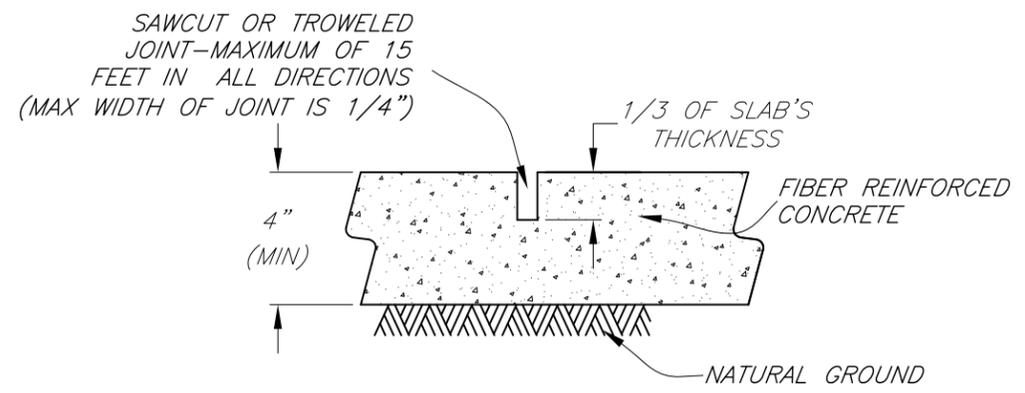

FIBER REINFORCED CONTRACTION JOINT

WOOD TREATMENT TABLE

MINIMUM RETENTION RATES IN PCF					
USE	CCA	ACQ-C/D	CBA-A	CA-B	MCA
GROUND CONTACT OR FRESH WATER	0.40	0.40	0.41	0.21	0.15
IMPORTANT STRUCTURAL MEMBERS	0.60	0.60	0.61	0.31	0.23

CCA - CHROMATED COPPER ARSENATE
 ACQ-C/D - ALKALINE COPPER QUATERNARY
 CBA-A & CA-B - COPPER AZOLE
 MCA - MICRONIZED COPPER AZOLE

NOTES:

1. ALL WOODEN WALLS, HALF POSTS, AND BIN FRONT WOOD SHALL MEET THE GROUND CONTACT RATES.
2. ALL SUPPORT POSTS SHALL MEET THE IMPORTANT STRUCTURAL MEMBER RATES.

Date 07/07
 Designed W. Brown
 Drawn S. Rogers
 Checked H. McFarland
 Approved J. Holloway
H. McFarland 07/07

COMPOSTING FACILITY
 Stand Alone Structure
 With Deep Composting Bins



File No.
ga-eng-317-c1_rev_062016

REVISIONS		
DATE	APPROVED	TITLE
09/05	H. MCFARLAND	STATE ENGINEER
01/06	H. MCFARLAND	STATE ENGINEER
07/07	H. MCFARLAND	STATE ENGINEER
10/10	J. HOLLOWAY	STATE ENGINEER

Drawing No.
Detail 2

01/07/2013
Sheet 5 of 5