


NOTES:


1. MANUFACTURED SAND IS NOT ACCEPTABLE IN DRYWELLS.
2. ALL PERFORATED PIPES MUST BE SCHEDULE 40 PVC OR HIGHER QUALITY, 4 IN DIAMETER MINIMUM.
3. DRYWELLS MUST BE LOCATED:
 - 3.1. - ___ FT MIN. FROM PROPERTY LINE
 - 3.2. - ___ FT MIN. FROM SLAB ON-GRADE BUILDINGS
 - 3.3. - ___ FT MIN. FROM BUILDING FOUNDATION
 - 3.4. - ___ FT MIN. FROM ANOTHER DRY WELL
 - 3.5. - ___ FT MIN. FROM SEPTIC TRENCH OR TANK
 - 3.6. - ___ FT MIN. FROM ALTERNATE WELL LOCATION
 - 3.7. - ___ FT MIN. FROM PRIMARY WELL LOCATION SO AS TO MINIMIZE ANY BASEMENT SEEPAGE

DRY WELL SPECIFICATIONS:


LENGTH:
 WIDTH:
 DEPTH:
 STONE AMOUNT AND TYPE:
 FILTER CLOTH AMOUNT:

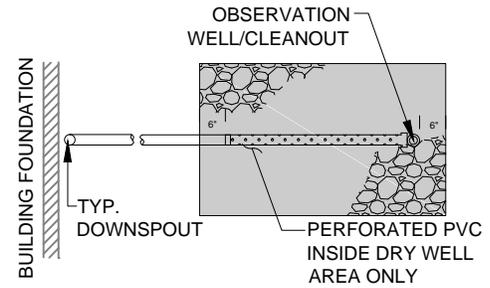


LAYOUT OPTION 1

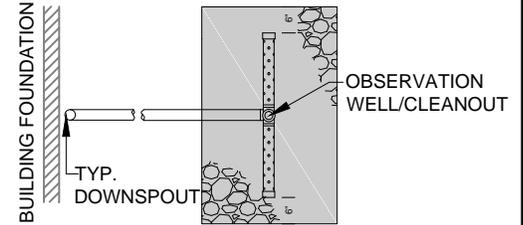

LAYOUT OPTION 2

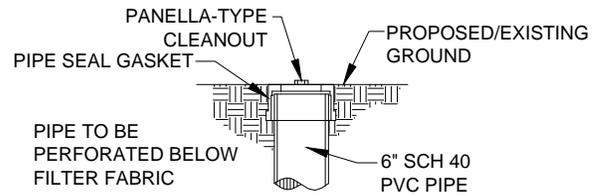

OBSERVATION WELL/ CLEANOUT CAP DETAIL

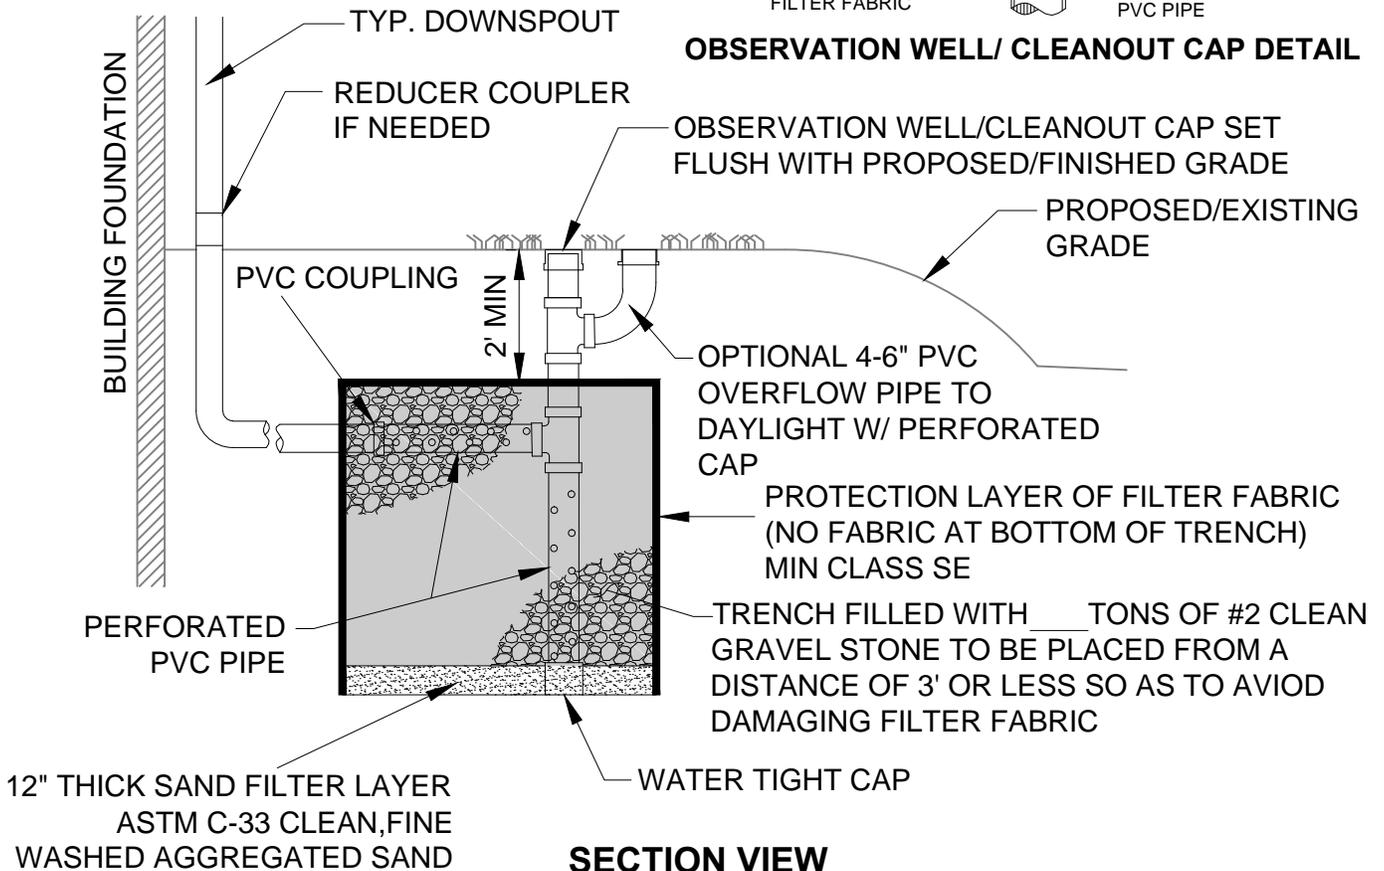

SECTION VIEW

ALL DRAWINGS NOT TO SCALE
 SEE PLAN FOR ALL DIMENSIONS