



BILL OF MATERIALS				HEIGHT =	ft
Max 6' Headwall				LENGTH =	ft
	Quantity	UNIT	TOTAL QUANTITY		
10" Pipe	0.700	lf			
4x8 Timbers	1.600	lf			
3/4" Cable	0.517	lf			
C7x9.8	0.333	lf			
1/2" Dia Bolts	0.133	ea			
10 GA Screws	1.000	ea			
Lock Washers	0.150	ea			
3/4" Dia Bolts	0.150	ea			
1/2" Plate	0.004	sf			
1"x30" Eye Bolts	0.025	ea			
Cable Clamps	0.033	ea			

NOTE:


- A. QUANTITIES ARE PER LINEAR FOOT OF WALL PER UNIT HEIGHT  
 B. TOTAL QUANTITY = QUANTITY x HEIGHT x LENGTH

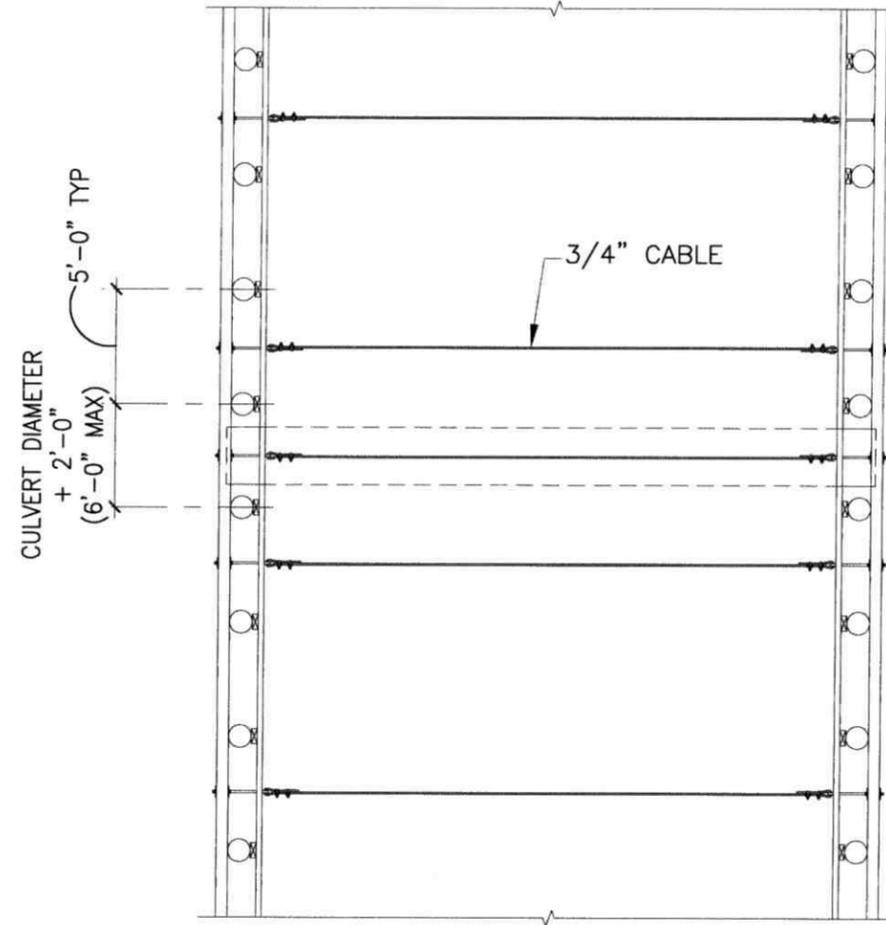

**2 PLAN**  
1/8"=1'-0"

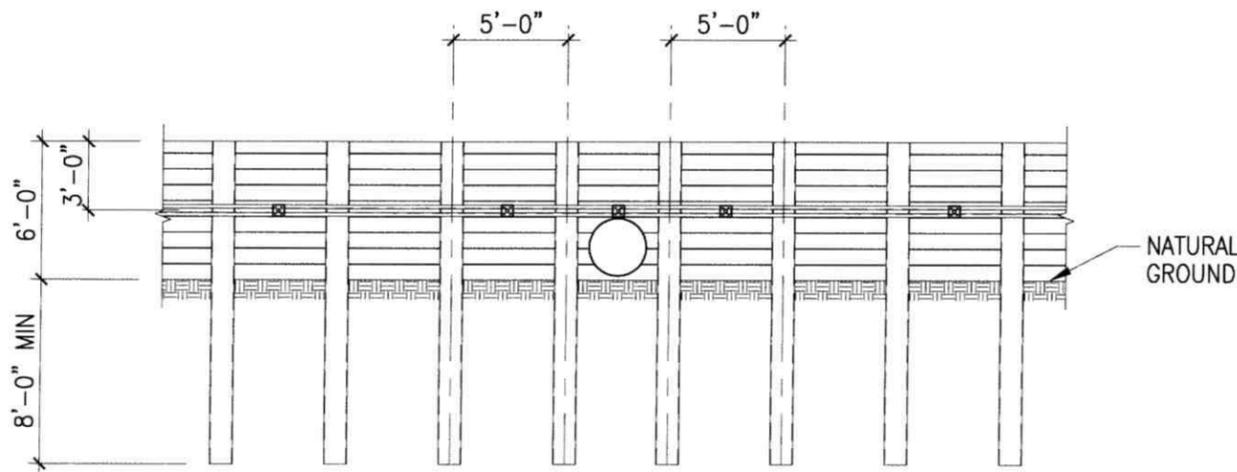

**3 ELEVATION**  
1/8"=1'-0"

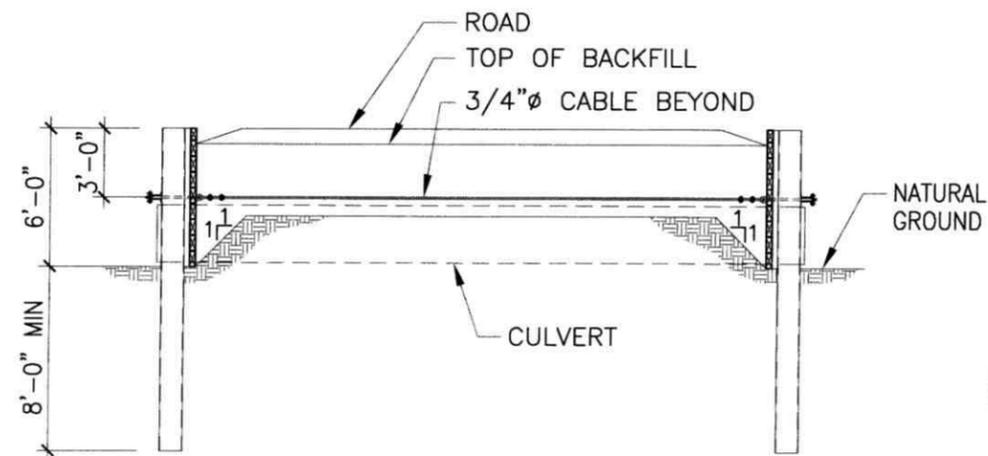

**1 SECTION**  
1/8"=1'-0"



THIS DRAWING WAS PREPARED FOR NRCS BY: **CSG**

PARKILL SMITH & COOPER, INC.  
ENGINEERS & ARCHITECTS-PLANNERS

DESIGNED BY: MSL  
 DRAWN BY: DLD  
 CHECKED BY: JRR  
 FILE NAME:  
 DATE PLOTTED: DEC. 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 6 FOOT MAXIMUM HEIGHT




**NRCS**  
 Natural Resource Conservation Service  
 U.S. Department of Agriculture




REVISIONS	DATE

DRAWING NO. TX-EN-0500


SHEET **1 of 5**

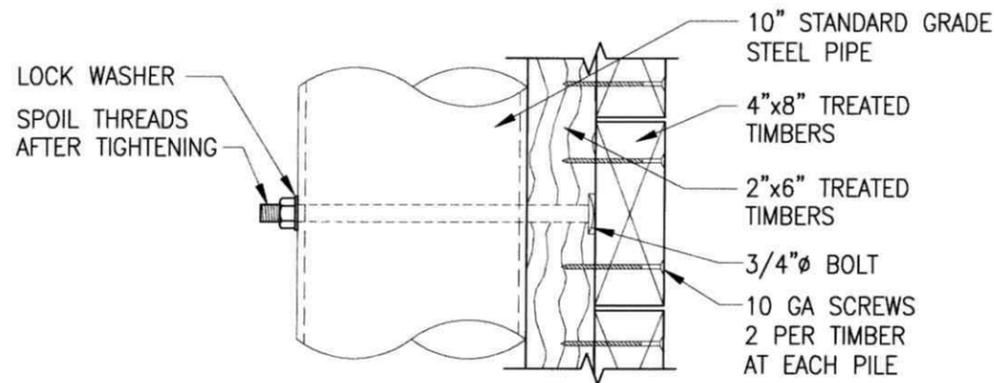


**1** TYPICAL LUMBER CONNECTION DETAIL  
1 1/2"=1'-0"

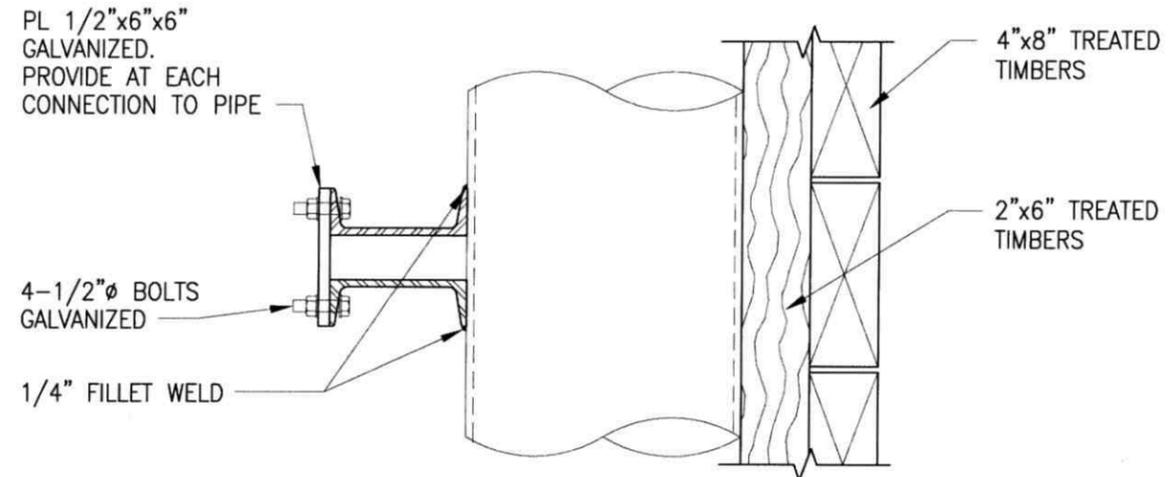

**3** TYPICAL WHALER CONNECTION DETAIL  
1 1/2"=1'-0"

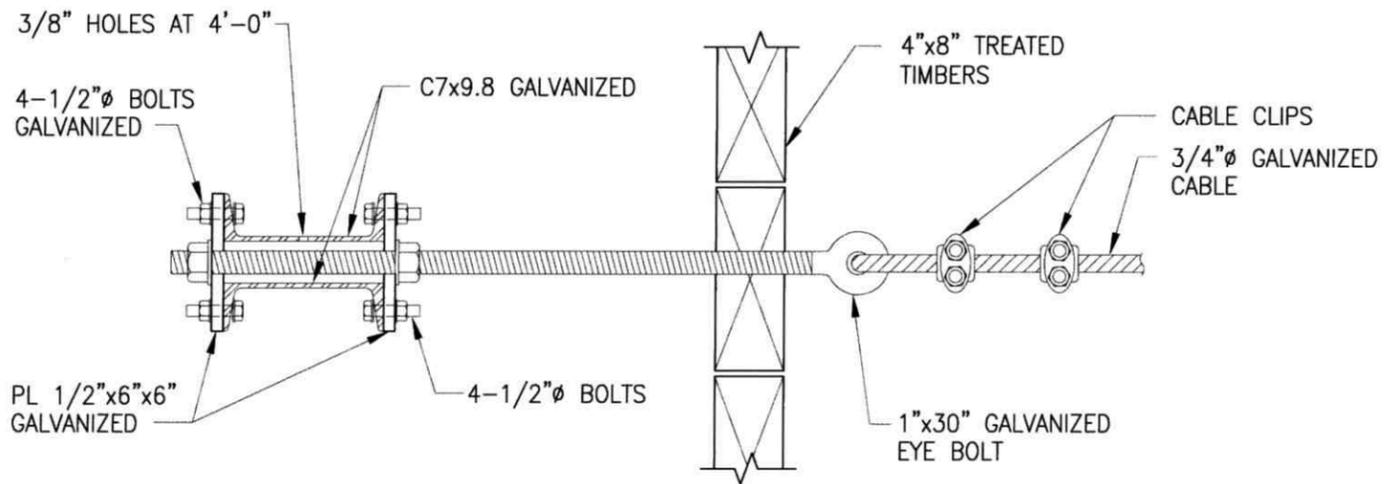

**2** TYPICAL EYEBOLT CONNECTION DETAIL  
1 1/2"=1'-0"

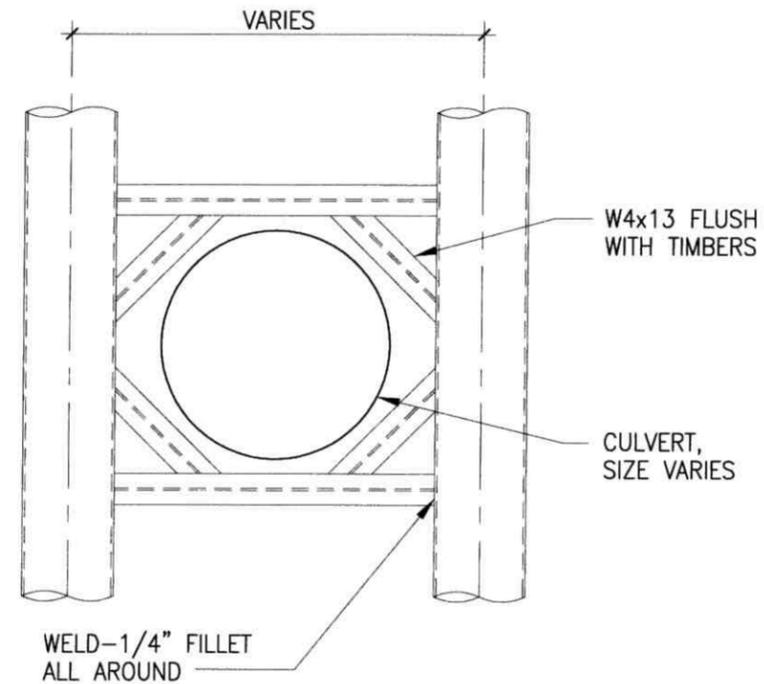

**4** TYPICAL DETAIL AROUND CULVERT  
1/2"=1'-0"



THIS DRAWING WAS PREPARED FOR NRCS BY: **PSG** PARKWELL SMITH & COOPER, INC. ENGINEERS ARCHITECTS PLANNERS

DESIGNED BY: MSL  
DRAWN BY: DLD  
CHECKED BY: JRR  
FILE NAME:  
DATE PLOTTED: DEC 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 6 FOOT MAXIMUM HEIGHT



**NRCS**  
Natural Resources Conservation Service  
U.S. Department of Agriculture

REVISIONS DATE

DRAWING NO. TX-EN-0500

SHEET **2 of 5**

# GENERAL NOTES

- A ALL LUMBER DIMENSIONS ARE NOMINAL DIMENSIONS. ALL LUMBER SHALL BE DOUGLAS FIR OR SOUTHERN PINE, NO. 2 GRADE. ALL LUMBER SHALL BE PRESSURE TREATED. ALL LUMBER SHALL BE PLACED ON THE INSIDE FACE OF THE STEEL PIPE PILES AS SHOWN.
- B ALL STEEL PIPE SHALL BE ASTM A501 GRADE STEEL. ALL STEEL PIPE DIMENSIONS ARE NOMINAL DIMENSIONS.
- C ALL STEEL PIPES SHALL HAVE A CAP PLATE WELDED WITH A CONTINUOUS 1/4" FILLET WELD. SPLICING OF STEEL MEMBERS IS PROHIBITED WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- D PILES MAY BE DRIVEN AND / OR EXCAVATED. IF EXCAVATION IS USED, USE A SATISFACTORY FILL, COMPACTED IN 6" MAXIMUM LOOSE LIFTS TO 95% OF MAXIMUM DENSITY PER ASTM D698-91.
- E ALL BOLTS SHALL BE ASTM A307.
- F THIS DRAWING DOES NOT PROVIDE PROVISIONS FOR TRENCH SAFETY OR THE SAFETY OF ANY WORKER IN OR AROUND THE EXCAVATION. THIS DRAWING DOES NOT INCLUDE CONFLICTS THAT MAY ARISE WITH UNDERGROUND OR OVERHEAD UTILITIES. THESE RESPONSIBILITIES SPECIFICALLY LIE WITH THE CONTRACTOR WHO IS RESPONSIBLE FOR METHODS AND MEANS OF CONSTRUCTION. THE CONTRACTOR WILL COMPLETE TX-EN-80, UTILITIES INVENTORY, PRIOR TO THE START OF ANY WORK AND PROVIDE A COPY TO THE APPROPRIATE NRCS REPRESENTATIVE.
- G FOR HEADWALLS OF ALL HEIGHTS LOCATED IN HIGHLY PLASTIC SOILS (PI=25) GEOTECHNICAL TESTING AND ENGINEERING RECOMMENDATIONS ARE REQUIRED.
- H ALL PIPE SHALL BE SCHEDULE 40 UNLESS OTHERWISE NOTED.
- I GALVANIZED CABLE SHALL MEET ASTM A603.
- J EARTHFILL SHALL BE COMPACTED IN ACCORDANCE WITH CONSTRUCTION SPECIFICATIONS 23, EARTH-FILL, USING CLASS C COMPACTION AS PER THE ITEMS OF CONSTRUCTION DETAILS
- K DRAINFILL SHALL BE MATERIAL FROM METHOD 2 OF CONSTRUCTION SPECIFICATION 24 OF NATIONAL STANDARD CONSTRUCTION SPECIFICATIONS.
- L THE SITE SHALL BE ANALYZED TO DETERMINE IF RIPRAP OR OTHER EROSION CONTROL MEASURES ARE NECESSARY TO MINIMIZE EROSION ADJACENT TO THE STRUCTURE. AREAS TO BE PROTECTED SHALL BE SHOWN ON CURRENT SHEET 2 OF 3 AND DETAILED WITH NOTES TO ADEQUATELY DESCRIBE THE REQUIRED SIZE, EXTENT, THICKNESS, AND DEPTH. OPTIONAL ROCK RIPRAP OUTLET PROTECTION, SHEETS 4 OF 5 AND 5 OF 5 MAY BE USED.

THIS DRAWING WAS PREPARED FOR NRCS BY:



PARKHILL SMITH & COOPER, INC.  
ENGINEERS - ARCHITECTS - PLANNERS


DESIGNED BY: MSB  
 DRAWN BY: DLD  
 CHECKED BY: JRR  
 FILE NAME:  
 DATE PLOTTED: DEC 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 6 FOOT MAXIMUM HEIGHT




STATE OF TEXAS  
 JOSEPH R. RAPIER  
 61147  
 PROFESSIONAL ENGINEER  
 12-21-06


REVISIONS	DATE
DRAWING NO.	TX-EN-0500
SHEET	3 of 5

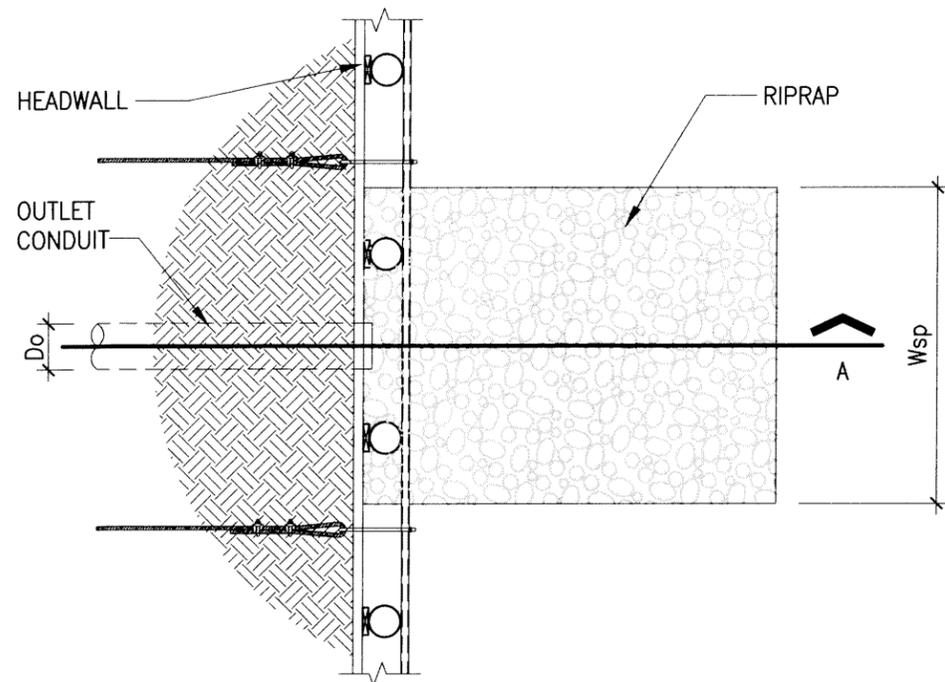


PLAN VIEW

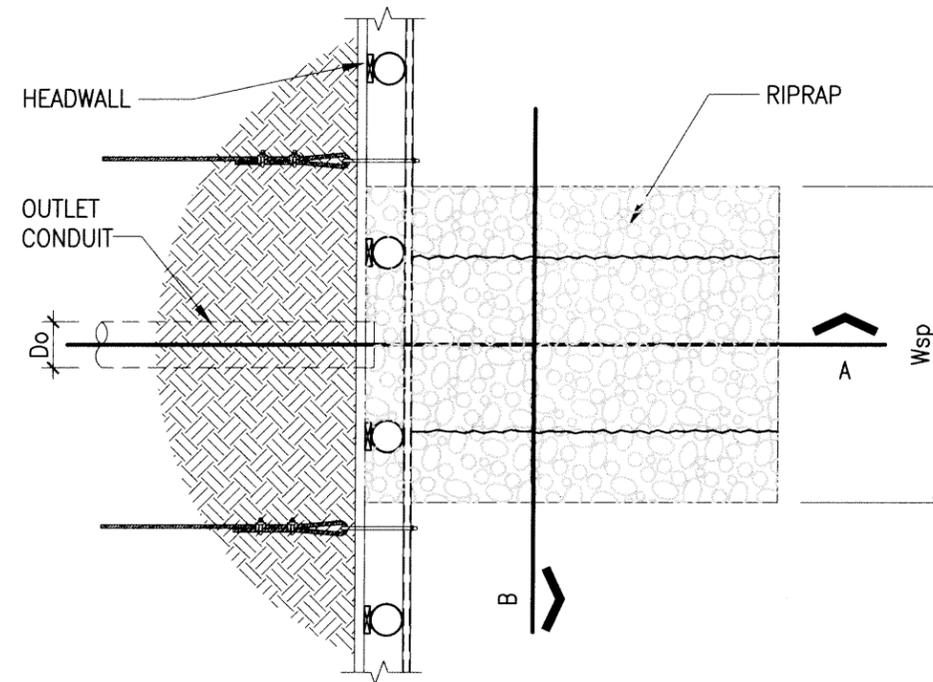

PLAN VIEW

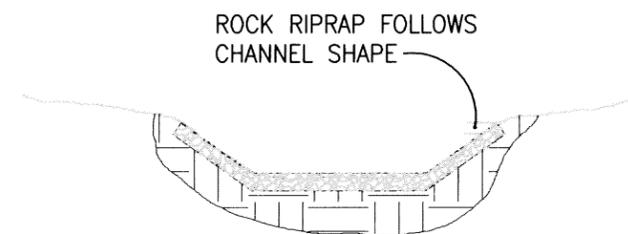


SECTION B

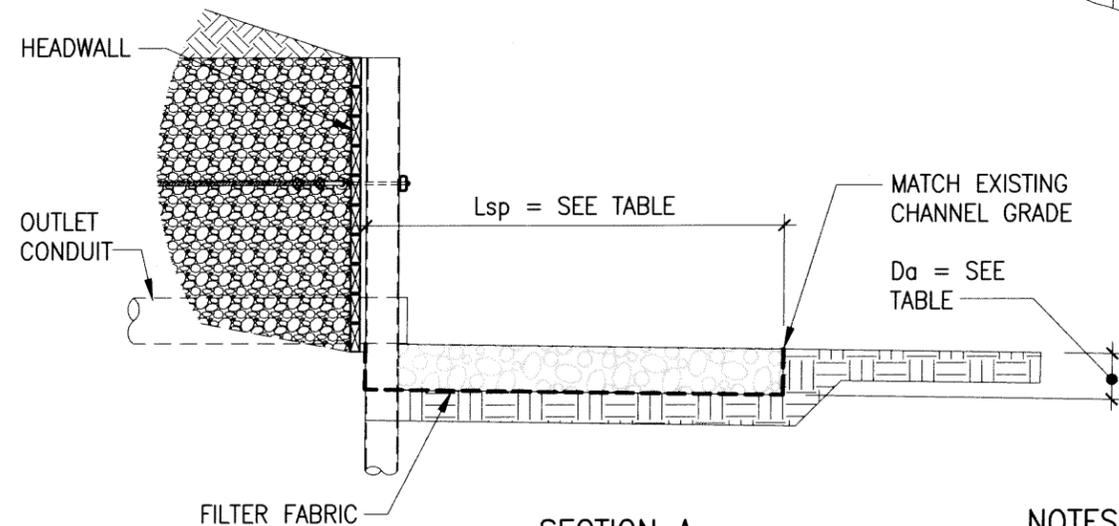

SECTION A

DOWNSTREAM CHANNEL  
NOT WELL DEFINED

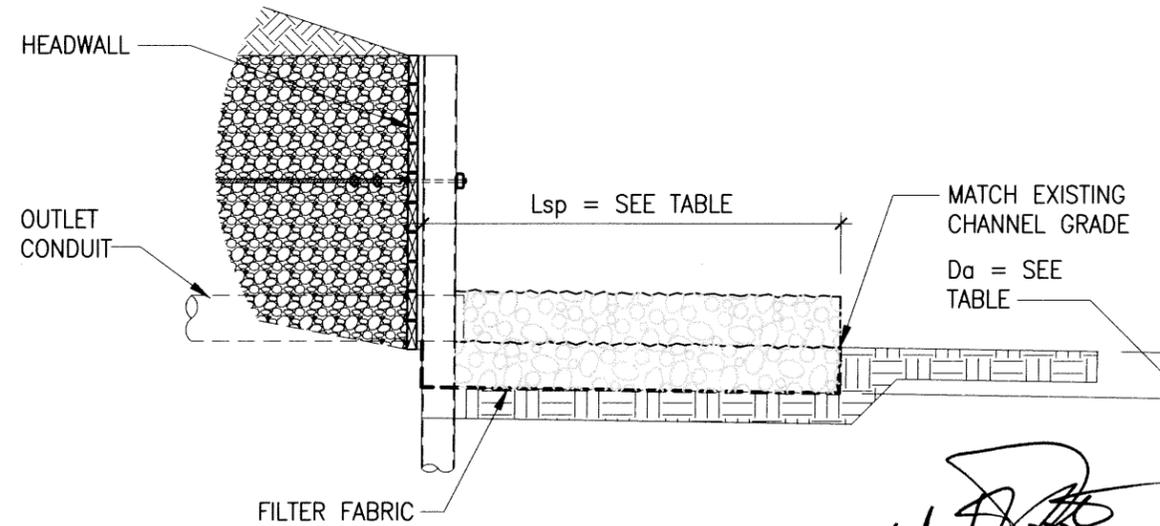


SECTION A

DOWNSTREAM CHANNEL  
WELL DEFINED

NOTES:

1. Lsp = LENGTH OF THE RIPRAP APRON. SEE TABLE
2. Da = DEPTH OF RIPRAP SEE TABLE
3. Wsp = WIDTH OF RIPRAP SEE TABLE
4. IN A WELL DEFINED CHANNEL FOLLOW CHANNEL SHAPE.
5. FILTER FABRIC SHOULD BE INSTALLED BETWEEN THE RIPRAP AND SOIL FOUNDATON.

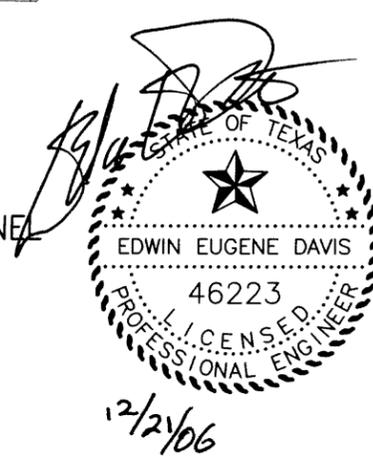

THIS DRAWING WAS PREPARED FOR NCRCS BY: **ESD** PARKHILL, SMITH & COOPER, INC. ENGINEERS - ARCHITECTS - PLANNERS

DESIGNED BY: MEL  
DRAWN BY: DLD  
CHECKED BY: JRR  
FILE NAME:  
DATE PLOTTED: DEC. 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 6 FOOT MAXIMUM HEIGHT



REVISIONS	DATE

DRAWING NO. TX-EN-0500

SHEET  
**4 of 5**

**OUTLET PROTECTION  
ROCK RIPRAP APRON**

PIPE DIAMETER	APRON DIMENSIONS				APRON QUANTITIES			
	LENGTH	WIDTH	ROCK SIZE	ROCK DEPTH	VOLUME	VOLUME	WEIGHT (165 lb/cf)	FILTER FABRIC AREA
do (in)	L <sub>sp</sub> (ft)	W <sub>sp</sub> (ft)	D <sub>50</sub> (inches)	D <sub>a</sub> (inches)	V (cf)	V (cy)	V (tons)	A (sy)
12	21	18	4	6	189	7	16	42
18	32	24	5	8	512	19	42	85
24	42	29	7	11	1,117	41	92	135
30	53	35	9	13	2,010	74	166	206
36	64	40	11	16	3,413	126	282	284
42	74	46	12	19	5,390	200	445	378
48	85	51	14	21	7,586	281	626	482
54	95	57	16	24	10,830	401	893	602
60	106	62	18	26	14,239	527	1175	730
66	116	68	19	29	19,063	706	1573	876
72	127	73	21	32	24,723	916	2040	1030

**CONSTRUCTION NOTES:**

1. THE MAXIMUM ROCK DIAMETER SHOULD BE 1.5x $d_{50}$ .  $d_{50}$  = THE MEDIAN ROCK SIZE IN A WELL GRADED APRON
2. THE ROCK SHALL CONSIST OF FIELD STONE OR ROUGH UNHEWN QUARRY STONE. THE STONE SHALL BE HARD AND ANGULAR AND OF A QUALITY THAT WILL NOT DISINTEGRATE ON EXPOSURE TO WATER OR WEATHERING.
3. GEOTEXTILE (FILTER FABRIC) SHALL BE PLACED BETWEEN THE APRON AND THE UNDERLYING SOIL TO PREVENT SOIL MOVEMENT INTO AND THROUGH THE RIPRAP.

12/21/06

THIS DRAWING WAS PREPARED FOR NRCS BY:

PAVILL, SMITH & COOPER, INC.  
ENGINEERS - ARCHITECTS - PLANNERS

DESIGNED BY: MSL  
 DRAWN BY: DLD  
 CHECKED BY: JRR  
 FILE NAME:  
 DATE PLOTTED: DEC. 2008

HEADWALL WITH TIMBERS AND  
 STEEL PIPE PILES 6 FOOT  
 MAXIMUM HEIGHT



REVISIONS      DATE

DRAWING NO.  
TX-EN-0500

SHEET  
**5 of 5**