



BILL OF MATERIALS					
Max 16' Headwall			HEIGHT =	ft	
	Quantity	UNIT	TOTAL QUANTITY	LENGTH =	ft
10" Pipe	0.750	lf			
4x8 Timbers	1.600	lf			
3/4" Cable	2.906	lf			
C7x9.8	0.375	lf			
1/2" Dia Bolts	0.250	ea			
10 GA Screws	1.615	ea			
Lock Washers	0.250	ea			
3/4" Dia Bolts	0.250	ea			
1/2" Plate	0.016	sf			
1"x30" Eye Bolts	0.063	ea			
Cable Clamps	0.063	ea			


NOTE:
 A. QUANTITIES ARE PER LINEAR FOOT OF WALL PER UNIT HEIGHT
 B. TOTAL QUANTITY = QUANTITY x HEIGHT x LENGTH

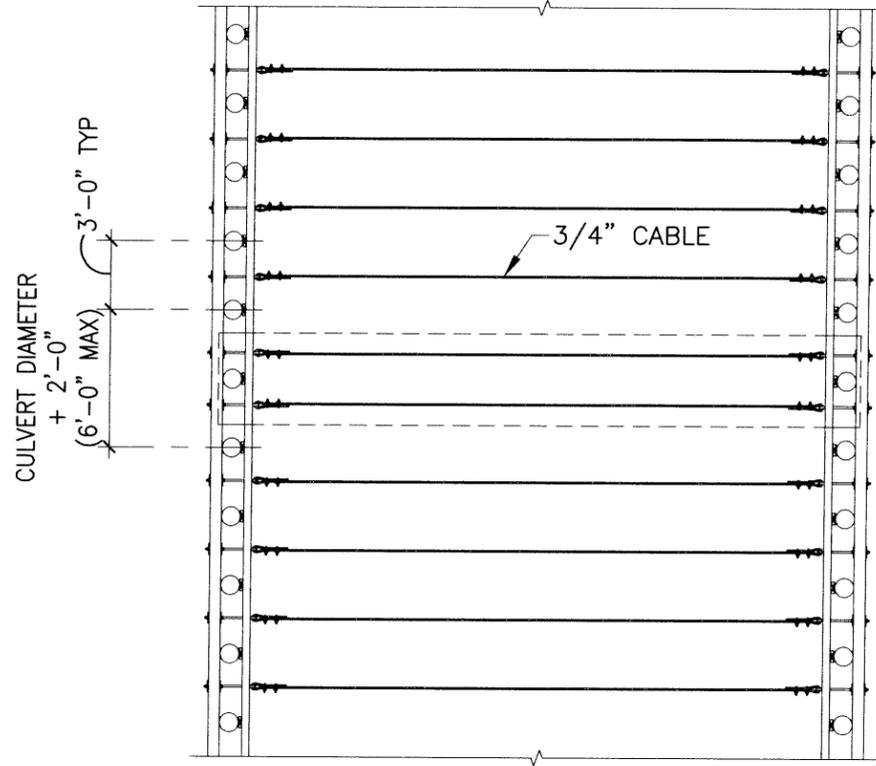

2 PLAN
 1/8"=1'-0"

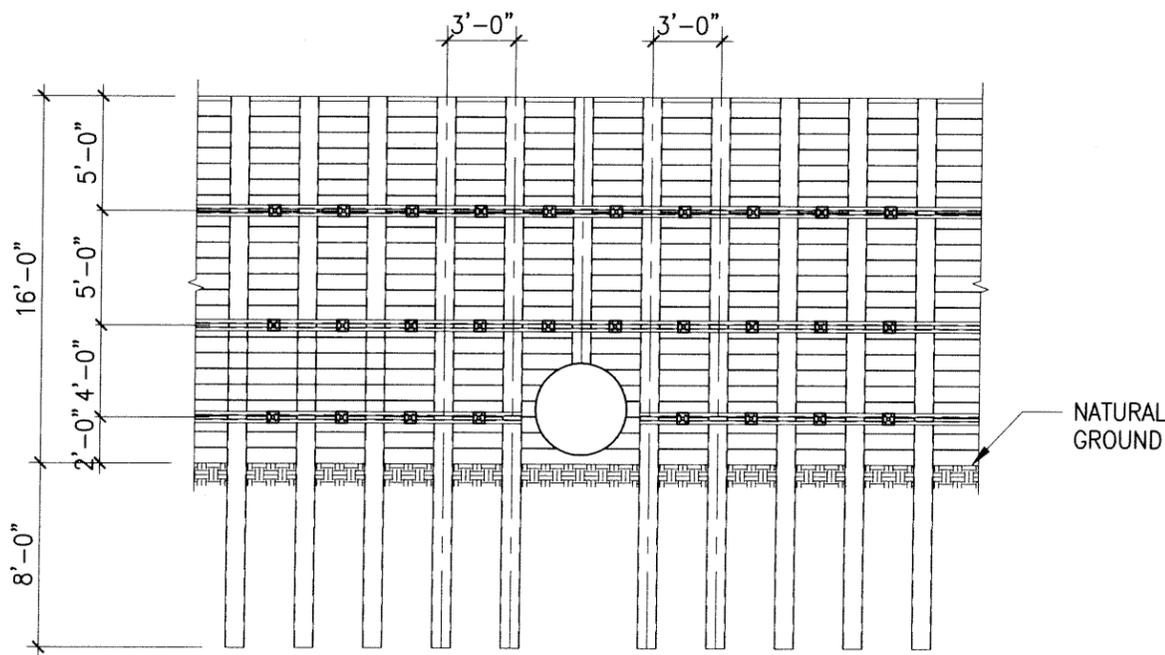

3 ELEVATION
 1/8"=1'-0"

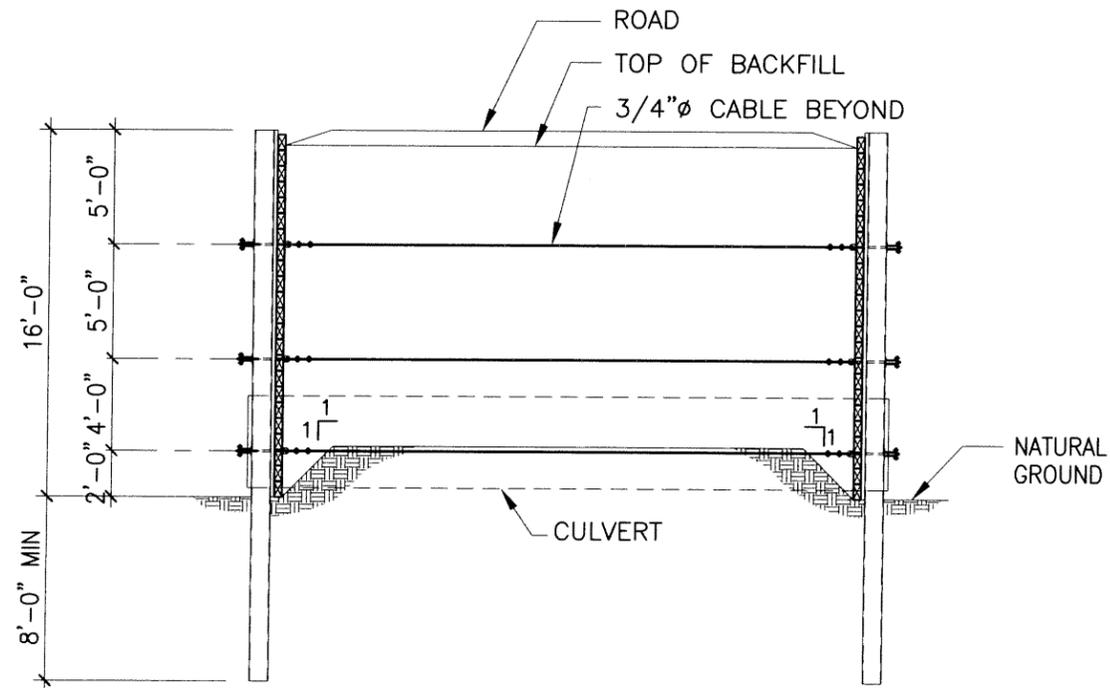

1 SECTION
 1/8"=1'-0"

THIS DRAWING WAS PREPARED FOR NRCS BY: **ESG**
 PARKILL, SMITH & COOPER, INC.
 ENGINEERS - ARCHITECTS - PLANNERS

DESIGNED BY: MSJ
 DRAWN BY: DLD
 CHECKED BY: JRR
 FILE NAME:
 DATE PLOTTED: DEC. 2006


HEADWALL WITH TIMBERS AND STEEL PIPE PILES 16 FOOT MAXIMUM HEIGHT



NRCS
 Natural Resources Conservation Service
 U.S. Department of Agriculture


STATE OF TEXAS
 JOSEPH R. RAPIER
 61147
 LICENSED PROFESSIONAL ENGINEER
 12-21-06

REVISIONS _____ DATE _____
 DRAWING NO. TX-EN-0502
 SHEET 1 of 5

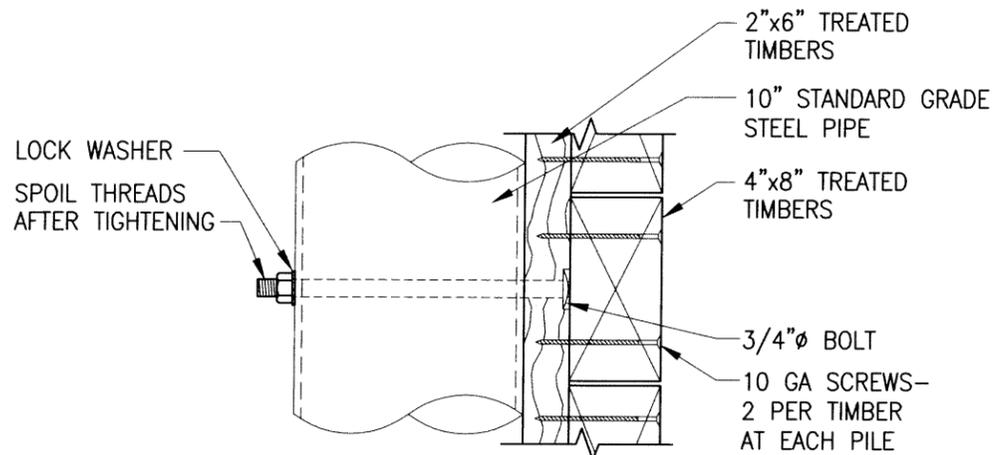


1 TYPICAL LUMBER CONNECTION DETAIL

1 1/2"=1'-0"

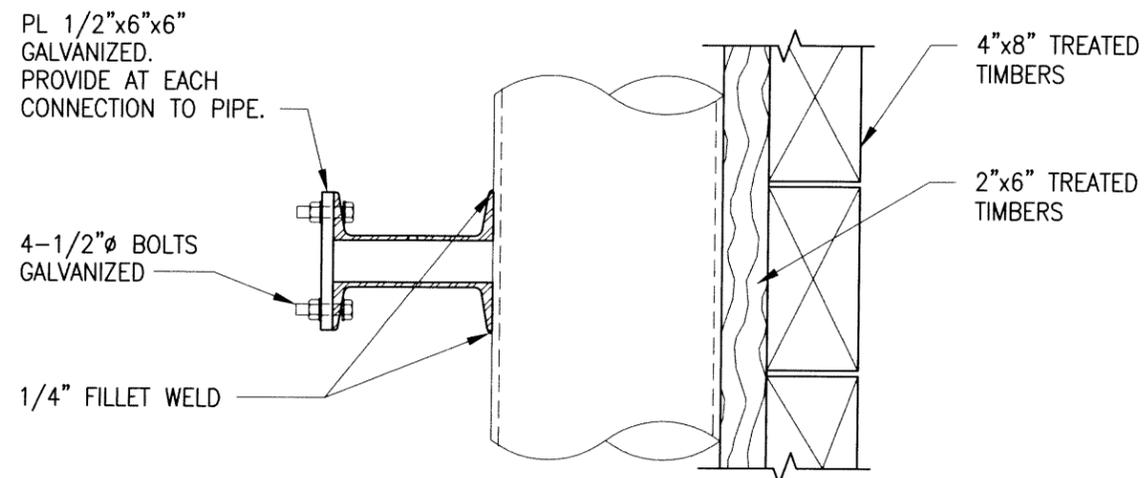


3 TYPICAL WHALER CONNECTION DETAIL

1 1/2"=1'-0"

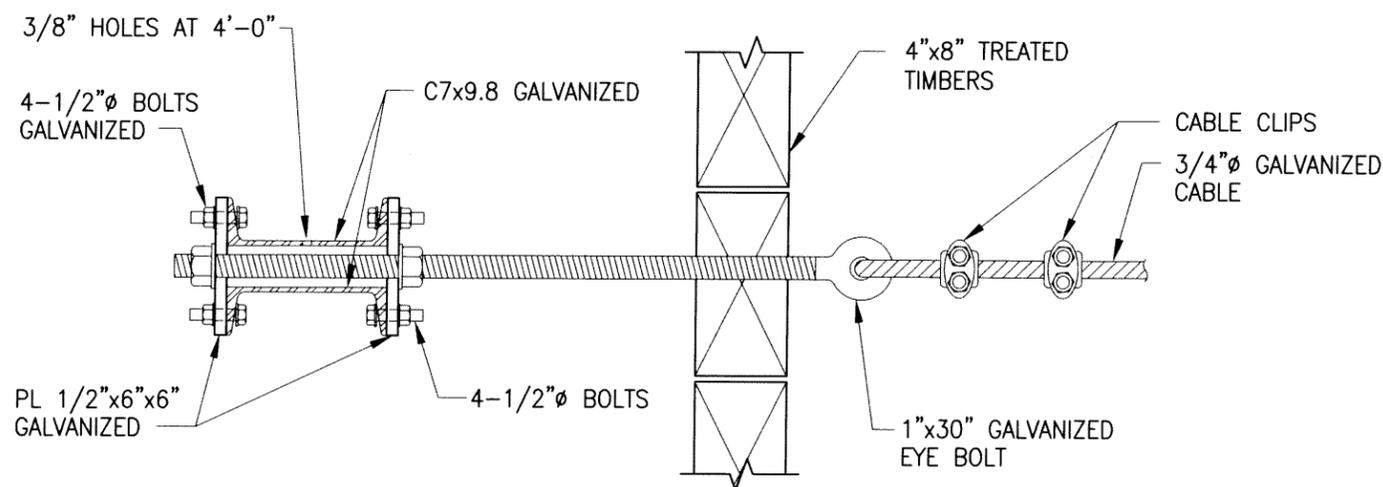


2 TYPICAL EYEBOLT CONNECTION DETAIL

1 1/2"=1'-0"

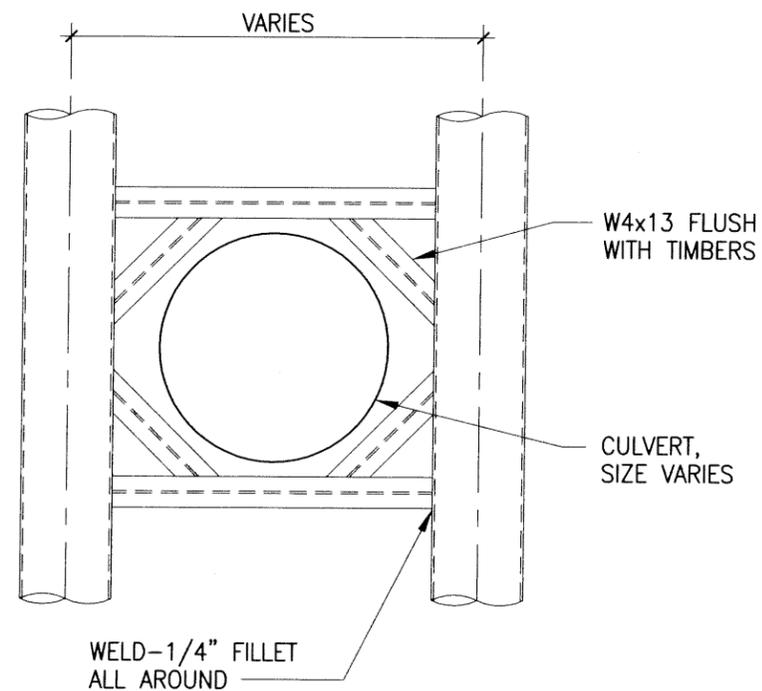

4 TYPICAL DETAIL AROUND CULVERT

1/2"=1'-0"

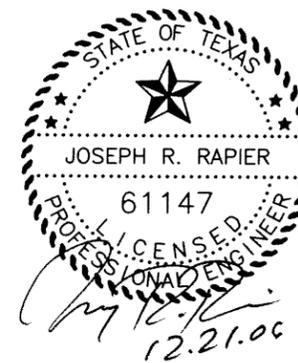

THIS DRAWING WAS PREPARED FOR NRC'S BY: **ESG** PARKWELL SMITH & COOPER, INC. ENGINEERS ARCHITECTS PLANNERS

DESIGNED BY: MSJ
DRAWN BY: DLD
CHECKED BY: JRR
FILE NAME:
DATE PLOTTED: DEC 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 16 FOOT MAXIMUM HEIGHT



NRCS
Natural Resources Conservation Service
U.S. Department of Agriculture



REVISIONS DATE

DRAWING NO. TX-EN-0502

SHEET

2 of 5

GENERAL NOTES

- A ALL LUMBER DIMENSIONS ARE NOMINAL DIMENSIONS. ALL LUMBER SHALL BE DOUGLAS FIR OR SOUTHERN PINE, NO. 2 GRADE. ALL LUMBER SHALL BE PRESSURE TREATED. ALL LUMBER SHALL BE PLACED ON THE INSIDE FACE OF THE STEEL PIPE PILES AS SHOWN.
- B ALL STEEL PIPE SHALL BE ASTM A501 GRADE STEEL. ALL STEEL PIPE DIMENSIONS ARE NOMINAL DIMENSIONS.
- C ALL STEEL PIPES SHALL HAVE A CAP PLATE WELDED WITH A CONTINUOUS 1/4" FILLET WELD. SPlicing OF STEEL MEMBERS IS PROHIBITED WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- D PILES MAY BE DRIVEN AND / OR EXCAVATED. IF EXCAVATION IS USED, USE A SATISFACTORY FILL, COMPACTED IN 6" MAXIMUM LOOSE LIFTS TO 95% OF MAXIMUM DENSITY PER ASTM D698-91.
- E ALL BOLTS SHALL BE ASTM A307.
- F THIS DRAWING DOES NOT PROVIDE PROVISIONS FOR TRENCH SAFETY OR THE SAFETY OF ANY WORKER IN OR AROUND THE EXCAVATION. THIS DRAWING DOES NOT INCLUDE CONFLICTS THAT MAY ARISE WITH UNDERGROUND OR OVERHEAD UTILITIES. THESE RESPONSIBILITIES SPECIFICALLY LIE WITH THE CONTRACTOR WHO IS RESPONSIBLE FOR METHODS AND MEANS OF CONSTRUCTION.
- G SITE SPECIFIC GOETECHNICAL TESTING IS REQUIRED TO ENSURE THAT SOIL PROPERTIES WOULD EITHER MEET OR BE MORE CONSERVATIVE THAN THE DESIGN ASSUMPTIONS. IF THEY DO NOT, A SITE SPECIFIC DESIGN WOULD BE REQUIRED.
- H FOR HEADWALLS OF ALL HEIGHTS LOCATED IN HIGHLY PLASTIC SOILS (PI=25) GEOTECHNICAL TESTING AND ENGINEERING RECOMMENDATIONS ARE REQUIRED.
- I ALL PIPE SHALL BE SCHEDULE 40 UNLESS OTHERWISE NOTED.
- J GALVANIZED CABLE SHALL MEET ASTM A603.
- K EARTHFILL SHALL BE COMPACTED IN ACCORDANCE WITH CONSTRUCTION SPECIFICATIONS 23, EARTH-FILL, USING CLASS C COMPACTION AS PER THE ITEMS OF CONSTRUCTION DETAILS
- L DRAINFILL SHALL BE MATERIAL MEETING THE REQUIREMENTS OF METHOD OF CONSTRUCTION SPECIFICATIONS 24, DRAIN-FILL, AS PER THE ITEMS OF CONSTRUCTION DETAILS.
- M THE SITE SHALL BE ANALYZED TO DETERMINE IF RIPRAP OR OTHER EROSION CONTROL MEASURES ARE NECESSARY TO MINIMIZE EROSION ADJACENT TO THE STRUCTURE. AREAS TO BE PROTECTED SHALL BE SHOWN ON CURRENT SHEET 2 OF 3 AND DETAILED WITH NOTES ADEQUATELY DESCRIBE THE REQUIRED SIZE, EXTENT, THICKNESS, AND DEPTH. OPTIONAL ROCK RIPRAP OUTLET PROTECTION, SHEETS 4 OF 5 AND 5 OF 5 MAY BE USED.



THIS DRAWING WAS PREPARED FOR NRCS BY:

PARKHILL SMITH & COOPER, INC.
ENGINEERS, ARCHITECTS & PLANNERS

DESIGNED BY: MSL
 DRAWN BY: DLD
 CHECKED BY: JRR
 FILE NAME:
 DATE PLOTTED: DEC 2006


HEADWALL WITH TIMBERS AND STEEL PIPE PILES 16 FOOT MAXIMUM HEIGHT




REVISIONS	DATE

DRAWING NO. TX-EN-0502


SHEET 3 of 5

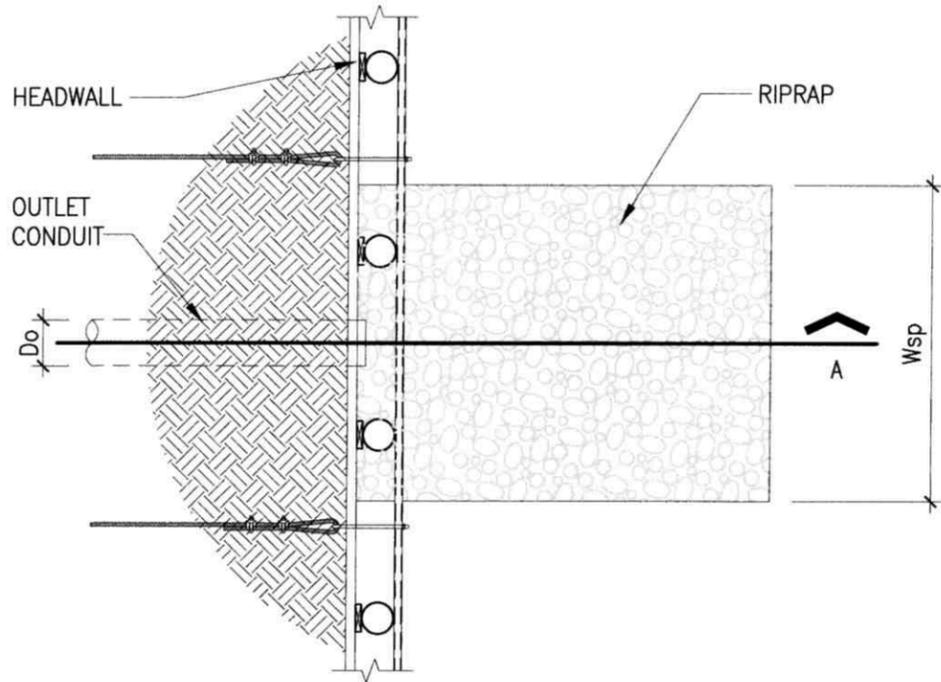


PLAN VIEW

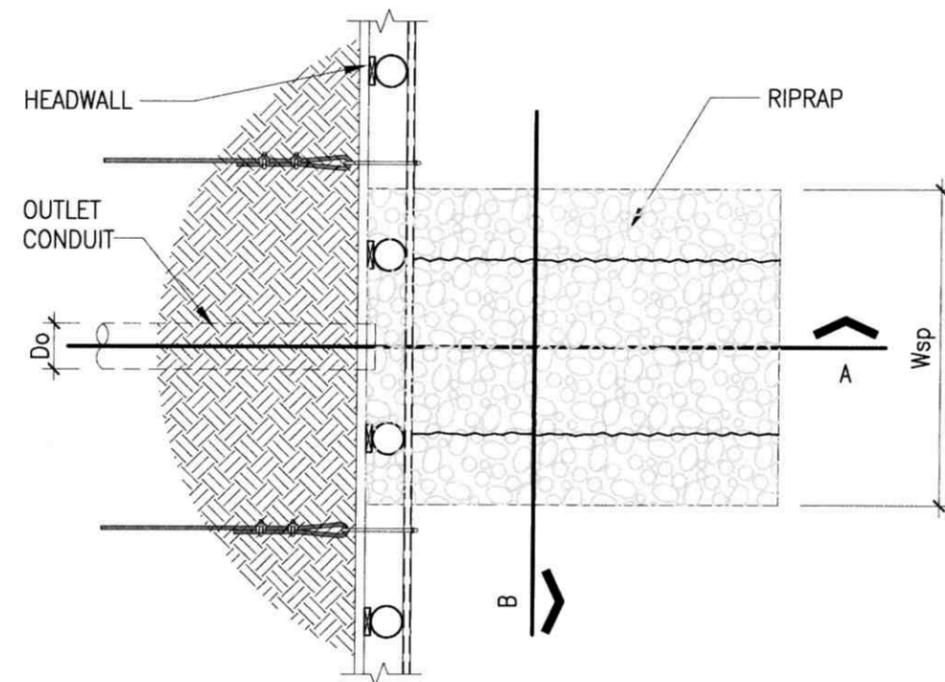

PLAN VIEW

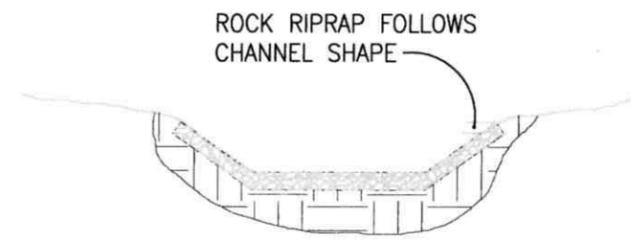


SECTION B

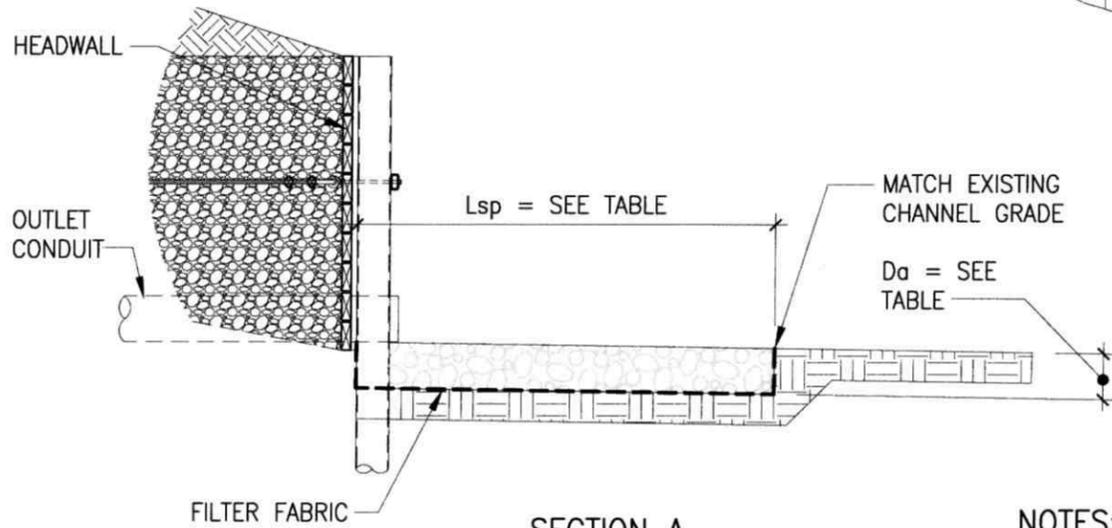

SECTION A

DOWNSTREAM CHANNEL
NOT WELL DEFINED

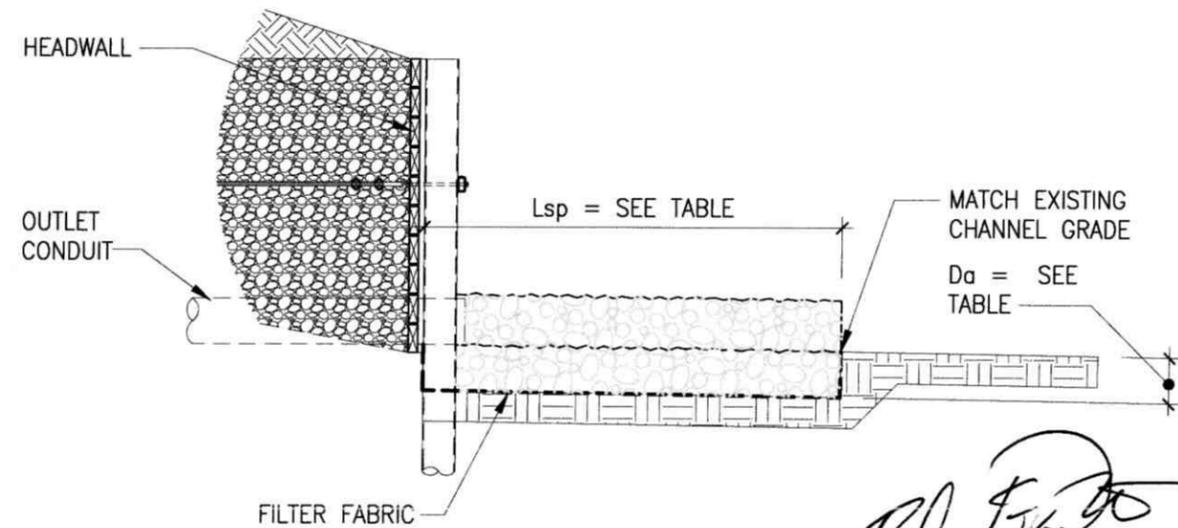

SECTION A
DOWNSTREAM CHANNEL
WELL DEFINED

NOTES:

1. L_{sp} = LENGTH OF THE RIPRAP APRON. SEE TABLE
2. D_a = DEPTH OF RIPRAP SEE TABLE
3. W_{sp} = WIDTH OF RIPRAP SEE TABLE
4. IN A WELL DEFINED CHANNEL FOLLOW CHANNEL SHAPE.
5. FILTER FABRIC SHOULD BE INSTALLED BETWEEN THE RIPRAP AND SOIL FOUNDATON.

THIS DRAWING WAS PREPARED FOR NRCS BY:

DESIGNED BY: MSL
DRAWN BY: DLD
CHECKED BY: JRR
FILE NAME:
DATE PLOTTED: DEC 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 16 FOOT MAXIMUM HEIGHT



REVISIONS	DATE

DRAWING NO. TX-EN-0502
SHEET 4 of 5

**OUTLET PROTECTION
ROCK RIPRAP APRON**

PIPE DIAMETER	APRON DIMENSIONS				APRON QUANTITIES			
	LENGTH	WIDTH	ROCK SIZE	ROCK DEPTH	VOLUME	VOLUME	WEIGHT (165 lb/cf)	FILTER FABRIC AREA
	do (in) L _{sp} (ft)	W _{sp} (ft)	D ₅₀ (inches)	D _a (inches)	V (cf)	V (cy)	V (tons)	A (sy)
12	21	18	4	6	189	7	16	42
18	32	24	5	8	512	19	42	85
24	42	29	7	11	1,117	41	92	135
30	53	35	9	13	2,010	74	166	206
36	64	40	11	16	3,413	126	282	284
42	74	46	12	19	5,390	200	445	378
48	85	51	14	21	7,586	281	626	482
54	95	57	16	24	10,830	401	893	602
60	106	62	18	26	14,239	527	1175	730
66	116	68	19	29	19,063	706	1573	876
72	127	73	21	32	24,723	916	2040	1030

CONSTRUCTION NOTES:

1. THE MAXIMUM ROCK DIAMETER SHOULD BE 1.5x d_{50} . d_{50} = THE MEDIAN ROCK SIZE IN A WELL GRADED APRON
2. THE ROCK SHALL CONSIST OF FIELD STONE OR ROUGH UNHEWN QUARRY STONE. THE STONE SHALL BE HARD AND ANGULAR AND OF A QUALITY THAT WILL NOT DISINTEGRATE ON EXPOSURE TO WATER OR WEATHERING.
3. GEOTEXTILE (FILTER FABRIC) SHALL BE PLACED BETWEEN THE APRON AND THE UNDERLYING SOIL TO PREVENT SOIL MOVEMENT INTO AND THROUGH THE RIPRAP.



THIS DRAWING WAS PREPARED FOR NRCS BY:  PARKHILL, SMITH & COOPER, INC. ENGINEERS - ARCHITECTS - PLANNERS

DESIGNED BY: MSL
DRAWN BY: DLD
CHECKED BY: JRR
FILE NAME:
DATE PLOTTED: DEC. 2006

HEADWALL WITH TIMBERS AND STEEL PIPE PILES 16 FOOT MAXIMUM HEIGHT



REVISIONS DATE

DRAWING NO. TX-EN-0502

SHEET

5 of 5